


Base electric plan

- § SINGLE POLE SWITCH
- §§ DOUBLE POLE SWITCH
- §§§ THREE WAY SWITCH
- §§§§ FOUR WAY SWITCH
- ◇ DIMMER SWITCH
- ◇◇ CEILING FUTURE
- SOURCE (WALL MOUNTED FIXTURE)
- 110V DUPLEX OUTLET
- SWITCHED OUTLET (L2)
- GROUND FAULT INTERRUPT OUTLET
- WATER PROOF GFI OUTLET
- 220V OUTLET
- SPECIAL SERVICES OUTLET
- TV CABLE OUTLET
- TELEPHONE CABLE OUTLET
- RECESSED LIGHTING
- WATER PROOF RECESSED LIGHTING
- BATH FAN
- BATH FAN WITH LIGHT
- SMOKE DETECTOR/CARBON MONOXIDE DETECTOR
- FLOOD LIGHT
- PUSH BUTTON
- CHIME-DOOR BELL
- DISCONNECT SWITCH
- SPEAKER PREWIRE
- JUNCTION BOX
- THERMOSTAT
- LOW VOLTAGE LIGHTING
- INTERCOM
- CEILING FAN
- TRACK LIGHTING
- FLUORESCENT LIGHTING
- GAS DROP

UNLESS OTHERWISE NOTED:

1. ELECTRICAL OUTLET HEIGHTS MEASURED FROM FINISH FLOOR TO CENTRALLINE OF THE BOX TO BE 12" A.F.F. (GENERAL)
2. ALL TRIM PLATES AND DEVICES TO BE GANGED WHERE POSSIBLE
3. ELECTRICAL SWITCHES TO BE AT 42" CENTERLINE A.F.F.
4. ELECTRICAL PLAN INTENDED FOR INFO PURPOSES ONLY. ALL WORK SHALL BE DONE IN STRICT ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE, LATEST EDITION BY A LICENSED ELECTRICAL CONTRACTOR WHO SHALL BE RESPONSIBLE FOR THE INSTALLATION AND SIZING OF ALL ELECTRICAL WIRING AND ACCESSORIES.
5. SMOKE DETECTORS SHALL BE IN ACCORDANCE WITH 2014 FLORIDA RESIDENTIAL CODE, SECTION 514, AND WITH I.A. 517 AND NFPA 722.
6. PROVIDE AFCI FAULT INTERRUPTERS PER 2008 NEC 210.12
7. ALL RECEPTACLES TO BE TAMPER PROOF PER NEC. SECT. 404.11

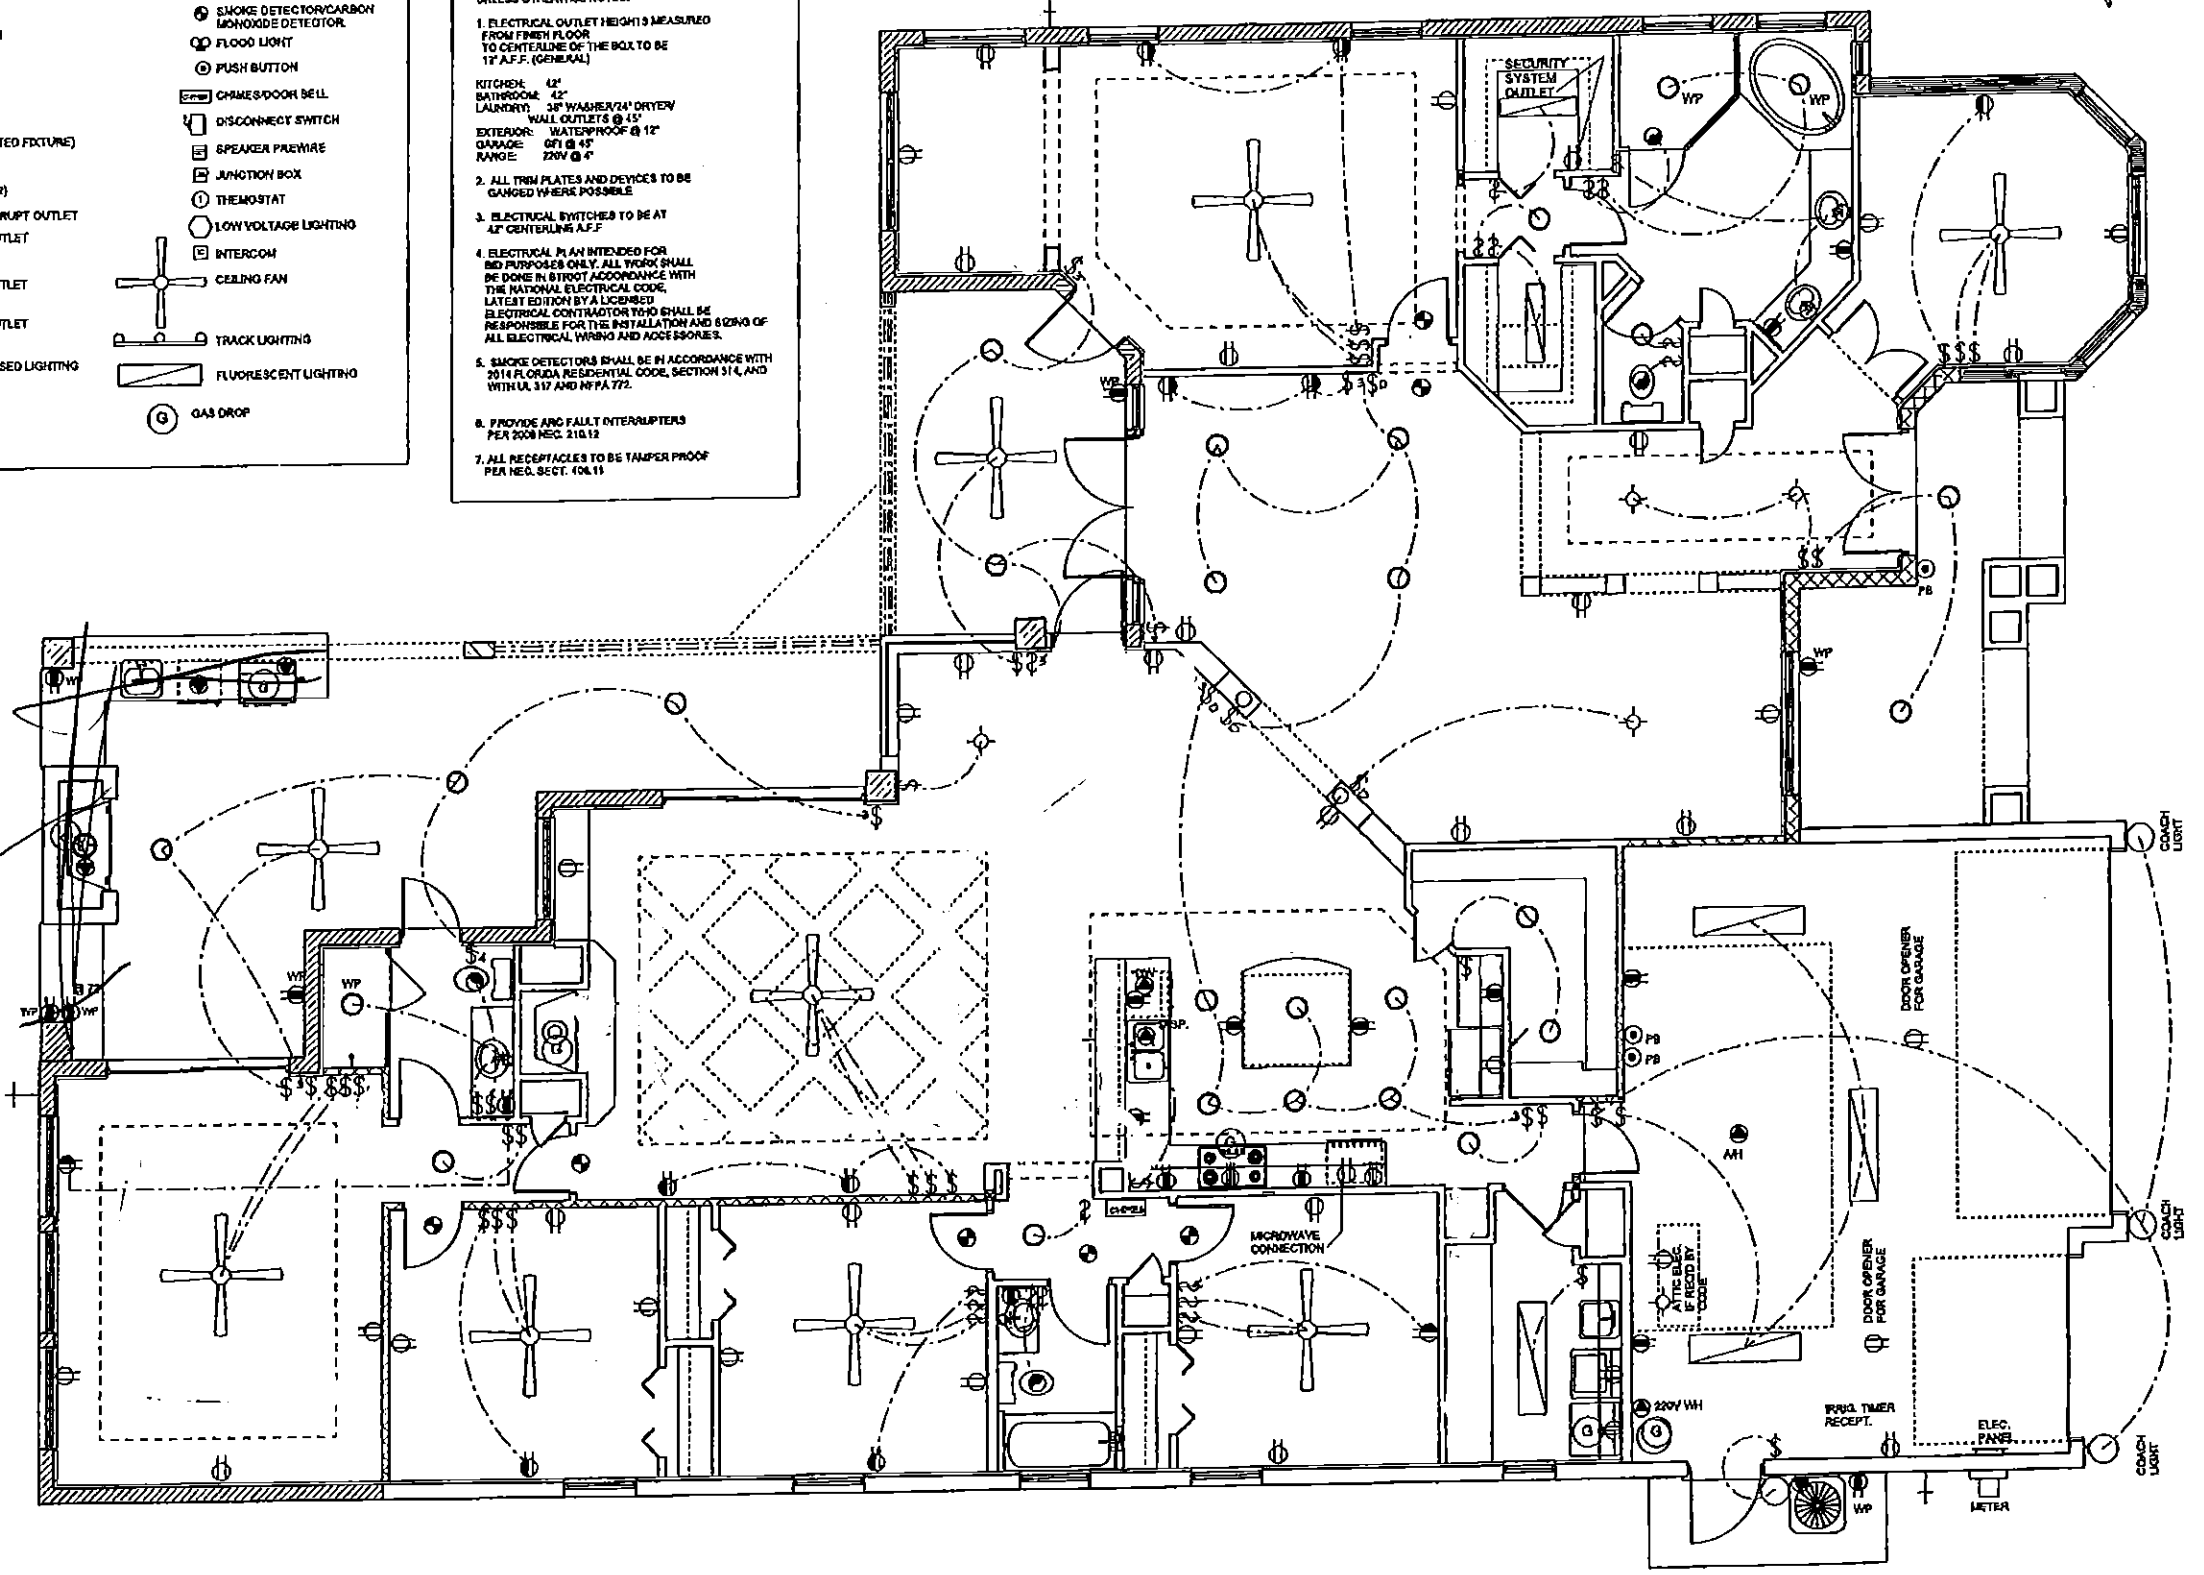

ASPEN 3541-C

1/8" = 1'-0"

LOT 12
BELLEAIR GRANDE

4. STRUCT. ENG. REVIEW
5. PLAN CHANGES
6. OUTDOOR FIREPLACE REVISION
- CONFERRED CEILINGS ADDED

PLAN DATE	DATE
1. 11-11-2015	6. 12-02-2015
2. 11-17-2015	
3. 11-18-2015	
4. 11-22-2015	
5. 11-25-2015	

DEEB FAMILY
HOMES, LTD.
9400 RIVER CROSSING BLD.
NEW PORT RICHEY, FL. 34655

ELECTRICAL PLAN

7