

RESAN 3/20/19 new sheets

CONTRACTOR COPY  
MUST BE POSTED ON SITE

18-1703

ALL WORK SHALL COMPLY WITH  
THE FLORIDA BUILDING CODE  
*Res 2017 6th Edition*  
AND THE NFPA 70 NEC  
*2014 N.E.C.*

SUBJECT TO FIELD  
INSPECTOR APPROVAL

NO SEDIMENTS SHALL LEAVE  
PERMITTED PROPERTY. USE EROSION  
CONTROL MEASURES AS NECESSARY  
PER THE MINIMUM CRITERIA AND  
DESIGN GUIDELINES OF FDEP STORMWATER,  
EROSION & SEDIMENTATION STANDARDS

FAILURE TO COMPLY WITH THE  
APPROVED EROSION CONTROL PLAN  
AND/OR THE MINIMUM CRITERIA AND  
DESIGN GUIDELINES OF FDEP STORMWATER,  
EROSION & SEDIMENTATION STANDARDS MAY  
RESULT IN A "STOP WORK ORDER" AND  
CODE ENFORCEMENT PROCEDURES.

PROVIDE APPROVED TERMITE  
TREATMENT & PROTECTION.

BEDROOM WINDOWS  
SHALL MEET EGRESS  
REQUIREMENTS.

*Blower door  
Test Required*

Plans have not been  
reviewed for Electrical  
Mechanical, Plumbing, and  
Gas, but must meet all  
applicable codes.

TIE-IN SURVEY REQUIRED  
AT SLAB INSPECTION.

PLANS EXAMINED AND REVIEWED FOR CODE  
COMPLIANCE IN ACCORDANCE WITH CITY  
OF SAFETY HARBOR BUILDING CODE  
WITH EXCEPTIONS NOTED

DEC 21 2018

THE ISSUANCE OF THIS PERMIT SHALL NOT  
BE HELD TO PERMIT OR APPROVE THE  
VIOLATION OF ANY CITY, COUNTY OR STATE  
LAW CODE REGULATION OR ORDINANCE

**GENERAL NOTES:**

THE FOLLOWING TECHNICAL CODES  
SHALL APPLY:  
2017 FLORIDA BUILDING CODE,  
PLUMBING, MECHANICAL, FUEL GAS,  
ENERGY EFFICIENCY, ACCESSIBILITY,  
AND NATIONAL ELECTRICAL CODES  
NEC 2014

1. TANK TYPE WATER CLOSET VOLUME  
1.8 GALLONS
2. WALL MOUNT WATER CLOSET VOLUME  
3.5 GALLONS
3. WATER - FLOW RATE.  
PUBLIC FACILITIES 0.5 G.P.M.  
PRIVATE FACILITIES 2.2 G.P.M.  
SHOWER HEADS 2.5 G.P.M.

VTR LOCATIONS ARE APPROXIMATE  
AND MAY CHANGE DUE TO JOBSITE  
CONDITIONS  
THE FOLLOWING SHALL COMPLY  
WITH THE 2017 FBC.

- PORCHES AND BALCONIES
- HANDRAILS
- GUARDRAILS
- STAIRS
- CHIMNEY & FIREPLACE
- EGRESS WINDOWS

4. ALL OPENINGS SHALL COMPLY WITH  
2017 FBC WIND LOADS AS STATED  
BELOW. ATTACHMENTS OF WINDOWS,  
DOORS, SLIDING GLASS DOORS  
AND O.H. GARAGE DOORS ARE DELEGATED  
THE MANUFACTURER OF THESE ITEMS. THE  
MANUFACTURER OF THESE ITEMS  
SHALL SUBMIT ATTACHMENTS TO ENGINEER  
OF RECORD FOR REVIEW PRIOR TO INSTALLATION.  
SEE ATTACHED SPECIFICATION SHEETS FOR  
MANUFACTURERS DESIGN CRITERIA AND  
INSTALLATION METHODS FOR WINDOWS,  
DOORS, SLIDING GLASS DOORS, OVERHEAD  
GARAGE DOORS, AND ROOFING.


5. ALL DOORS INTERIOR & EXTERIOR ARE  
8' 0" UNLESS OTHERWISE NOTED  
ALL SHOWER ENCLOSURES TO BE  
TEMPERED GLASS
6. ALL WINDOWS WITHIN 24" OF DOORS  
(INTERIOR & EXTERIOR) AND WITHIN  
18" OFF FLR TO BE TEMPERED GLASS.

**SOFTPLAN**  
ARCHITECTURAL DESIGN SOFTWARE

**ROBBIAN DESIGN**  
AL ROBBIAN A.I.B.D.  
6397 CONNORWOOD SQ.  
NEW PORT RICHEY, FL. 34653  
(727) 848-2259  
MAIL: al@robbiandesign.com



**AIBD** 7059 Blair Road NW  
Suite 201  
**BD** Washington DC 20012



ALLEN ENGINEERING AND CONSTRUCTION SERVICES, INC. (AECS) IS NOT  
RESPONSIBLE FOR THE ARCHITECTURAL DESIGN, ITS FEATURES AND  
ASSOCIATED DIMENSIONS. THE ARCHITECTURAL INFORMATION IS ACCEPTED  
AS BEING ACCURATE AND IS USED BY AECS SOLELY FOR THE PURPOSE OF  
DETERMINING STRENGTH, FIRE PROTECTION, AND FLOOD RESISTANCE  
CONSTRUCTION REQUIREMENTS.

**INDEX OF DRAWINGS**

SHEET	TITLE
S	COVER SHEET
S1	STRUCTURAL ENGINEER NOTES
S2	STRUCTURAL ENGINEER NOTES
S3	STRUCTURAL ENGINEER NOTES
S4	WIND LOAD DESIGN DATA
1	FOUNDATION PLAN
1A	FOUNDATION PLUMBING LAYOUT
2	FIRST FLOOR PLAN NOTES
2A	SECOND FLOOR PLAN NOTES
3	FIRST FLOOR DIMENSION PLAN
3A	SECOND FLOOR DIMENSION PLAN
3B	SECTION DETAILS
3C	SECTION DETAILS
4	EXTERIOR ELEVATIONS
5	EXTERIOR ELEVATIONS
6	ROOF PLAN
6A	SECOND FLOOR FRAMING
6B	SECOND FLOOR ROOF TRUSSES
6C	TRUSS KEY NOTES
7	FIRST FLOOR ELECTRICAL PLAN
7A	SECOND FLOOR ELECTRICAL PLAN
8	CONSTRUCTION DETAILS
9	CONSTRUCTION DETAILS
10	TYPICAL ONE STORY WALL SECTIONS
10A	TYPICAL TWO STORY WALL SECTIONS
11	TYPICAL FOOTING DETAILS

**NOTICE TO SUBCONTRACTORS :**

DUE TO SPACE LIMITATIONS IN THIS 11"X 17" PLAN  
FORMAT, AND TO ELIMINATE CLUTTER AND TEXT  
READABILITY ISSUES, SOME DETAILS AND NOTATIONS  
MAY OR MAY NOT BE LOCATED ON THE SAME SHEETS  
OR IN THE SAME LOCATIONS AS PROVIDED FOR BY  
OTHER CONTRACTORS OR ARCHITECTS.  
IT WOULD BE IN YOUR BEST INTREST TO REVIEW THESE  
PLANS AND LOCATE THE APPROPRIATE INFORMATION  
REQUIRED TO COMPLETE YOUR SPECIFIC PORTION OF  
THE JOB BEFORE BEGINNING CONSTRUCTION.

**NOTICE TO BUILDER**

IT IS THE INTENT OF THIS DESIGNER THAT  
THESE PLANS ARE ACCURATE AND ARE  
CLEAR ENOUGH FOR THE LICENSED PROFESSIONAL  
TO CONSTRUCT THIS PROJECT.  
IN THE EVENT THAT SOMETHING IS UNCLER  
OR NEEDS CLARIFICATION. STOP AND CALL  
THE DESIGNER LISTED IN THIS TITLE PAGE. IT  
IS THE RESPONSIBILITY OF THE LICENSED  
PROFESSIONAL THAT IS CONSTRUCTING THIS  
PROJECT TO FULLY REVIEW THESE DOCUMENTS  
BEFORE CONSTRUCTION BEGINS AND ANY AND  
ALL CORRECTIONS, IF NEEDED, TO BE MADE  
BEFORE ANY WORK IS DONE.

**WINDOW INSTALLATION NOTES:**

1. WINDOWS MUST BE FASTENED INTO STRUCTURAL MEMBERS  
PER MFG'S. DETAIL REQUIREMENTS PER DESIGN CRITERIA  
NOTED ON THESE DRAWINGS.
2. WINDOWS ARE NOT IMPACT RESISTANT TYPE. STORM  
SHUTTERS OR PANELS ARE REQUIRED.
3. ROOF, WALLS AND WINDOW FASTENINGS MUST BE  
ENGINEERED AND SPECIFIED FOR CUMULATIVE INTERNAL  
PRESSURE AND EXTERNAL NEGATIVE ( SUCTION ) PRESSURES  
WHICH VARIES ACCORDING TO AREAS AS NOTED IN THE DESIGN  
CRITERIA AS NOTED ON PAGE S4.

A.E.C.S. 18040 PLAN 3020

ALLEN ENGINEERING &  
CONSTRUCTION SERVICES  
RICH ALLEN PROFESSIONAL ENGINEER  
P.E. # 56920 C.A. # 9542  
8809 SKYMASTER DR.  
NEW PORT RICHEY, FL. 34654  
727-842-6100  
richallenpe@gmail.com

HEREBY CERTIFY THAT I HAVE  
PERFORMED THE ATTACHED DESIGN  
TO COMPLY WITH 145 MPH ULTIMATE  
WIND LOADS AND IT IS IN COMPLIANCE  
WITH SECT. 301 OF THE 2017 FLORIDA  
RESIDENTIAL BUILDING CODE  
SEALED FOR STRUCTURE ONLY  
SIGNATURE: RICH ALLEN P.E. #56920

INVENTORY LOT 22  
365 HAMILTON AVE  
SAFETY HARBOR

PLAN DATE
07-17-18
09-17-18
12-11-18

DEEB FAMILY  
HOMES, LTD.  
9400 RIVER CROSSING BLD.  
NEW PORT RICHEY, FL. 34655  
727-376-6831



COVER SHEET

**STRUCTURAL ENGINEER DESIGN NOTES**

**ADMINISTRATIVE**

1. THE ENGINEERING FIRM FOR THIS STRUCTURAL DESIGN IS ALLEN ENGINEERING AND CONSTRUCTION SERVICES, INC. HEREBY REFERRED TO AS "AECS OR "A.E.C.S".
2. THE ENGINEER FOR THIS STRUCTURAL DESIGN IS RICHARD E. ALLEN, P.E. HEREIN REFERRED TO AS "STRUCTURAL ENGINEER".
3. THE STRUCTURAL ENGINEER DESIGN NOTES ARE PART OF THE STRUCTURAL DESIGN AND ARE TO BE TAKEN AS TYPICAL REQUIREMENTS UNLESS NOTED OTHERWISE, "UNO", IN THE STRUCTURAL PLANS AND STRUCTURAL DETAILS.
4. THE DESIGN SHOWN IN THESE PLANS CONFORM TO THE STRUCTURAL PROVISIONS OF THE CHAPTER 16 OF THE FLORIDA BUILDING CODE, SECTION R301 OF THE FLORIDA RESIDENTIAL BUILDING CODE 2017, THE SECTIONS TITLED "STRUCTURAL" OF THE FLORIDA EXISTING BUILDING CODE 2017.
5. THE PURPOSE OF THESE PLANS IS TO OBTAIN A BUILDING PERMIT AND FOR SUBSEQUENT CONSTRUCTION OF THE DESIGN AS SHOWN. THESE PLANS ARE TO BE CONSIDERED VOID IF WORK COMMENCES PRIOR TO A PERMIT BEING ISSUED, A CHANGE IN THE BUILDING CODE OCCURS PRIOR TO THE PLANS BEING SUBMITTED FOR PERMIT OR AFTER SIX MONTHS OF THE DATE THAT THESE PLANS ARE SIGNED AND SEALED WITHOUT BEING SUBMITTED FOR PERMITTING, WHICHEVER OCCURS FIRST. ONCE A BUILDING PERMIT HAS BEEN ISSUED BASED ON THESE PLANS, THE BUILDING DEPARTMENT IS NOT AUTHORIZED TO REISSUE OR TRANSFER BUILDING PERMITS WITHOUT THE EXPRESSED WRITTEN CONSENT OF THE STRUCTURAL ENGINEER.
6. CONSTRUCTION BASED ON THE STRUCTURAL DESIGN IS TO BE DONE AS SHOWN IN THE PLANS WITHOUT DEVIATION, CHANGE OR OMISSION WITHOUT PRIOR APPROVAL OF THE STRUCTURAL ENGINEER. IF ADDITIONAL DETAIL INFORMATION, OR EXPLANATION IS NEEDED, IT IS TO BE OBTAINED FROM THE STRUCTURAL ENGINEER. THE STRUCTURAL ENGINEER IS NOT RESPONSIBLE FOR ANY ADDITIONAL PARTS OF THESE PLANS, INCLUDING PROVISIONS AS STATED IN ITEM 4.
7. IT IS IMPORTANT TO UNDERSTAND THAT STRUCTURAL PROVISIONS OF THE BUILDING CODE ARE COMPLICATED AND THESE PLANS ARE INTENDED TO BE USED BY AN EXPERIENCED BUILDING CONTRACTOR. PROPERTY OWNERS OBTAINING OWNER-BUILDER PERMITS ARE PROCEEDING AT THEIR OWN RISK. THE STRUCTURAL ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS BY PROPERTY OWNERS OR THEIR AGENTS AS A RESULT OF ANY MISUNDERSTANDING OF THE PLANS THE OTHERWISE WOULD BE UNDERSTOOD BY A LICENSED CONTRACTOR.
8. THE STRUCTURAL ENGINEER IS NOT RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, AND SCHEDULE.
9. THE STRUCTURAL PLANS AND ANY RELEVANT DESIGN DOCUMENTS PRODUCED UNDER THE DIRECT CHARGE OF THE STRUCTURAL ENGINEER ARE THE PROPERTY OF THE STRUCTURAL ENGINEER AND MAY NOT BE USED BY ANY PERSON OTHER THAN THE CONTRACTED CLIENT AND FOR ANY PURPOSE OTHER THAN THAT STATED IN ITEM 5 ABOVE WITHOUT THE EXPRESSED WRITTEN CONSENT OF THE STRUCTURAL ENGINEER. MOREOVER, NO OTHER ENGINEER OR ARCHITECT IS TO BE DESIGNATED A DELEGATED ENGINEER FOR ANY PURPOSE RELATED TO THESE STRUCTURAL PLANS OR CONSTRUCTION BASED ON THESE PLANS PRIOR TO THE ISSUANCE OF A CERTIFICATE OF COMPLETION OR OCCUPANCY WITHOUT THE EXPRESSED WRITTEN CONSENT OF THE STRUCTURAL ENGINEER.

**DESIGN CRITERIA**

10. LOAD COMBINATIONS : THIS DESIGN IS BASED ON AN "ALLOWABLE-STRESS" FORMULATION RELYING ON THE LOAD COMBINATIONS DEFINED IN FBC 2017 SECTION 1605.3.1 OR SECTION 1605.3.2 WHERE OMEGA EQUALS 1.3
11. FOUNDATION LOADS: SEE NOTES ON " SITE CONDITIONS, SOILS, AND FOUNDATIONS".
12. FLOOR LIVE LOADS:
  - RESIDENTIAL ONE AND TWO STORY FAMILY DWELLINGS: ALL LIVE LOADS PER TABLE R301.5
  - UNINHABITABLE ATTICS WITHOUT STORAGE : 10 PSF
  - UNINHABITABLE ATTICS WITH STORAGE : 20 PSF
  - HABITABLE ATTICS AND SLEEPING AREAS: 30 PSF
  - BALCONIES: 60 PSF
  - DECKS: 40 PSF
  - ALL OTHER ROOMS 40 PSF
  - GUARDRAILS /HANDRAILS :200PSF CONCENTRATED LOAD APPLIED IN ANY DIRECTION.

13. INFORMATION CONTAINED ON A PLAN SHEET WHERE HIS SIGNATURE AND SEAL APPEAR, THAT DOES NOT PERTAIN TO THE RELEVANT STRUCTURAL PROVISIONS AS STATED IN ITEM 4, INCLUDING, BUT NOT LIMITED TO THE BUILDING OCCUPANCY, THE ARCHITECTURAL DESIGN, ITS FEATURES, FINISHES (I.E. DECORATIVE STUCCO, SIDING, ROOFING, SOFFITS, FLASHING, PAINTING, ETC) AND THEIR INSTALLATION, DIMENSIONS, AND ANY DESIGN OF FIRE PROTECTION, ELECTRICAL, PLUMBING, AND MECHANICAL COMPONENTS OR SYSTEMS. THE ARCHITECTURAL INFORMATION, INCLUDING DIMENSIONS SHOWN IN THESE PLANS AND PROVIDED TO THE ENGINEER.
17. N/A
18. SITE PLAN AND TOPOGRAPHY
  - A. THE STRUCTURAL ENGINEER IS NOT A SURVEYOR AND IS NOT RESPONSIBLE FOR THE SITE PLAN, ESTABLISHING REQUIRED SET-BACKS, AND LOCATING THE BUILDING ON THE PROPERTY.
  - B. THE STRUCTURAL ENGINEER IS NOT RESPONSIBLE FOR THE GRADING OF THE SITE OR ITS COMPLIANCE WITH ANY DRAINAGE PLAN WHETHER INDIVIDUAL OR AS A PART OF A MASTER DRAINAGE PLAN.
  - C. THE FOUNDATION DESIGN IS BASED ON THESE PRESUMED CONDITIONS INCLUDING THAT DIFFERENTIAL SETTLEMENT DOES NOT EXCEED THE SAFE LIMITS OF THE FOUNDATION DESIGN (INCLUDING STEM WALLS AND MASONRY ABOVE GRADE WALLS) AS STATED IN ITEM 19 BELOW.
  - D. IT IS IMPORTANT TO KNOW THAT THE FOUNDATION DESIGN BASED ON A PRESUMED ALLOWABLE SOIL BEARING CAPACITY OF 2,000 PSF RELIES ON LESS THAN L/500 (E.G., 0.25 INCHES OVER 10 FEET) OF DIFFERENTIAL SETTLEMENT. CRACKS IN MASONRY WALLS SHOULD BE EXPECTED WHERE DIFFERENTIAL SETTLEMENT EXCEEDS L/150. THIS STATEMENT SHOULD BE TAKEN AS A CAUTIONARY NOTE FOR PROCEEDING WITHOUT A SOILS ANALYSIS AND FOUNDATION RECOMMENDATION BY A GEOTECHNICAL ENGINEER FOR THE SITE.
  - E. COPIES OF ANY AND ALL REQUIRED COMPACTION TESTS ARE TO BE PROVIDED TO THE BUILDING DEPARTMENT FOR THEIR RECORDS.

**STRUCTURAL ELEMENTS**

19. FOUNDATION, FOOTING AND GROUND FLOOR SLAB
  - A. THE FOUNDATION AND FOOTINGS ARE TO BEAR A MINIMUM ON 12 INCHES BELOW GRADE AND ARE TO BE PLACED ON UNDISTURBED SOIL OR FILL COMPACTED TO A MINIMUM OF 95% MODIFIED PROCTOR PURSUANT TO ASTM D 1557 WITH FILL LIFTS LESS THAN 12".

**COMMERCIAL**

- ALL LIVE LOADS PER FBC 2017 TABLE 1607.1
14. ROOF LIVE LOADS: ALL ROOF / WOOD CONSTRUCTION TYPES ARE 30 PSF.
  15. DEAD LOADS: FLOOR WOOD FRAME : 35 PSF FOR TILE/MARBLE FLOOR COVERING, 15 PSF FOR ALL OTHERS. ROOF WOOD FRAME : 25 PSF FOR SHINGLES, 35 PSF FOR TILE
  16. WIND LOADS:
    - A. WIND LOADS ARE BASED ON THE SPECIFIC REQUIREMENTS AND DEFINITIONS OF FLORIDA RESIDENTIAL BUILDING CODE 2017 EDITION ASCE-7-10.
    - B. THE COMPONENT AND CLADDING WIND PRESSURES ARE THE MINIMUM REQUIREMENTS FOR STRENGTH AND IMPACT PROTECTION NEEDED FOR SELECTING SATISFACTORY COMPONENTS AND CLADDING, BY OTHERS, FOR THE STRUCTURE.

ENGINEERING BY OTHERS IS PRESUMED ACCURATE AND IS RELIED UPON BY THE STRUCTURAL ENGINEER SOLELY FOR THE PURPOSE OF ACHIEVING COMPLIANCE WITH THE RELEVANT STRUCTURE

20. MIX DESIGNS FOR ALL CONCRETE USED IN THE CONSTRUCTION OF SLAB - ON - GRADE FLOORS SHALL SPECIFY A MINIMUM DESIGN STRENGTH OF 3,000 PSI (20.7 MPa) AT 28 DAYS AND A DESIGN SLUMP NOT TO EXCEED 4 INCHES (102 mm) . ON-SITE SLUMPS SHALL NOT EXCEED 5 INCHES (127mm) , PROVIDE TOTAL WATER ADDED TO THE MIX INCLUDING PLANT, TRANSIT AND SITE ADDED WATER DOES NOT EXCEED THE FOLLOWING PARAMETERS:
  1. FOR MIXES USING NATURAL SANDS: 275 POUNDS PER CUBIC YARD (33 GALLONS - 125L )
  2. FOR MIXES USING MANUFACTURED SANDS : 292 POUNDS PER CUBIC YARD (35 GALLONS - 132L )

- A. IN ADDITION, THE STRUCTURAL ENGINEER IS NOT A CIVIL OR GEOTECHNICAL ENGINEER AND IS NOT RESPONSIBLE FOR DETERMINING THE SUITABILITY OF THE SITE FOR CONSTRUCTION, INCLUDING ITS TOPOGRAPHY, DRAINAGE AND SUB-SURFACE CONDITIONS (INCLUDING WATER TABLE DEPTH) AND FOR INTERPRETING GEOTECHNICAL DATA CONCERNING THE SITE.
- B. IF SOIL CONDITIONS AT THE SITE APPEAR QUESTIONABLE AS DETERMINED BY THE BUILDING CONTRACTOR OR OWNER-BUILDER, A SOILS ANALYSIS SHALL BE PERFORMED BY A LICENSED GEOTECHNICAL ENGINEER THAT WILL GIVE SPECIFIC RECOMMENDATIONS FOR A FOUNDATION TYPE. IF THE BUILDING CONTRACTOR OR OWNER-BUILDER DO NOT MAKE THAT DETERMINATION AND A SOILS ANALYSIS IS NOT PERFORMED, THE STRUCTURAL ENGINEER SHALL PROCEED WITH THE DESIGN BASED ON THE PRESUMPTIONS ALLOWED BY THE FBC 2017, SEC. 1804.
- C. THE DETERMINATIONS OF THE SUITABILITY OF THE SITE FOR CONSTRUCTION ( INCLUDING TOPOGRAPHICAL INFORMATION ) AND THE SOIL CONDITIONS SHALL HAVE BEEN COMPLETED AND ANY RECOMMENDATIONS RESULTING FROM THAT ANALYSIS SHALL HAVE BEEN PROVIDED TO THE STRUCTURAL ENGINEER PRIOR TO THE SIGNING AND SEALING OF THE STRUCTURAL PLANS.
- D. IN THE ABSENCE OF GEOTECHNICAL INFORMATION, THE SITE IS PRESUMED TO HAVE AN ALLOWABLE SOIL BEARING CAPACITY OF 2000 PSF AND THE TOPOGRAPHY AS IT RELATES TO THE STRUCTURE IS PRESUMED TO BE THAT SHOWN IN THE PLANS.
- E. THE SIZE AND REQUIRED REINFORCEMENT FOR THE FOOTINGS ARE SHOWN ON THE FOUNDATION PLAN.
- F. THE GROUND FLOOR SLAB SHALL BE PLACED OVER A 6 MIL. POLYETHYLENE MOISTURE RETARDER.

- I. THE TRUSS SYSTEM DESIGN PROVIDED IN THIS PLAN IS FOR THE USE OF THE TRUSS MANUFACTURER IN DEVELOPING THE ACTUAL ROOF TRUSS SYSTEM DESIGN. IT IS NOT TO BE USED FOR ANY OTHER PURPOSE AS IT IS SUBJECT TO ENGINEERING AND MAY BE DIFFERENT FROM THE FINAL DESIGN.
- II. MANUFACTURED FLOOR TRUSSES SHALL BE DESIGNED BY A LICENSED TRUSS COMPONENT AND TRUSS SYSTEM ENGINEER ACTING AS A DELEGATED ENGINEER AND WORKING THROUGH A TRUSS MANUFACTURER FOR THIS PURPOSE. THE SELECTION OF THE TRUSS MANUFACTURER IS HEREBY SUBORDINATED TO THE BUILDING CONTRACTOR.
- III. THE MANUFACTURED TRUSS DESIGN SHALL INCLUDE SPECIFYING THE TRUSS TO TRUSS AND TRUSS TO GIRDER CONNECTIONS ON EITHER THE INDIVIDUAL TRUSS COMPONENT SHEETS OR THE GIRDER TRUSS COMPONENTS SHEETS AS APPLICABLE. A SPECIFIC HANGER MUST BE SELECTED AND IDENTIFIED ON THE SIGNED AND SEALED COMPONENT SHEETS FOR EACH LOCATION THAT A HANGER IS REQUIRED IN THE TRUSS SYSTEM.
- IV. THE TRUSS PLAN SIGNED AND SEALED BY THE DELEGATED ENGINEER SHALL BE PROVIDED TO AND REVIEWED BY THE STRUCTURAL ENGINEER FOR COMPLYING WITH THE DESIGN INTENT OF THE ORIGINAL PLAN AND FOR ANY CHANGES TO THE "TRUSS TO UNDERLYING STRUCTURE" CONNECTIONS. THIS PLAN MUST BE PROVIDED TO THE STRUCTURAL ENGINEER PRIOR TO CONSTRUCTION ON THE UNDERLYING STRUCTURE AS THE STRUCTURAL ENGINEER RESERVES THE RIGHT TO MAKE STRUCTURAL CHANGES BASED UPON THE FINAL FLOOR TRUSS SYSTEM.

- F. CONVENTIONAL FRAMED JOISTS WITH A MINIMUM 6 INCH OVERLAP OF JOINTS.
- G. TERMITE TREATMENT OF THE SITE SHALL BE SPECIFIED BY THE BUILDING CONTRACTOR OR OWNER-BUILDER.
- H. SHRINKAGE CONTROL OF THE FLOOR SLAB SHALL BE ACCOMPLISHED BY 6 INCH BY 6 INCH . W 1.4 BY 1.4 WELDED WIRE FABRIC AS SPECIFIED BY FBC 2017 SECTION 1910.2 EXCEPTION 2 OR FIBERMESH ADMIXTURE AS SPECIFIED BY FBC 2017, SECTION 1910.2 EXCEPTION 1. THE WELDED WIRE FABRIC SHALL BE PLACED BETWEEN THE MIDDLE AND UPPER 1/3 DEPTH OF THE SLAB AND HELD IN POSITION BY APPROPRIATE SUPPORTS SPACED NOT GREATER THAN 3 FEET APART.
- I. CONTRACTION JOINTS ARE TO BE PROVIDED FOR THE PURPOSE OF CONTROLLING SHRINKAGE. ONE INCH DEEP CUTS (FOR A FOUR INCH THICK SLAB OR 25 PERCENT OF THE SLAB THICKNESS OTHERWISE) ARE TO BE PROVIDED ACROSS THE WIDTH AND LENGTH OF ANY FLOOR SLAB AT A DISTANCE OF NOT TO EXCEED 30 TIMES THE SLAB THICKNESS. FOR EXAMPLE A FOUR INCH THICK SLAB, CONTRACTION JOINTS SHALL NOT EXCEED 10 FEET ON CENTER EACH WAY. THE CONTRACTION JOINTS ARE OPTIONAL FOR ONE AND TWO STORY FAMILY RESIDENTIAL WHEN WELDED WIRE FABRIC OR FIBERMESH ARE USED IN THE FLOOR SLAB.

**STRUCTURAL ENGINEER NOTES**

**A.E.C.S.: 18040 PLAN 3020**



**DEEB FAMILY HOMES, LTD.**  
9400 RIVER CROSSING BLD.  
NEW PORT RICHEY, FL. 34655  
727-376-6831

PLAN DATE
07-17-18
09-17-18
12-11-18

**INVENTORY LOT 22**  
**365 HAMILTON AVE**  
**SAFETY HARBOR**

HEREBY CERTIFY THAT I HAVE PERFORMED THE ATTACHED DESIGN TO COMPLY WITH 145 MPH ULTIMATE WIND LOADS AND IT IS IN COMPLIANCE WITH SECT-301 OF THE 2017 FLORIDA RESIDENTIAL BUILDING CODE SEALED FOR STRUCTURE ONLY  
SIGNED: RICHARD E. ALLEN, P.E. #54628

**ALLEN ENGINEERING & CONSTRUCTION SERVICES**  
RICH ALLEN PROFESSIONAL ENGINEER  
P.E. # 59920 C.A. # 9542  
8809 SKYMASTER DR.  
NEW PORT RICHEY, FL. 34654  
727-362-6100  
richallenpe@gmail.com

THIS PERMIT IS ISSUED FOR CODE ENFORCEMENT AND REVIEWED BY THE CITY ENGINEER IN ACCORDANCE WITH CITY SAFETY HARBOR BUILDING CODE WITH EXCEPTIONS NOTED  
DEC 21 2018

21. FLOORS

A. MANUFACTURED FLOOR TRUSS FRAMING PLAN CONTAINED HEREIN IS FOR THE SOLE PURPOSE OF ILLUSTRATING THE DESIGN INTENT AND FOR PLANNING TO BE USED BY THE TRUSS COMPANY.

I. FLOOR JOISTS ARE SIZED BASED ON THE SOUTHERN PINE COUNCIL SPAN TABLES FOR NO. 2 GRADE DIMENSIONAL LUMBER.

II. FLOOR JOISTS FOR EXTERIOR DECKS SHALL BE PRESSURE TREATED.

B. FOR ALL WOOD FLOORS:

I. THE TRUSS TO WALL CONNECTIONS ARE IDENTIFIED ON THE FLOOR FRAMING PLAN.

II. A STRUCTURAL BAND JOIST IS TO BE PROVIDED ON THE EXTERIOR PERIMETER OF ALL BOTTOM BEARING FLOOR TRUSSES AND JOISTS. THE STRUCTURAL BAND JOIST IS TO BE FASTENED TO EACH END OF A FLOOR TRUSS OR JOIST WITH A SIMPSON L50 BRACKET USING SIMPSON SHORT 10d COMMON NAILS.

III. FLOOR TRUSSES OR JOISTS BEARING ON WOOD WALLS ARE TO BE SET WITH A MINIMUM OF THREE 10d COMMON NAILS (TOE NAILED) TO THE TOP PLATE OF THE WALL.

IV. A MOISTURE BARRIER SHALL BE INSTALLED BETWEEN ANY UNTREATED WOOD TRUSSES OR JOISTS AND CONCRETE OR ANY MASONRY.

V. LEDGERS/ NAILERS SHALL BE FASTENED TO WOOD STUDS OR BAND JOISTS (NOT SHEATHING) WITH A MINIMUM 2 3/8" X 5 1/2" LAG BOLTS WITH WASHERS AT EACH STUD INTERSECTION AT 16 INCHES ON CENTER AND SHALL CONSIST OF PRESSURE TREATED LUMBER 2 PLY 1 1/2" THICK BY A HEIGHT SHOWN IN THE PLANS. FOR CONCRETE OR MASONRY WALLS THE FASTENERS SHALL BE 5/8" X 5 1/2" SIMPSON TITEN HEAD CONCRETE BOLTS.

VI. FLOOR BEAMS

I. BEAMS SUPPORTING FLOOR TRUSSES AND JOISTS ARE TO BE ATTACHED AS SPECIFIED IN THE FLOOR FRAMING PLAN.

2. UNDER NO CIRCUMSTANCES ARE THERE TO BE BUTT JOINTS BETWEEN THE BEARING POINTS OF ANY PLY OF A MULTIPLE BEAM. THE PLIES ARE TO BE CONTINUOUS BETWEEN BEARING POINTS.

3. MULTIPLE BEAMS CONSISTING OF MANUFACTURED WOOD (I.E. GLULAM, MICROLAM) ARE TO HAVE THE INDIVIDUAL PLIES INTERCONNECTED AS REQUIRED BY THE MANUFACTURERS SPECIFICATIONS.

4. MULTIPLE BEAMS CONSISTING OF DIMENSIONAL LUMBER ARE TO HAVE INDIVIDUAL PLIES INTERCONNECTED AS FOLLOWS:

A. FOR TWO PLY BEAMS- ONE ROW OF 10d GALVANIZED COMMON NAILS AT 6" O.C. ON EACH SIDE OF THE BEAM

B. FOR THREE PLY BEAMS- TWO ROWS OF 16d GALVANIZED COMMON NAILS SPACED AT 6" O.C. (TOP AND BOTTOM) THRU EACH SIDE OF BEAM.

C. FOR FOUR PLY BEAMS OR LARGER- TWO ROWS OF 1/2" DIAMETER CARRIAGE BOLTS OR ALL THREAD ROD WITH NUTS AND WASHERS SPACED AT 12 INCHES ON CENTER, 2 INCHES FROM THE TOP AND BOTTOM EDGES OF THE BEAM.

D. FLOOR SHEATHING:

I. ALL FLOOR SHEATHING IS TO BE 3/4" TONGUE AND GROOVE PLYWOOD RATED FOR FLOOR SHEATHING APPLICATION.

II. FLOOR SHEATHING SHALL BE FASTENED TO THE FLOOR TRUSSES /JOISTS WITH 10d RING SHANK NAILS AT 6" ON CENTER WITH CONSTRUCTION GRADE ADHESIVE.

III. FLOOR SHEATHING SPECIFIED FOR SEALED EXTERIOR DECKS AND ITS INSTALLATION SHALL BE THE SAME AS THAT FOR INTERIOR APPLICATION EXCEPT PRESSURE TREATED AND THE FASTENERS TO BE GALVANIZED.

E. EXTERIOR DECK FLOORING:

I. DECK FLOORING SHALL BE INDIVIDUALLY SPECIFIED ON THE FLOOR FRAMING PLANS AND SHALL BE FASTENED TO THE UNDERLYING PRESSURE TREATED JOISTS WITH 3- 3 INCH DECK SCREWS AS EACH FLOORING JOIST INTERSECTION.

22. WALLS:

A. MASONRY

I. CONCRETE MASONRY UNITS (CMU) SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 1900 PSI.

II. WALL CMU SHALL BE 8 INCH X 16 INCH IN SIZE OR 8 INCH X 8 INCH X 8 INCH FOR EDGE FINISHES.

III. CMU SHALL BE PLACED IN A RUNNING BOND AND THERE SHALL BE NO VERTICAL BUTT JOINTS EXCEPT AS SHOWN ON THE FLOOR PLAN FOR CONSTRUCTION JOINTS.

IV. REINFORCED FILLED CELLS AS SHOWN ON THE PLANS SHALL BE FILLED WITH " FINE" GRADE GROUT, HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3,000 PSI AND 8 TO 11 INCH SLUMP TO ENSURE CONSOLIDATION.

V. BOND BEAMS SHALL BE POURED WITH GROUT MONOLITHICALLY WITH THE FILLED WALL CELLS-NO COLD JOINTS.

VI. VERTICAL STEEL REINFORCEMENT SHALL BE CONTINUOUS BETWEEN THE MIDDLE AND BOTTOM 1/3 OF THE FOOTING HEIGHT AND END IN THE TOP COURSE OF THE BOND BEAM WITH A STANDARD 10 INCH 90 DEGREE BEND.

VII. HORIZONTAL REINFORCING STEEL SHALL BE CONTINUOUS, INCLUDING AROUND CORNERS.

VIII. REINFORCING STEEL SPLICES SHALL CONSIST OF WIRE LAPS NO LESS THAN 40 TIMES THE STEEL BAR DIAMETER (I.E. 25 INCHES FOR #5 REBAR, 15 INCHES FOR #3 REBAR, AND 52 INCHES FOR #7 REBAR)

B. WOOD FRAME WALLS:

I. WALL STUD SIZES ARE SHOWN IN THE TYPICAL WALL SECTION.

II. LOAD BEARING.

1. WOOD STUDS IN WALLS SHALL BE SPACED 16 INCHES ON CENTER AND FASTENED TO THE TOP AND BOTTOM PLATES PER THE TOP PLATE SPlice DETAIL. ALL LOAD BEARING STUDS TO BE SOUTHERN YELLOW PINE #2 GRADE OR BETTER.

2. LOAD BEARING WALLS SHALL HAVE A SINGLE BOTTOM PLATE (PRESSURE TREATED) IN CONTACT WITH MASONRY OR CONCRETE. SEE THE TOP PLATE SPICE DETAIL FOR TOP PLATE NAILING AND SPLICING REQUIREMENTS.

3. THE WOOD STUDS SHALL HAVE A SIMPSON SP2 AT THE TOP PLATE AND A PROPERLY SIZED SPH FOR THE BOTTOM PLATE (I.E. 4" STUD WALL = SPH4, 6" STUD WALL = SPH6)

4. 3 STUD PACK SHALL BE INSTALLED DIRECTLY BENEATH BEARING POINTS OF ALL GIRDERS AND BEAMS HAVING A GRAVITY LOAD OF UP TO 3,000 LBS.

5. STEEL TUBE COLUMNS SHALL BE INSTALLED IN THE WALL DIRECTLY BENEATH GIRDERS AND BEAMS HAVING GRAVITY LOADS GREATER THAN 3000 LBS.

6. BASE PLATES SHALL BE FASTENED TO MONOLITHIC FOOTINGS WITH 5/8" X 8 INCH ANCHOR BOLTS OR SIMPSON TITEN HD. CONCRETE BOLTS OF THE SAME SIZE AT 24 INCHES ON CENTER. ALL CONNECTIONS SHALL BE MADE WITH 3 INCH SQUARE BY 1/8 INCH THICK WASHERS

7. BASE PLATES BEARING ON WOOD SHALL BE FASTENED WITH 16d COMMON NAILS AT 8" O.C. THROUGH ANY FLOOR SHEATHING AND TO UNDERLYING LUMBER (NOT SHEATHING ONLY) AND USE BLOCKING AS NEEDED TO MAINTAIN NAILING SPACING REQUIREMENTS.

8. FOR EXTERIOR LOAD BEARING WALLS, EACH STUD ABOVE THE BASE PLATE SHALL BE FASTENED TO THE UNDERLYING BAND JOIST OR BEAM WITH A SIMPSON LSTA18 STRAP. FOR THIS SITUATION THE SIMPSON SPH BRACKET TO THE BASE PLAN MAY BE OMITTED.

9. FOR INTERIOR LOAD BEARING WALLS, 1/2 INCH ALL THREAD ROD SHALL BE INSTALLED AT 32" O.C. FROM THE BASE PLATE THROUGH THE SHEATHING AND TOP PLATE OF UNDERLYING SUPPORTING WALL. ALL CONNECTIONS SHALL INCLUDE A STANDARD 3 INCH SQUARE WASHER.

10. HEADER BEAMS SHALL BE SIZED ACCORDING TO THE ENCLOSED HEADER SCHEDULE AND FASTENED WITH A MINIMUM OF TWO SIMPSON LSTA36 STRAPS OVER EACH END TO THE JACK STUDS BELOW. IN ADDITION, THE HEADER BEAMS SHALL BE FASTENED WITH A MINIMUM OF 3-10d COMMON NAILS ( TOE NAILED ON EACH FACE SIDE AT EACH END TO THE ABUTTING FULL LENGTH STUDS.

III. NON LOAD BEARING WALLS:

I. WOOD STUDS IN WALLS SHALL BE SPACED AT 16 INCHES ON CENTER AND FASTENED TO THE TOP AND BOTTOM PLATES WITH A MINIMUM OF THREE 10d COMMON NAILS. NAILS INSTALLED IN PRESSURE TREATED WOOD SHALL BE GALVANIZED.

2. INCIDENTAL, NON STRUCTURAL FRAMING ITEMS SUCH AS KNEE WALLS, DROP CEILINGS, BUILT IN SHELVING, NICHEs, ETC. MAY BE CONSTRUCTED WITH 2 X 4'S AT 24" O.C. AT THE DISCRETION OF THE BUILDER.

2. NON LOAD BEARING WALLS SHALL HAVE A SINGLE BOTTOM PLATE (PRESSURE TREATED AGAINST MASONRY AND CONCRETE) AND A SINGLE TOP PLATE.

3. BASE PLATES SHALL BE FASTENED TO CONCRETE SLABS WITH 1/4 INCH BY 3 1/2 INCH TAPCON SCREWS AT 12" ON CENTER.

4. BASE PLATES ON WOOD SHALL BE FASTENED WITH 16d COMMON NAILS AT 8" ON CENTER.

C. SHEATHING

I. PLYWOOD SHEATHING.

1. EXTERIOR WALL SHEATHING COVERED BY AN ARCHITECTURAL FINISH SHALL BE MINIMUM 7/16 INCH THICK (NOMINAL) 4 PLY PLYWOOD MANUFACTURED WITH EXTERIOR GLUE.

2. THE LONG SIDE OF THE SHEATHING SHALL BE INSTALLED PERPENDICULAR TO THE WALL STUDS.

3. FASTEN TO STUDS AND BLOCKING WITH 8d RING SHANK NAILS AT 4 INCHES ON CENTER ALL LOCATIONS.

4. IN ADDITION TO THE REGULAR FASTENING, A SECOND ROW SHALL BE INSTALLED AT THE DOUBLE TOP PLATE AND TO THE LOWEST HORIZONTAL WOOD MEMBER ON AN EXTERIOR WALL. (I.E. SILL PLATE, BAND JOIST)

5. FOR PLYWOOD SHEATHING COVERED WITH A CEMENTITIOUS FINISH ALL BUTT JOINTS NOT ON WALL STUDS SHALL BE EXAMINED AND REVIEWED FOR CORRECTION IN ACCORDANCE WITH CITY OF SAFETY HARBOR BUILDING CODE WITH EXCEPTIONS NOTED

II. PARTICLE BOARD

1. PARTICLE BOARD IS NOT TO BE USED WITHOUT THE EXPRESS WRITTEN CONSENT OF THE STRUCTURAL ENGINEER AND THE PROPERTY OWNER.

III. ARCHITECTURAL FINISHES

1. ARCHITECTURAL WALL FINISHES, SUCH AS STUCCO, CEMENTITIOUS COATING, SIDING OR PAINT ARE MENTIONED ONLY FOR THE PURPOSE OF UNDERSTANDING THAT THEIR INSTALLATION AND ASSOCIATED DETAILS ARE NOT THE RESPONSIBILITY OF THE STRUCTURAL ENGINEER.

23. COLUMNS

A. CONCRETE / MASONRY COLUMNS

1. MASONRY COLUMNS SHALL BE CONSTRUCTED OF PILASTER CONCRETE BLOCK OR FORMED AND POURED. WALL BLOCK SHALL NOT BE USED FOR MASONRY COLUMNS.

II. REINFORCING STEEL SHALL BE GRADE 60 AND HELD IN PLACE BY STIRUPS SPACED AT 12 INCHES ON CENTER VERTICALLY.

III. PILASTER BLOCK COLUMNS SHALL BE FILLED WITH A FINE GROUT HAVING A MINIMUM OF COMPRESSIVE STRENGTH OF 3,000 PSI

IV. FORMED AND POURED COLUMNS SHALL CONSIST OF A MINIMUM OF 3,000 PSI CONCRETE, OR IN AREAS OF HIGH CHLORIDES, SUCH AS NEAR THE COAST OR BODIES OF SALT WATER, THE MINIMUM SHALL BE 5,000 PSI

V. ALL MASONRY COLUMNS SHALL BEGIN AT THE FOUNDATION OR AT A MONOLITHIC FOOTING. IN NO CASE SHALL THERE BE A BREAK OR A COLD JOINT IN THE GROUT OF A COLUMN EXCEPT AT 1 FOOT FROM THE TOP IN PREPARATION FOR INSTALLATION OF A CONCRETE LINTEL.

VI. METAL CONNECTORS AT THE TOP OF THE COLUMN FOR HOLDING WOOD BEAMS OR GIRDERS SHALL BE INSTALLED WITH THE MINIMUM EMBEDMENT OF THE ASSOCIATED FASTENERS FOR THE CONNECTOR AS SHOWN ON THE PLANS.

B. WOOD COLUMNS:

I. ALL LOAD BEARING WOOD COLUMNS SHALL BE A MINIMUM OF #2 GRADE PRESSURE TREATED WOOD.

II. DIMENSIONAL WOOD COLUMNS OF 4 INCHES BY 4 INCHES IN CROSS SECTION SHALL ONLY BE USED FOR SUPPORTING OPEN WOOD DECKS WHERE THE FLOOR HEIGHT ABOVE THE FLOOR BELOW IS 8 FEET OR LESS. ALL OTHER DIMENSIONAL WOOD COLUMNS SHALL HAVE A MINIMUM OF 6 INCHES BY 6 INCHES.

III. METAL CONNECTORS AT THE BASE AND THE TOP OF WOOD COLUMNS SHALL BE OF THE TYPE THAT RESISTS LATERAL LOADS AS WELL AS UPLIFT AND GRAVITY LOADS. IN NO CASE SHALL FLAT STRAPS BE USED UNLESS SPECIFICALLY SHOWN IN THE PLANS OR CROSS SECTION DETAILS.

STRUCTURAL ENGINEER NOTES

A.E.C.S. 18040 PLAN 3020



DEEB FAMILY HOMES, LTD. 9400 RIVER CROSSING BLD. NEW PORT RICHEY, FL. 34655 727-376-6831

Table with 2 columns: PLAN DATE, values: 07-17-18, 09-17-18, 12-11-18

INVENTORY LOT 22 365 HAMILTON AVE SAFETY HARBOR

THESE CERTIFICATES HAVE BEEN PERFORMED... RICHARD E. ALLEN, P.E. #6928

ALLEN ENGINEERING & CONSTRUCTION SERVICES RICH ALLEN PROFESSIONAL ENGINEER P.E. # 6928 C.A. # 9542 8809 SKYMASTER DR. NEW PORT RICHEY, FL. 34654 727-842-6100 richallenpe@gmail.com

THIS PERMIT SHALL NOT BE USED TO PERMIT OR APPROVE THE INSTALLATION OF ANY CITY, COUNTY OR STATE LAW CODE REGULATION OR ORDINANCE

C. COMPOSITE COLUMNS

- I. A COMPOSITE COLUMN HERE IS DEFINED AS A HOLLOW COLUMN CONSISTING OF ANY MATERIAL SPECIFICALLY DESIGNED BY ITS MANUFACTURER TO BE LOAD BEARING. ANY OTHER TYPE OF HOLLOW COLUMN IS CONSIDERED AN ARCHITECTURAL FINISH INTENDED TO FIT OVER A STRUCTURAL COLUMN AND ITS USE AND DETAILS OF INSTALLATION ARE NOT THE RESPONSIBILITY OF THE STRUCTURAL ENGINEER.
- II. LOAD BEARING COMPOSITE COLUMNS ARE A MANUFACTURED PRODUCT SUBJECT TO THE DESIGN AND LOAD BEARING CAPACITY AS DETERMINED BY THE MANUFACTURER. A SHOP DRAWING OR A LETTER FOR THE INSTALLATION OF THE COLUMN SHALL BE PROVIDED BY THE STRUCTURAL ENGINEER TO SUPPLEMENT THE CONSTRUCTION PLANS AFTER THE SPECIFIC COLUMN AND MANUFACTURER HAVE BEEN IDENTIFIED.
- III. IN ALL CASES, THE COLUMN MANUFACTURER'S INFORMATION SHALL BE PROVIDED TO THE STRUCTURAL ENGINEER BY THE CONTRACTING CLIENT OR HIS AGENT FOR REVIEW PRIOR TO ITS ACCEPTANCE FOR THE STRUCTURAL DESIGN. THE INFORMATION SHALL INCLUDE THE LATERAL AS WELL AS UPLIFT AND GRAVITY LOAD BEARING CAPACITIES.
- D. STEEL TUBE COLUMNS:
  - I. LOAD BEARING STEEL TUBE COLUMNS SHALL HAVE A MINIMUM WALL THICKNESS OF 1/4 INCH AND BE MADE OF STEEL WITH A DESIGN YIELD STRENGTH OF 46 PSI UNLESS OTHERWISE SHOWN IN THE STRUCTURAL DESIGN
  - II. THE SPECIFIC CONNECTION SCHEME SHALL BE SHOWN IN THE STRUCTURAL DESIGN WHERE THE STEEL TUBE COLUMN IS TO BE INSTALLED.

B. ALUMINUM COLUMNS:

- I. LOAD BEARING ALUMINUM COLUMNS SHALL HAVE A MINIMUM WALL THICKNESS OF 1/4 INCH.
- II. ALL FASTENERS AND CONNECTORS FOR ALUMINUM COLUMNS SHALL BE STAINLESS STEEL OR MONEL TO AVOID CORROSION DUE TO DISSIMILAR METALS BEING IN CONTACT.
- III. THE SPECIFIC CONNECTION SCHEME SHALL BE SHOWN IN THE STRUCTURAL DESIGN WHERE THE ALUMINUM COLUMN IS TO BE INSTALLED.

24. ROOF

A. MANUFACTURED WOOD TRUSSES

- I. THE MANUFACTURED ROOF TRUSS FRAMING PLAN CONTAINED HEREIN IS FOR THE SOLE PURPOSE OF ILLUSTRATING THE DESIGN INTENT AND FOR PLANNING TO BE USED BY THE TRUSS COMPONENT AND TRUSS SYSTEM ENGINEER OF THE TRUSS MANUFACTURER IN DEVELOPING THE ACTUAL SYSTEM DESIGN. IT IS NOT INTENDED TO BE USED FOR ANY OTHER PURPOSE AS IT IS SUBJECT TO ENGINEERING AND MAY BE DIFFERENT FROM THE FINAL DESIGN.
- II. MANUFACTURED ROOF TRUSSES SHALL BE DESIGNED BY A LICENSED TRUSS COMPONENT AND TRUSS SYSTEM ENGINEER ACTING AS A DELEGATED ENGINEER AND WORKING THROUGH A TRUSS MANUFACTURER FOR THIS PURPOSE. THE SELECTION OF THE TRUSS MANUFACTURER IS HEREBY SUBORDINATED TO THE BUILDING CONTRACTOR.
- III. THE TRUSS PLAN "SIGNED AND SEALED" BY THE DELEGATED ENGINEER SHALL BE PROVIDED TO AND PRIOR TO CONSTRUCTION OF THE UNDERLYING STRUCTURE AS THE STRUCTURAL ENGINEER RESERVES THE RIGHT TO MAKE STRUCTURAL CHANGES BASED ON THE FINAL FLOOR TRUSS SYSTEM.
- VI. THE TRUSS MANUFACTURER SHALL PROVIDE ALL LATERAL BRACING REQUIREMENTS TO THE BUILDING CONTRACTOR. IF NOT, THE BUILDING CONTRACTOR IS TO NOTIFY THE STRUCTURAL ENGINEER FOR GUIDANCE.
- V. IN ADDITION TO THE METAL CONNECTORS SHOWN IN THE TRUSS LAYOUT OF THE ORIGINAL PLANS, EACH TRUSS IS TO BE SET ON WOOD FRAME BEARING WALLS OR SILL PLATES WITH 10d COMMON NAILS (TOE-NAILED)
- VI. A MOISTURE BARRIER IS TO BE INSTALLED BETWEEN UNTREATED WOOD AND CONCRETE / MASONRY

23.2 CONVENTIONAL FRAME

- I. IN ADDITION TO THE METAL CONNECTORS SHOWN IN THE TRUSS LAYOUT OF THE ORIGINAL PLANS, EACH RAFTER IS TO BE SET ON WOOD FRAME BEARING WALLS OR SILL PLATES WITH 3- 10d COMMON NAILS (TOE-NAILED)
- II. ANY WOOD COMING IN CONTACT WITH MASONRY OR CONCRETE IS TO BE PRESSURE TREATED OR A MOISTURE BARRIER IS TO BE INSTALLED BETWEEN UNTREATED WOOD AND CONCRETE OR MASONRY.

- III. COLLAR TIES ARE TO BE INSTALLED BETWEEN RAFTERS AT 2/3 OF THE RIDGE HEIGHT FROM WHERE THE RAFTERS BEAR ON WALLS. THE COLLAR TIES ARE TO BE FASTENED WITH A MINIMUM OF 4-10d 16 COMMON NAILS (CLINCHED) AT EACH LAP JOINT. EACH RAFTER IS TO BE ATTACHED TO THE RIDGE BEAM WITH A LIGHT ANGLE HANGER AS SHOWN IN THE FRAMING PLAN. IN ADDITION, A FLAT METAL STRAP SHALL BE INSTALLED ACROSS THE RIDGE BEAM TO TWO OPPOSING RAFTERS. TO BE REVIEWED BY THE STRUCTURAL ENGINEER FOR COMPLYING WITH THE DESIGN INTENT OF THE ORIGINAL PLAN AND FOR ANY CHANGES TO THE "TRUSS TO THE UNDERLYING STRUCTURE" CONNECTIONS.

- IV. AS PART OF THE REVIEW, THE STRUCTURAL ENGINEER WILL DETERMINE WHETHER THE TRUSS TO WALL / BEAM METAL CONNECTORS SHOWN IN THE ORIGINAL PLANS ARE ACCEPTABLE OR WHETHER THEY NEED TO BE CHANGED OR SUPPLEMENTED TO ACCOMMODATE THE LOADS SHOWN IN THE TRUSS COMPONENT SHEETS.

- V. THE STRUCTURAL ENGINEER IS NOT RESPONSIBLE FOR VERIFYING THE DIMENSIONAL, ARCHITECTURAL, OR FORM ASPECTS OF THE OF THE TRUSS MANUFACTURERS PLAN WITH THE ORIGINAL PLANS.

- VI. THE MINIMUM LIVE LOADS FOR THE ROOF TRUSS DESIGN IS TO BE ON FBC 2017 SECTION 1607 FOR ROOF TYPE AND ROOFING MATERIAL.

- VII. THE DEAD LOADS ARE LISTED IN ITEM 16 ABOVE.

- VIII. ALL TRUSS TO TRUSS AND TRUSS TO GIRDER CONNECTORS ARE TO BE SPECIFIED BY THE TRUSS MANUFACTURER, INCLUDING CONNECTORS FOR TRUSS TO MANUFACTURED BEAM (I.E. GLUELAM, OR MICROLAM) SPECIFIED BY THE TRUSS MANUFACTURER. A SPECIFIC HANGER MUST BE SELECTED AND IDENTIFIED ON THE SIGNED AND SEALED COMPONENT SHEETS FOR EACH LOCATION, A HANGER IS REQUIRED IN THE TRUSS SYSTEM.

- IX. THE TRUSS PLAN SIGNED AND SEALED BY THE DELEGATED ENGINEER SHALL BE PROVIDED TO AND REVIEWED BY THE STRUCTURAL ENGINEER FOR COMPLYING WITH THE DESIGN INTENT OF THE ORIGINAL PLAN AND FOR ANY CHANGES TO THE "TRUSS TO UNDERLYING STRUCTURE" CONNECTIONS. THIS PLAN MUST BE PROVIDED TO THE STRUCTURAL ENGINEER.

- X. A RIDGE BEAM TERMINATING AT A GABLE END SHALL BE SUPPORTED BY A MINIMUM 3 STUD PACK COLUMN BEARING ON THE UNDERLYING WALL OR BEAM.

- XI. TREATED LUMBER-DOUBLE 1 1/2 INCH BY A HEIGHT SHOWN ON THE PLANS. FOR CONCRETE OR MASONRY WALLS THE FASTENERS SHALL BE 5/8 INCH BY 5 1/2 INCH SIMPSON TITEN HD CONCRETE BOLTS.

- XII. SLEEPERS SHALL BE FASTENED TO UNDERLYING ROOF TRUSSES OR RAFTERS (NOT SHEATHING) WITH A MINIMUM OF 2-3/8 INCH BY 3 1/2 INCH LAG BOLTS AND WASHERS AT EACH TRUSS OR RAFTER INTERSECTION AND NO GREATER THAN 24 INCHES ON CENTER AND SHALL CONSIST OF DIMENSIONAL LUMBER 1 1/2 INCH THICK BY A WIDTH SHOWN IN THE PLANS.

- XIII. USE 2 INCH BY 4 INCH BLOCKING ATTACHED BETWEEN UNDERLYING STUDS, TRUSSES OR RAFTERS WITH A MINIMUM OF 3-10d NAILS AT EACH IN ORDER TO SATISFY THE ON CENTER SPACING FOR THE LEDGERS OR SLEEPERS.

- XIV. BEAMS SUPPORTING ROOF TRUSSES OR RAFTERS ARE TO BE ATTACHED AS SPECIFIED IN THE ROOF FRAMING PLANS.

24. UNDER NO CIRCUMSTANCES ARE THERE TO BE BUTT JOINTS BETWEEN THE BEARING POINTS OF ANY PLY OF A MULTIPLE BEAM. THE PLIES ARE TO BE CONTINUOUS BETWEEN BEARING POINTS.

- A. LEDGERS/ SLEEPERS
  - I. LEDGERS / NAILERS SHALL BE FASTENED TO WOOD STUDS (NOT SHEATHING) WITH A MINIMUM OF 2- 3/8 INCH BY 5 1/2 INCH LAG BOLTS WITH WASHERS AT EACH STUD INTERSECTION AND NO GREATER THAN 16 INCHES ON CENTER AND SHALL CONSIST ON PRESSURE TREATED WOOD.

- II. MULTIPLE BEAMS CONSISTING OF MANUFACTURED WOOD (I.E. GLUELAM, MICROLAM) ARE TO HAVE THE INDIVIDUAL PLIES INTERCONNECTED AS REQUIRED BY THE MANUFACTURERS SPECIFICATIONS.

- III. MULTIPLE BEAMS CONSISTING OF DIMENSIONAL LUMBER ARE TO HAVE THE INDIVIDUAL PLIES INTERCONNECTED AS FOLLOWS:
  - I. FOR TWO PLY BEAMS - ONE ROW OF 10d GALVANIZED COMMON NAILS AT 6 INCHES ON CENTER ON EACH SIDE OF BEAM.
  - II. FOR THREE PLY BEAMS- TWO ROWS OF 16d GALVANIZED COMMON NAILS AT 6" ON CENTER (TOP AND BOTTOM) THRU EACH SIDE OF THE BEAM.
  - III. FOR FOUR PLY BEAMS AND LARGER- TWO ROWS OF 1/2 INCH DIAMETER CARRIAGE BOLTS OR ALL THREAD RODS WITH NUTS AND WASHERS SPACED AT 12" ON CENTER 2 INCHES FROM THE TOP AND BOTTOM EDGES OF THE BEAM.

- B. SHEATHING :
  - I. ROOF SHEATHING COVERED BY COMPOSITE ROOFING SHALL BE A MINIMUM OF 15/32 INCH THICK (NOMINAL ) O.S.B. MANUFACTURED WITH EXTERIOR GLUE.
  - II. ROOF SHEATHING COVERED BY TILE SHALL BE A MINIMUM OF 5/8 INCH THICK (NOMINAL ) MANUFACTURED WITH EXTERIOR GLUE.
  - III. THE LONG SIDE OF THE SHEATHING SHALL BE INSTALLED PERPENDICULAR TO THE ROOF TRUSS SYSTEM.
  - IV. FASTENING SHALL BE 8d RING SHANK NAILS AT 4 INCHES ON CENTER AT BOUNDARY AND EDGES AND 6 INCHES ON CENTER IN THE FIELD WITH A SETBACK OF 5'-0" FROM ALL EDGES.
  - V. METAL "H" CLIPS OR SOLID WOOD BLOCKING SHALL BE USED AT ALL UNSUPPORTED BUTT JOINTS BETWEEN TRUSSES OR RAFTERS.

25. PRECAST CONCRETE LINTELS
  - A. PRECAST AND PRESTRESSED CONCRETE LINTELS SHALL BE MANUFACTURED BY CASTCRETE AND INSTALLED PER MANUFACTURERS SPECIFICATIONS AND INSTRUCTIONS.
  - B. THE SIZE OF THE LINTELS SHALL BE BASED ON THE SPAN AND LOAD. REFER TO THE ATTACHED SCHEDULE UNLESS OTHERWISE SHOWN IN THE STRUCTURAL DESIGN FOR THE SPECIFIED LINTEL

- C. LINTEL SCHEDULE U.N.O. ON PLANS:
  - I. SPAN UP TO 3'- 8F8-0B
  - II. SPAN UP TO 3' TO < 6' - 8F8-0B
  - III. SPAN 6' TO > 14' - 8F16- 1B/1T

- D. THE MINIMUM SPECIFIED GROUT COMPRESSIVE STRENGTH FOR LINTELS IS 3,000 PSI.

- E. THE REINFORCING STEEL SHALL BE ASTM GRADE 60

26. FASTENERS / METAL CONNECTORS.
  - A. ALL FASTENERS AND METAL CONNECTORS SHALL BE MANUFACTURED BY SIMPSON STRONG TIE AND INSTALLED PER THE MANUFACTURERS SPECIFICATIONS AND INSTRUCTIONS.
  - B. THESE FASTENERS DO NOT INCLUDE TYPICAL NAILS AND SCREWS WHICH MAY BE MANUFACTURED BY OTHERS.
  - C. FOLLOW ALL MANUFACTURERS SPECIFICATIONS AND INSTRUCTIONS FOR ALL FASTENERS, METAL CONNECTIONS, SCREWS, NAILS, ETC. THAT ARE IN CONTACT WITH PRESSURE TREATED LUMBER.

27. DIMENSIONAL LUMBER :
  - A. ALL LOAD BEARING WALLS SHALL BE SOUTHERN YELLOW PINE #2 OR BETTER GRADED AND STAMPED BY THE CERTIFYING AGENCY . IN ADDITION, ALL WOOD SHALL BE PRESSURE TREATED FOR EXTERIOR USE WHERE EXPOSED TO MOISTURE, PLACED WITHIN 12 INCHES OF SOIL OR IN CONTACT WITH CONCRETE OR MASONRY.

28. STRUCTURAL SHEATHING:
  - A. ALL SHEATHING USED FOR EXTERIOR APPLICATIONS SHALL BE EXTERIOR GRADE AND ADA STAMPED AND VERIFYING ITS RATING.

29. MASONRY:
  - A. CONCRETE MASONRY UNITS SHALL CONFORM WITH AMERICAN MASONRY INSTITUTE STANDARD 530
  - B. CONCRETE MASONRY UNITS SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 1900 PSI
  - C. MORTAR SHALL BE OF TYPE M OR S GRAY MORTAR.

30. GROUT:
  - A. ALL GROUT SHALL BE A FINE TYPE HAVING A MINIMUM COMPRESSIVE STRENGTH OF 3,000 PSI UNLESS SPECIFICALLY SHOWN OTHERWISE BY A MANUFACTURER PURSUANT TO GROUT USE WITH ITS PRODUCTS.

31. REINFORCING STEEL :
  - A. ALL REINFORCING STEEL SHALL BE ASTM GRADE 40 EXCEPT GRADE 60 SHALL BE USED FOR GRADE BEAMS, ALL LINTEL TYPES (I.E. PRECAST AND FIELD PREFORMED ) COLUMNS UNLESS OTHERWISE SHOWN IN THE STRUCTURAL PLANS.

A.E.C.S. 18040 PLAN 3020

ALLEN ENGINEERING & CONSTRUCTION SERVICES  
 RICH ALLEN PROFESSIONAL ENGINEER  
 P.E. # 56928 C.A. # 9542  
 8809 SKYMASTER DR.  
 NEW PORT RICHEY, FL. 34654  
 727-942-6100  
 richallenpe@gmail.com

HEREBY CERTIFY THAT I HAVE PERFORMED THE ATTACHED DESIGN TO COMPLY WITH THE APPLICABLE WIND LOADS AND IT IS IN COMPLIANCE WITH SECT. 301 OF THE 2017 FLORIDA RESIDENTIAL BUILDING CODE. SEALED FOR STRUCTURE ONLY.  
 RICHARD E. ALLEN P.E. #56928

INVENTORY LOT 22  
 365 HAMILTON AVE  
 SAFETY HARBOR

PLAN DATE
07-17-18
09-17-18
12-11-18

DEEB FAMILY HOMES, LTD.  
 9400 RIVER CROSSING BLD.  
 NEW PORT RICHEY, FL. 34655  
 727-576-6831



THE ISSUANCE OF THIS PERMIT SHALL NOT BE HELD TO BE A GUARANTEE OF THE ACCURACY OF ANY CITY, COUNTY OR STATE LAW CODE REGULATORY OR ORDINANCE WITH EXCEPTIONS NOTED

REVIEWED FOR COMPLIANCE WITH THE FLORIDA BUILDING CODE

DEC 21 2018

32. STRUCTURAL STEEL AND CONNECTION ACCESSORY MATERIAL:  
 A. I-BEAMS, FORMED STRUCTURAL STEEL, FLAT BAR OR PLATE SHALL BE ASTM GRADE A36 UNLESS STATED OTHERWISE.  
 B. ALL STRUCTURAL STEEL SHALL HAVE A MINIMUM OF TWO COATS OF PRIMER AND TWO COATS OF EPOXY AS A CORROSION PREVENTIVE. THE BUILDING CONTRACTOR MAY VARY FROM THIS SPECIFICATION WITH THE APPROVAL OF THE STRUCTURAL ENGINEER IF IT CAN BE DEMONSTRATED ANOTHER MEANS OF CORROSION CONTROL IS EQUALLY EFFECTIVE.  
 C. ALL WELDING OF STRUCTURAL STEEL SHALL BE MADE WITH E60/70 TYPE ELECTRODES. THE DEPTH AND LENGTH FOR THE WELD SHALL BE SPECIFIED IN THE STRUCTURAL DESIGN FOR THE SPECIFIC CONNECTION.

33. VENTILATION:  
 A. THE STRUCTURAL ENGINEER IS NOT RESPONSIBLE FOR DETERMINING VENTILATION REQUIREMENTS OF CRAWL SPACES, FLOORS AND ATTICS NOR THE MEANS AND METHODS FOR IMPLEMENTING THESE REQUIREMENTS.

34. WATERPROOFING:  
 A. ANY RENDERING OF NOTES OF WATERPROOFING MEASURES FOR BASEMENTS OR HALF BASEMENTS SHOWN IN THESE PLANS WHERE A SPECIFIC CONSTRUCTION DETAIL IS NOT SHOWN IN THE STRUCTURAL DESIGN IS AN ARCHITECTURAL ILLUSTRATION ONLY AND IS NOT PART OF THE STRUCTURAL DESIGN OR THE RESPONSIBILITY OF THE STRUCTURAL ENGINEER.  
 B. CRICKETS ARE ASSOCIATED WITH THE ARCHITECTURAL FINISHES AND ARE NOT THE RESPONSIBILITY OF THE STRUCTURAL ENGINEER.

35. FIRE RESISTANT DESIGN:  
 A. FIRE RESISTANT DESIGN OF STRUCTURAL ELEMENTS SHALL BE INCIDENTAL TO THEIR STRUCTURAL DESIGN AND SHALL BE BASED ON UNDERWRITERS LABORATORY OR GYPSUM ASSOCIATION DESIGN FOR FIRE RATED FLOOR, WALL AND ROOF ASSEMBLIES.

36. FLOOD RESISTANT DESIGN:  
 A. FLOOD RESISTANT DESIGN OF FLOOD RESISTANT DESIGN OF STRUCTURAL ELEMENTS SHALL BE INCIDENTAL TO THEIR STRUCTURAL DESIGN AND SHALL BE BASED ON THE REQUIREMENTS STATED IN TITLE 44 CFR SECTIONS 59 AND 60, AND ON THOSE OF THE INDIVIDUAL COMMUNITY RATING AGENCIES FOR THE GOVERNMENTAL JURISDICTION WHERE THE CONSTRUCTION IS TO BE DONE.  
 B. HOWEVER, THE STRUCTURAL ENGINEER IS NOT RESPONSIBLE FOR IDENTIFYING AND SHOWING ON THE PLANS THE FLOOD ZONE CATEGORY, BASE FLOOD ELEVATION, AND THE FLOOR AND STORY HEIGHTS OF THE BUILDING IN RELATION TO THE BASE FLOOD ELEVATION. THIS INFORMATION IS CONSIDERED ARCHITECTURAL AND SITE RELATED AND SHALL BE PROVIDED TO THE STRUCTURAL ENGINEER BY THE CONTRACTING CLIENT OR HIS AGENT.

37. SPECIAL CONSTRUCTION:  
 I. ALUMINUM STRUCTURAL COLUMNS:  
 A. ANY ALUMINUM STRUCTURES SHOWN IN THESE PLANS SUCH AS PORCH AND POOL ENCLOSURES OR GUARDRAILS AND HANDRAILS ARE FOR ARCHITECTURAL ILLUSTRATION ONLY AND ARE NOT PART OF THE STRUCTURAL DESIGN OR THE RESPONSIBILITY OF THE STRUCTURAL ENGINEER.  
 B. WHERE THE ALUMINUM STRUCTURE ATTACHES TO THE MAIN STRUCTURE OR IS INCORPORATED IN THE MAIN STRUCTURE, SHOP DRAWINGS FOR THESE STRUCTURES SHALL BE PROVIDED TO THE STRUCTURAL ENGINEER TO DETERMINE THEIR EFFECT ON THE MAIN STRUCTURE.  
 II. SWIMMING POOLS:  
 A. ANY SWIMMING POOL OR HOT TUBS SHOWN IN THESE PLANS ARE FOR ARCHITECTURAL ILLUSTRATION ONLY AND ARE NOT PART OF THE STRUCTURAL DESIGN OR THE RESPONSIBILITY OF THE STRUCTURAL ENGINEER.  
 III. FENCES AND RETAINING WALLS:  
 A. ANY RENDERING OF FENCES, RETAINING WALLS OR EXTERIOR PLANTERS WHERE A SPECIFIC STRUCTURAL DETAIL IS NOT SHOWN FOR THEIR CONSTRUCTION ARE FOR ARCHITECTURAL ILLUSTRATION ONLY AND ARE NOT THE RESPONSIBILITY OF THE STRUCTURAL ENGINEER.  
 IV. DRIVEWAYS AND WALKWAYS:  
 A. ANY DRIVEWAYS OR WALKWAYS SHOWN IN THESE PLANS ARE FOR ARCHITECTURAL ILLUSTRATION PURPOSES ONLY AND ARE NOT PART OF THE STRUCTURAL DESIGN OR THE RESPONSIBILITY OF THE STRUCTURAL ENGINEER.

Project:

Floor and Roof Live Loads	
Atti	20 psf w/ storage, 10 psf w/o storage
Habitable Attics, Bedroom:	30 psf
All Other Rooms:	40 psf
Garage:	40 psf
Roofs:	20 psf

Wind Design Data	
Ultimate Wind Speed:	145 mph
Nominal Wind Speed:	112 mph
Risk Category:	II
Wind Exposure:	D
Enclosure Classification:	Enclosed
Internal Pressure Coefficient:	0.18 +/-

Components and Cladding Design Pressures:	
Roofing Zone 1:	+38.0 psf max., -60.4 psf min.
Roofing Zone 2:	+38.0 psf max., -105.2 psf min.
Roofing Zone 3:	-155.6 psf min.
Roofing at Zone 2 Overhangs:	-122.8 psf min.
Roofing at Zone 3 Overhangs:	-206.6 psf min.
Stucco, Cladding, Doors & Windows:	
Zone 4:	+65.9 psf max., -71.4 psf min.
Zone 5:	+65.9 psf max., -88.2 psf min.
End Zone Width:	4.00 ft.

The Ultimate Wind Speed was used to determine the above Component and Cladding Design Pressures.

All exterior glazed openings shall be protected from wind-borne debris as per Section 1609.1.2 of the 2017 FBC.

The site of this building is not subject to special topographic wind effects as per Section 1609.1.1.1 of the 2017 FBC.

Geotechnical Information	
Design Soil Load-Bearing Capacity:	2,000 psf

Flood Design Data	
AE FLOOD ZONE	

0.6 ALLOWABLE STRESS DESIGN USED

WIND LOAD DESIGN DATA

DEEB FAMILY HOMES, LTD.  
 9400 RIVER CROSSING BLD.  
 NEW PORT RICHEY, FL. 34655  
 727-376-6831



PLAN DATE
07-17-18
09-17-18
12-11-18

INVENTORY LOT 22  
 365 HAMILTON AVE  
 SAFETY HARBOR


A.E.C.S. 18040

PLAN 3020

PLANS EXAMINED AND REVIEWED FOR COMPLIANCE WITH CITY OF SAFETY HARBOR BUILDING CODE WITH EXCEPTIONS NOTED  
 EEC 21 2018  
 THE ISSUANCE OF THIS PERMIT SHALL NOT BE HELD TO PERMIT OR APPROVE THE LAMINATION OF ANY CITY, COUNTY OR STATE CODE REGULATION OR ORDINANCE

ALLEN ENGINEERING & CONSTRUCTION SERVICES  
 RICH ALLEN PROFESSIONAL ENGINEER  
 P.E. # 56920 C.A. # 9542  
 8609 SKYMASTER DR.  
 NEW PORT RICHEY, FL. 34654  
 727-862-6100  
 richallenpe@gmail.com

Scanned Online 2/5/19 @ Done AS Revised sheets  
only 1

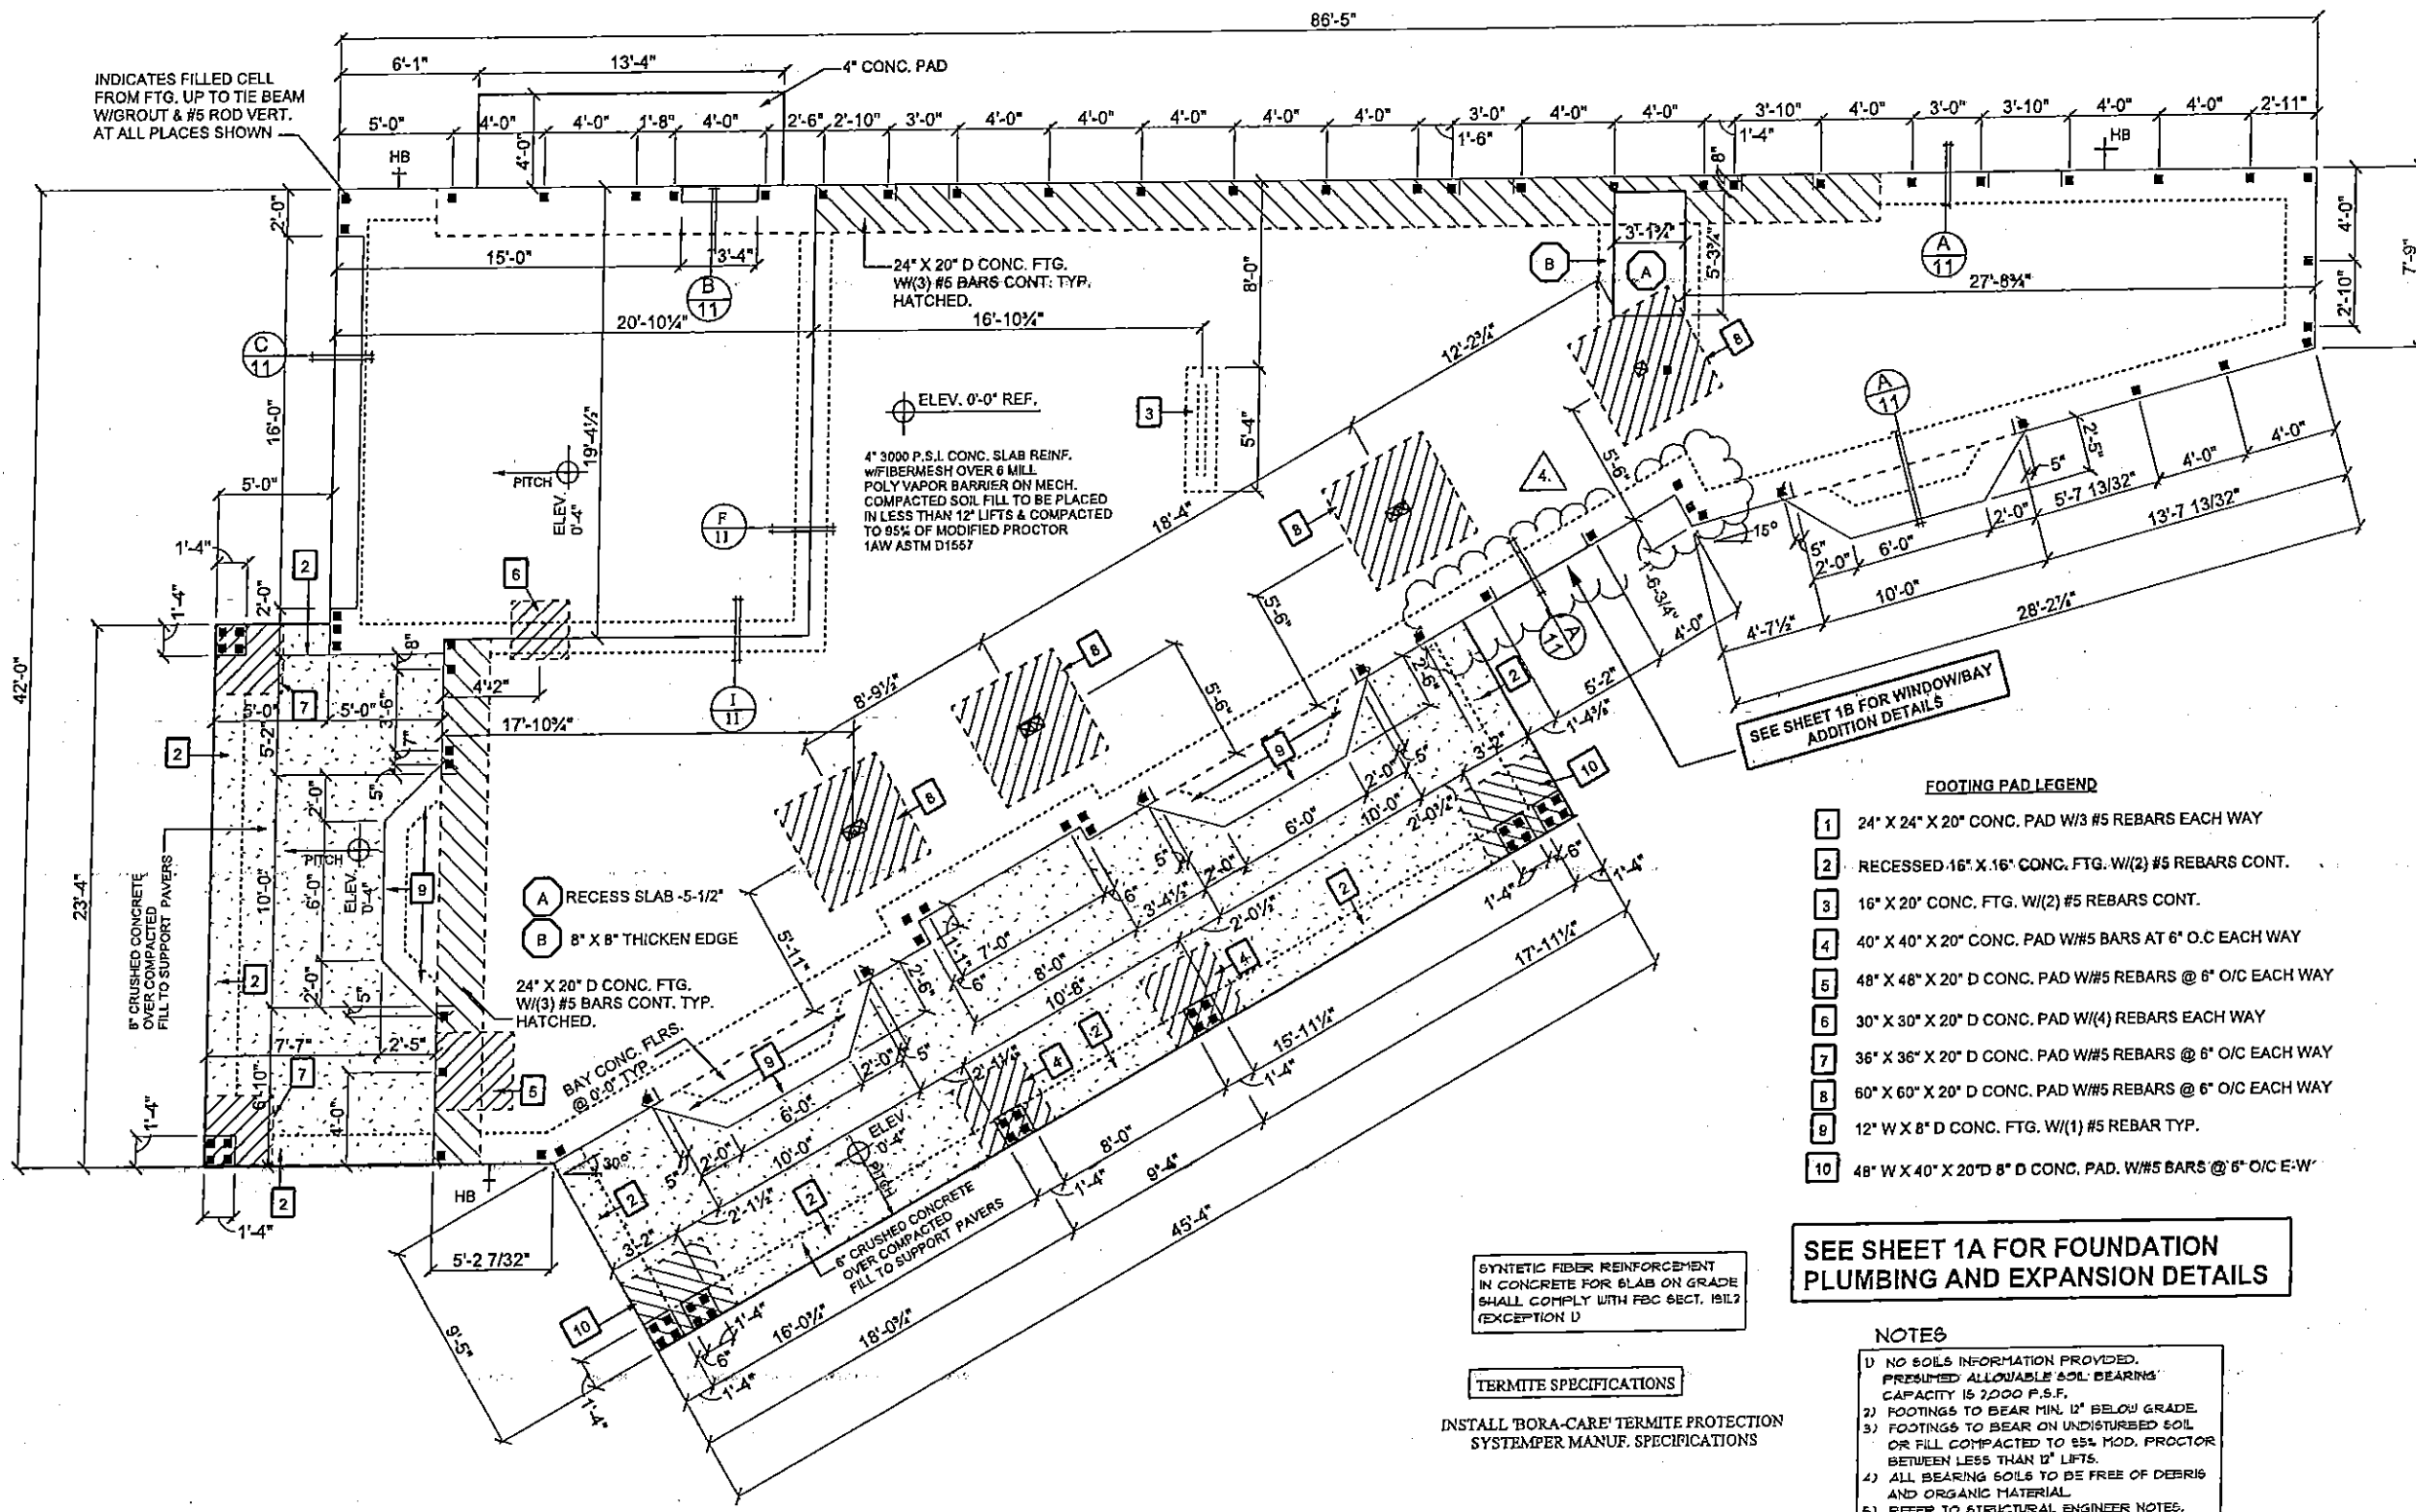

- FOOTING PAD LEGEND**
- 1 24" X 24" X 20" CONC. PAD W/3 #5 REBARS EACH WAY
  - 2 RECESSED-16" X 16" CONC. FTG. W/(2) #5 REBARS CONT.
  - 3 16" X 20" CONC. FTG. W/(2) #5 REBARS CONT.
  - 4 40" X 40" X 20" CONC. PAD W/5 BARS AT 6" O.C EACH WAY
  - 5 48" X 48" X 20" D CONC. PAD W/5 REBARS @ 6" O/C EACH WAY
  - 6 30" X 30" X 20" D CONC. PAD W/(4) REBARS EACH WAY
  - 7 36" X 36" X 20" D CONC. PAD W/5 REBARS @ 6" O/C EACH WAY
  - 8 60" X 60" X 20" D CONC. PAD W/5 REBARS @ 6" O/C EACH WAY
  - 9 12" W X 8" D CONC. FTG. W/(1) #5 REBAR TYP.
  - 10 48" W X 40" X 20" D 8" D CONC. PAD. W/5 BARS @ 6" O/C E-W

- NOTES**
- 1) NO SOILS INFORMATION PROVIDED. PRESUMED ALLOWABLE SOIL BEARING CAPACITY IS 2,000 P.S.F.
  - 2) FOOTINGS TO BEAR MIN. 12" BELOW GRADE.
  - 3) FOOTINGS TO BEAR ON UNDISTURBED SOIL OR FILL COMPACTED TO 95% MOD. PROCTOR BETWEEN LESS THAN 12" LIFTS.
  - 4) ALL BEARING SOILS TO BE FREE OF DEBRIS AND ORGANIC MATERIAL.
  - 5) REFER TO STRUCTURAL ENGINEER NOTES.

**FOUNDATION PLAN**

SCALE 1/8" = 1'-0"

A.E.C.S. #18040

PLAN 3035

**DEEB FAMILY HOMES, LTD.**  
 9400 RIVER CROSSING BLD.  
 NEW PORT RICHEY, FL. 34655

PLAN DATE

1. 12-06-2018	2. 12-11-2018	3. 12-27-2018	4. 02-01-2019
---------------	---------------	---------------	---------------

**LOT 22 HAMILTON SAFETY HARBOR**


1. PRELIMINARY PLANS  
 2. STRUCTURAL ENG. REVIEW (VERSION 8)  
 3. BAY WINDOW DETAIL UPDATES (VERSION 8)  
 4. BAY WINDOW/WINDOW ROOF ADDITION

HEREBY CERTIFY THAT I HAVE PERFORMED THE ATTACHED DESIGN TO COMPLY WITH ALL APPLICABLE LOCAL, STATE AND FEDERAL REQUIREMENTS AND IT IS MY OPINION THAT THE SAME COMPLY WITH THE 2019 FLORIDA RESIDENTIAL BUILDING CODE. SEEALED FOR THE STRUCTURE ONLY.

SIGNED: RICHARD E. ALLEN P.E. #56920  
 RICHARD E. ALLEN P.E. #56920

**ALLEN ENGINEERING & CONSTRUCTION SERVICES**  
 RICH ALLEN PROFESSIONAL ENGINEER  
 P.E. #56920 C.A. #9542  
 8809 SKYMASTER DRIVE  
 NEW PORT RICHEY, FL. 34654  
 727-842-6100  
 richallenpe@gmail.com

1

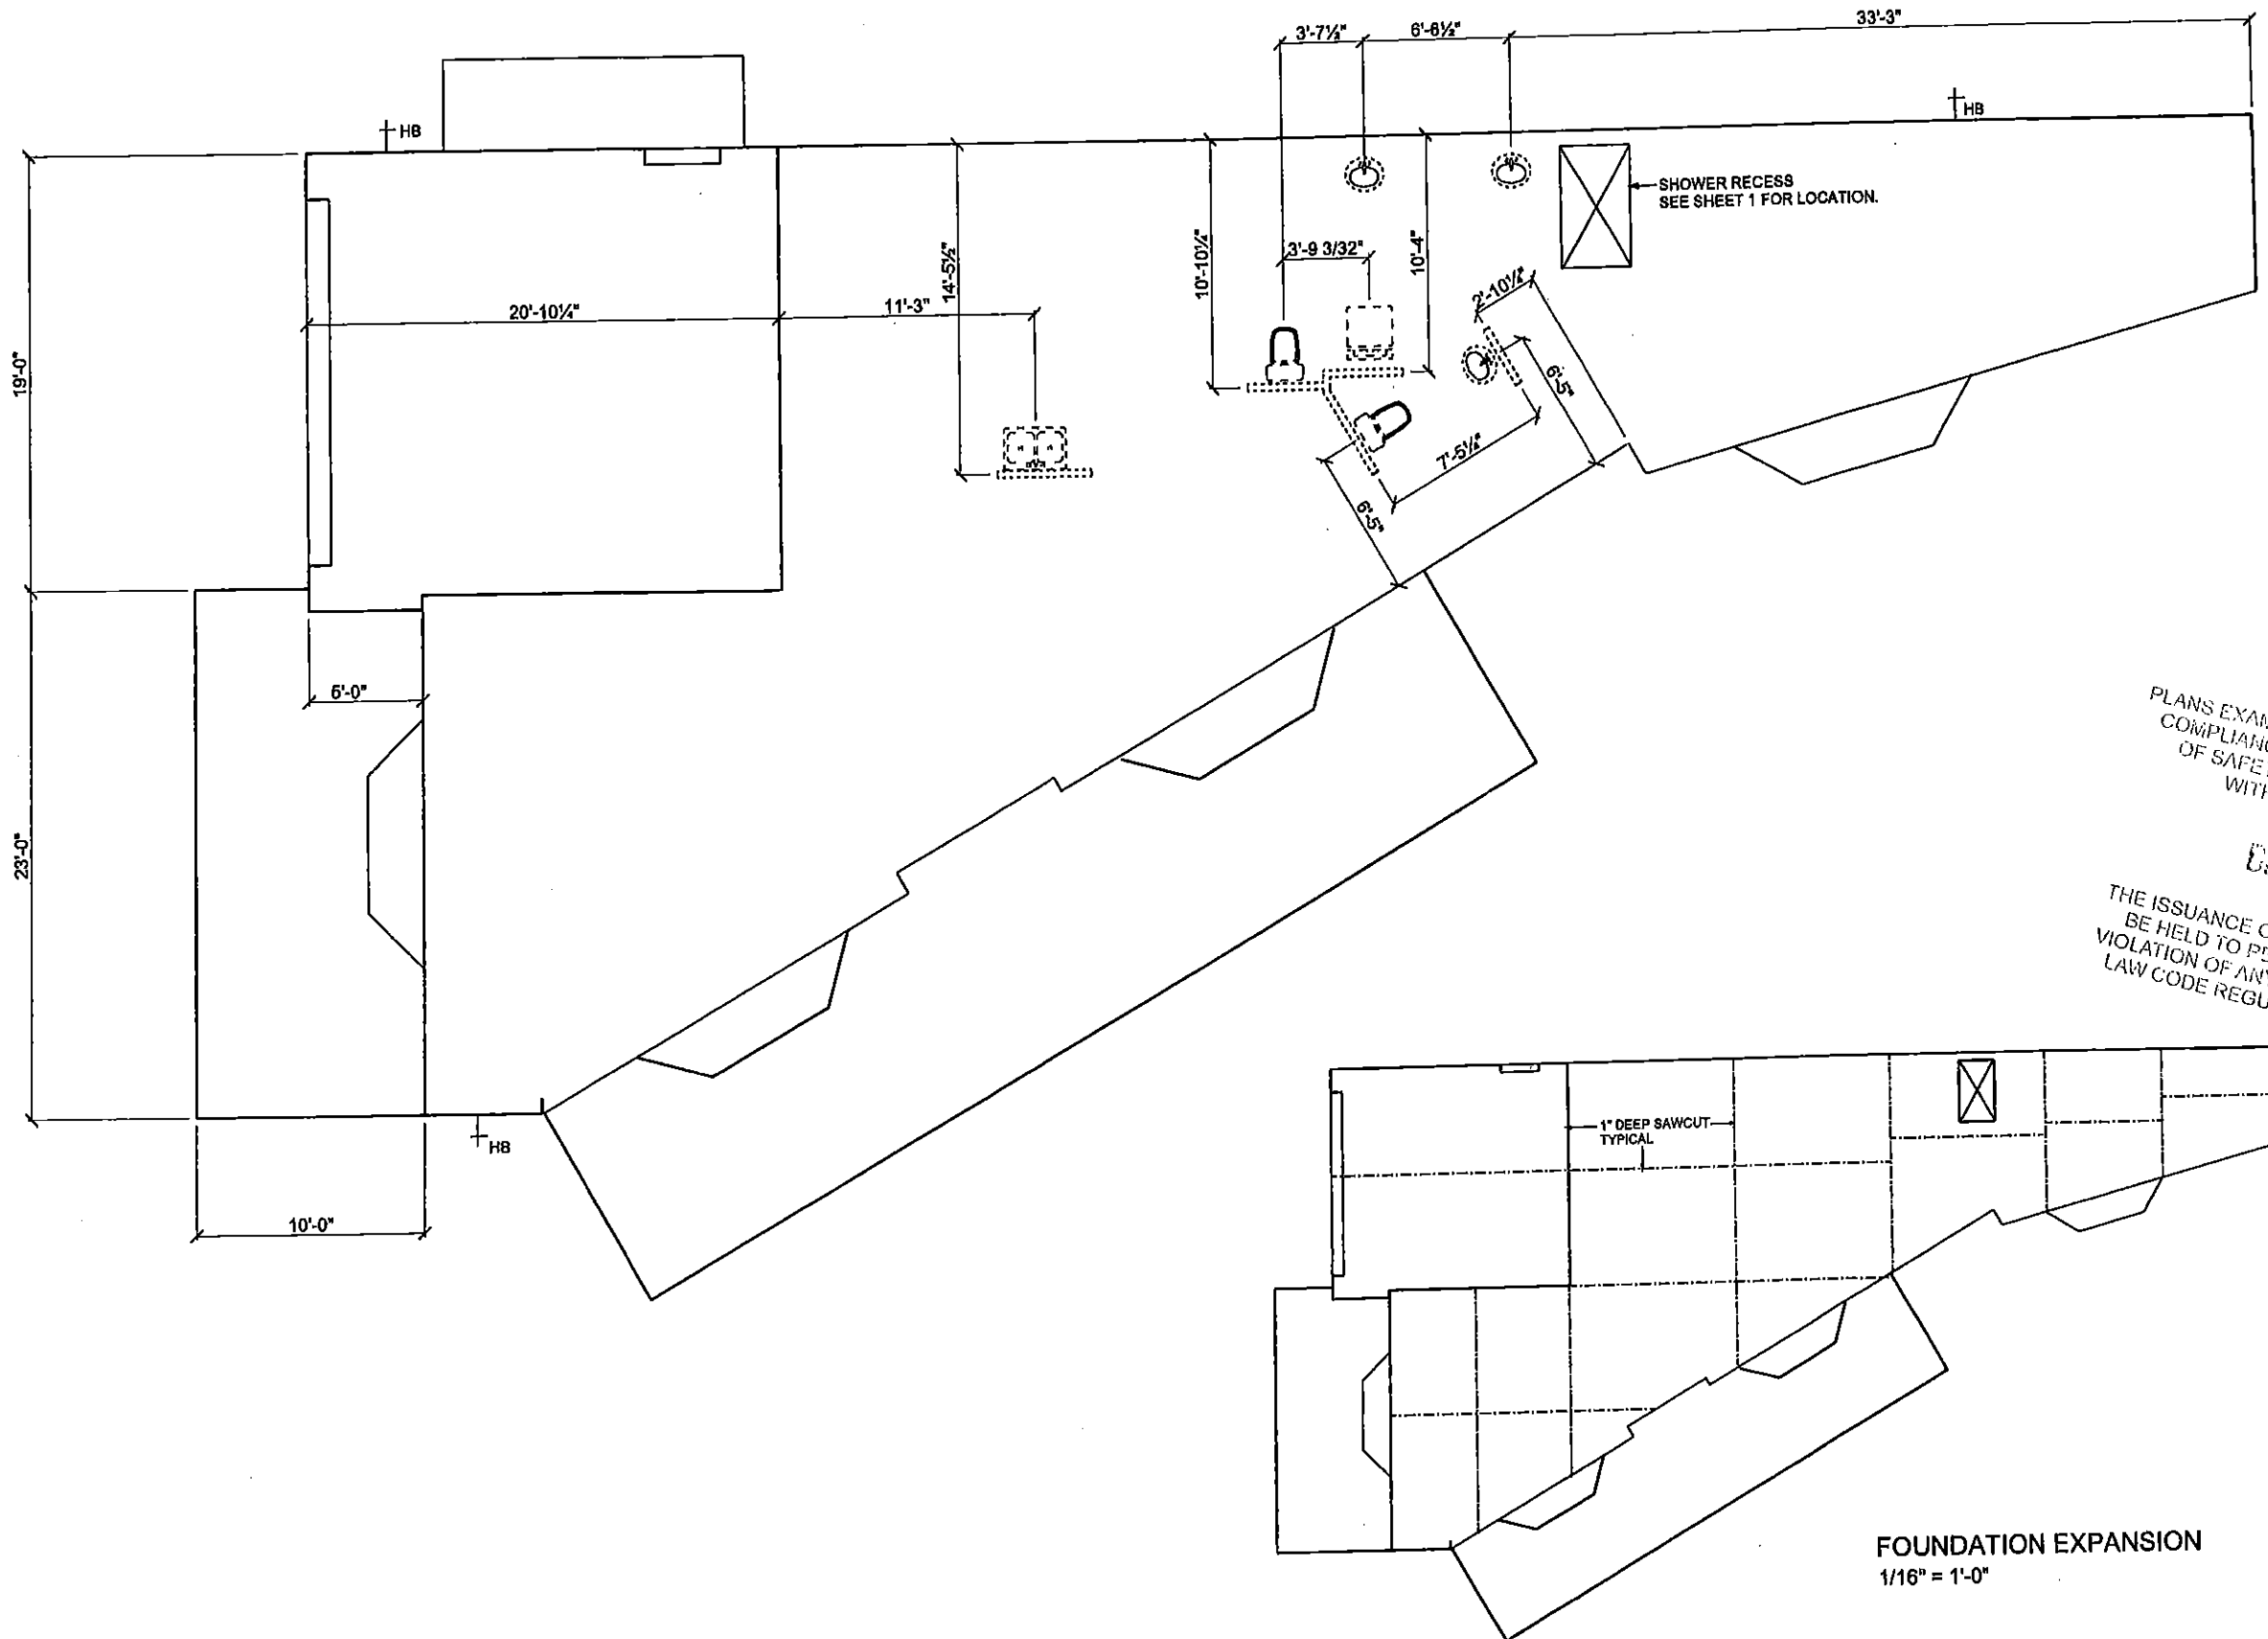

PLAN 3020

SCALE 1/8" = 1'-0"

PLANS EXAMINED AND REVIEWED FOR COMPLIANCE IN ACCORDANCE WITH THE BUILDING CODE OF SAFETY HARBOR BUILDING WITH EXCEPTIONS NOTED  
 DEC 21 2018  
 THE ISSUANCE OF THIS PERMIT SHALL BE HELD TO PERMIT OR APPROVE THE VIOLATION OF ANY CITY, COUNTY OR STATE LAW CODE REGULATION OR ORDINANCE.

FOUNDATION PLUMBING LAYOUT


LOT 22 HAMILTON AVE  
 SAFETY HARBOR  
 1. PRELIMINARY PLANS (VERSION 8)  
 2. STRUCTURAL ENG. REVIEW (VERSION 8)

PLAN DATE
1. 12-06-2018
2. 12-11-2018



DEEB FAMILY  
 HOMES, LTD.  
 9400 RIVER CROSSING BLD.  
 NEW PORT RICHEY, FL. 34655

1A


FOUNDATION EXPANSION  
 1/16" = 1'-0"

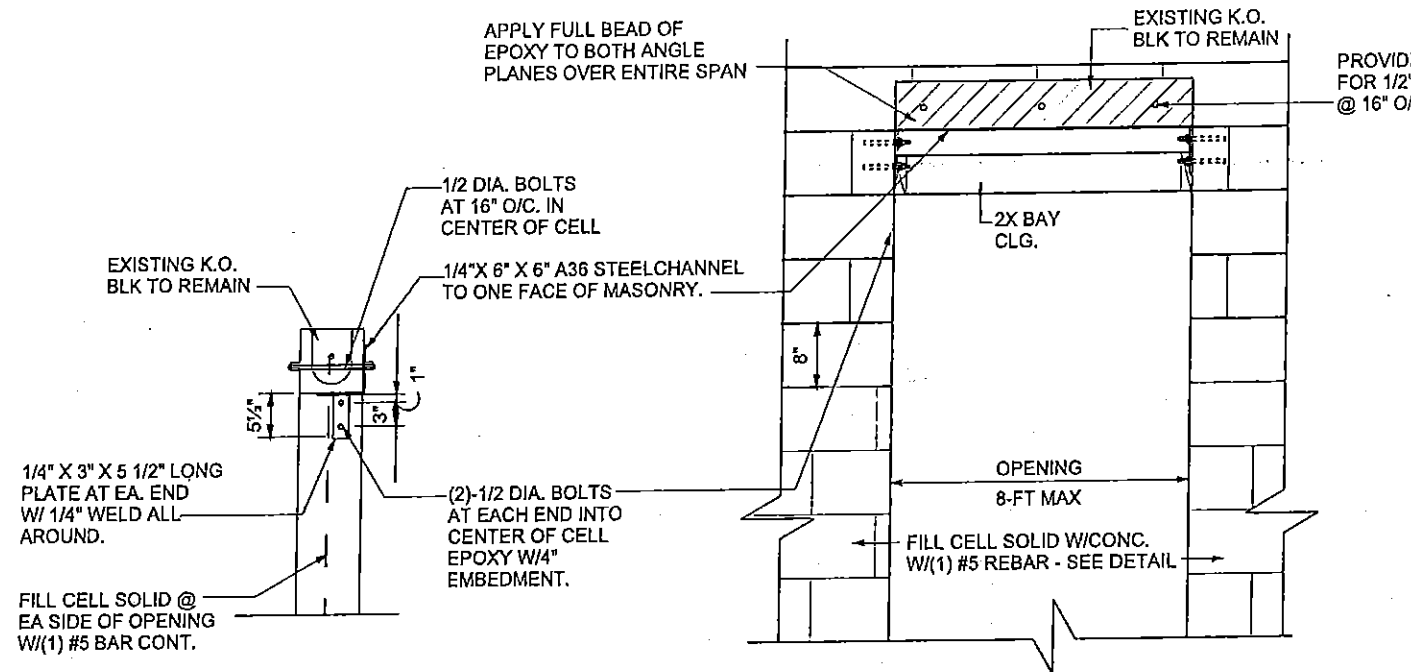


**1/1B LINTEL RETROFIT DETAIL AT BAY**

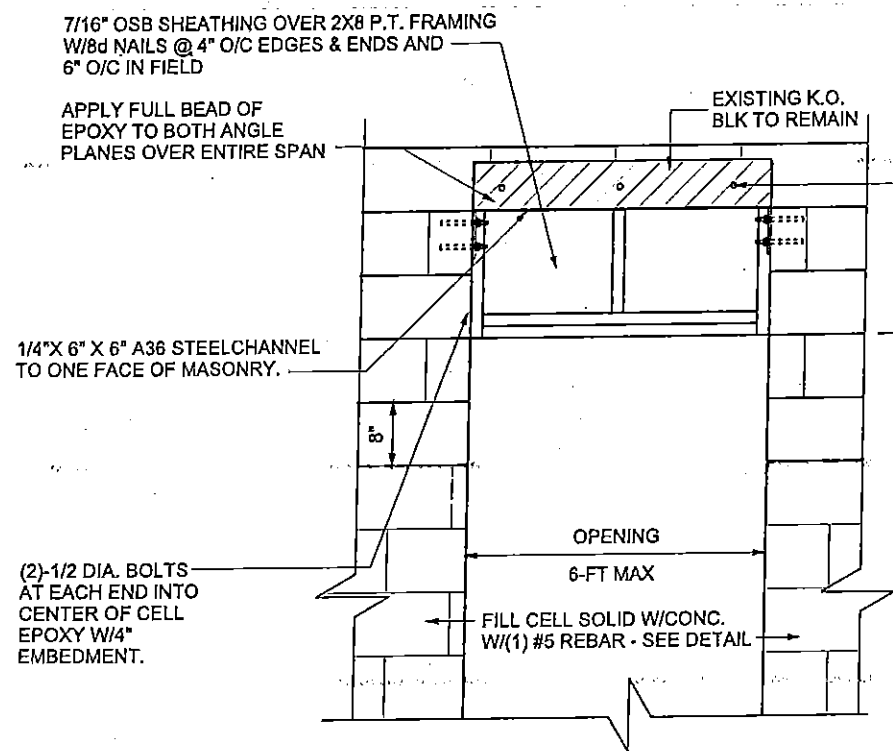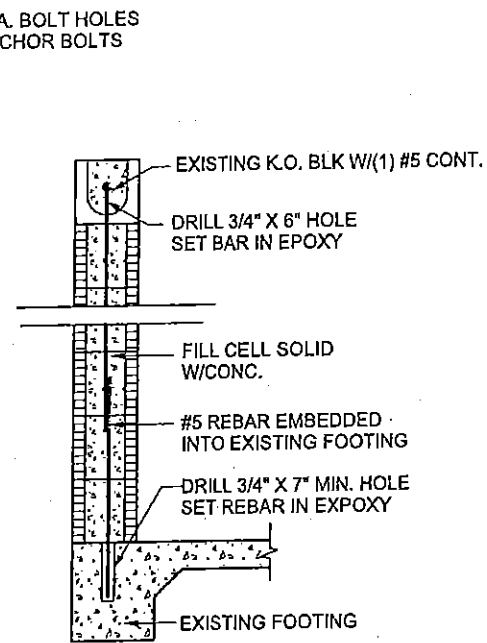

**2/1B LINTEL RETROFIT DETAIL AT WINDOW**

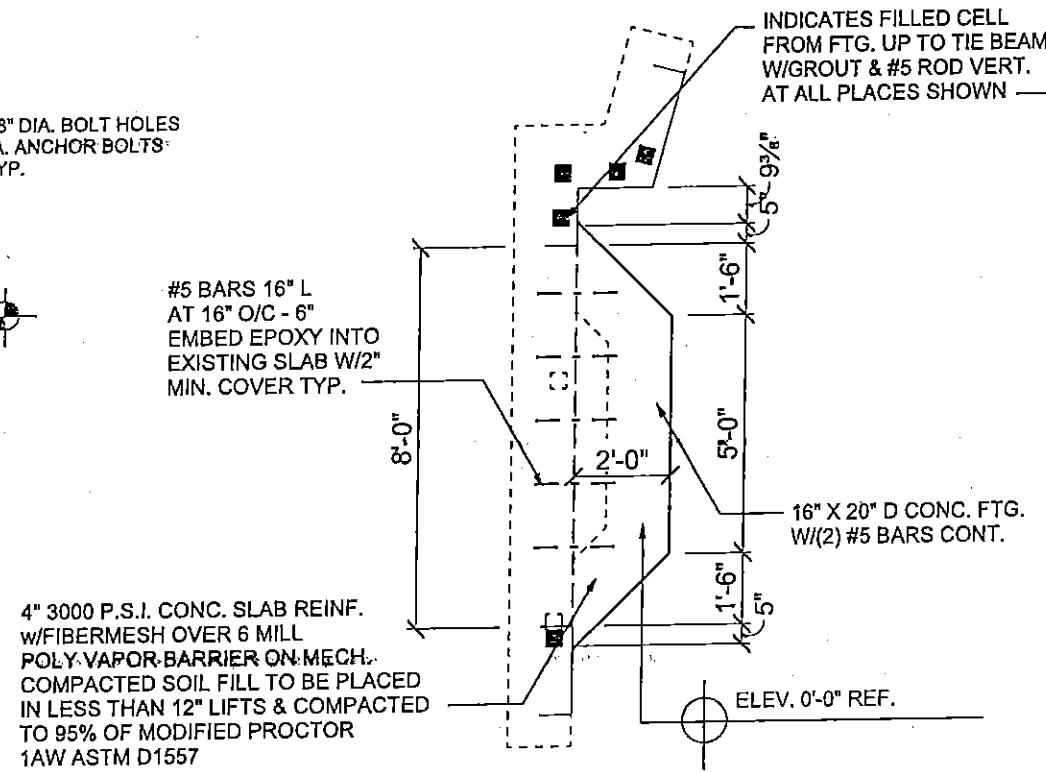

**BAY FOUNDATION**

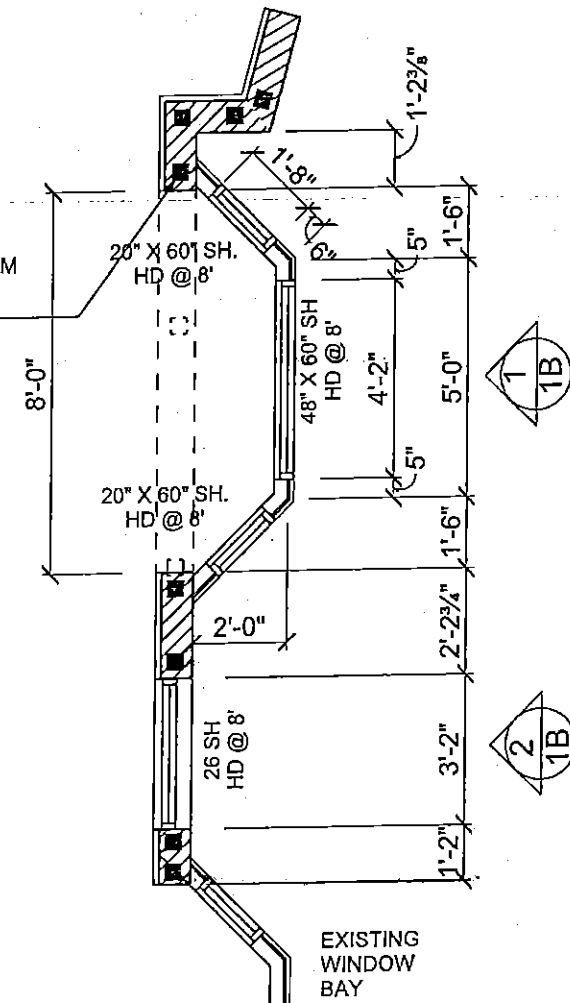

**BAY/WINDOW PLAN**

**BAY ADDITION DETAILS**

SCALE 1/4" = 1'-0"

A.E.C.S. #18040

PLAN 3020

**1B**

**DEEB FAMILY HOMES, LTD.**  
9400 RIVER CROSSING BLD.  
NEW FORT RICHEY, FL. 34655

PLAN DATE
1. 12-06-2018
2. 12-11-2018
3. 12-27-2018
4. 02-01-2019

LOT 22 HAMILTON SAFETY HARBOR


1. PRELIMINARY PLANS  
2. STRUCTURAL ENG. REVIEW (VERSION 8)  
3. BAY WINDOW DETAIL UPDATES (VERSION 8)  
4. BAY WINDOW/WINDOW ADDITION

I HEREBY CERTIFY THAT I HAVE PERFORMED THE ATTACHED DESIGN TO COMPLY WITH ALL APPLICABLE LOCAL, STATE AND FEDERAL BUILDING CODES AND THE 2017 FLORIDA RESIDENTIAL BUILDING CODE. I HAVE REVIEWED THE STRUCTURE ONLY. I HAVE NOT REVIEWED THE FOUNDATION OR OTHER DETAILS.

SIGNED: RICHARD E. ALLEN P.E. #5923

**ALLEN ENGINEERING & CONSTRUCTION SERVICES**  
RICH ALLEN PROFESSIONAL ENGINEER  
P.E. #56920 C.A. #9542  
8809 SKYMASTER DRIVE  
NEW FORT RICHEY, FL 34654  
727-842-6100  
richallenpe@gmail.com



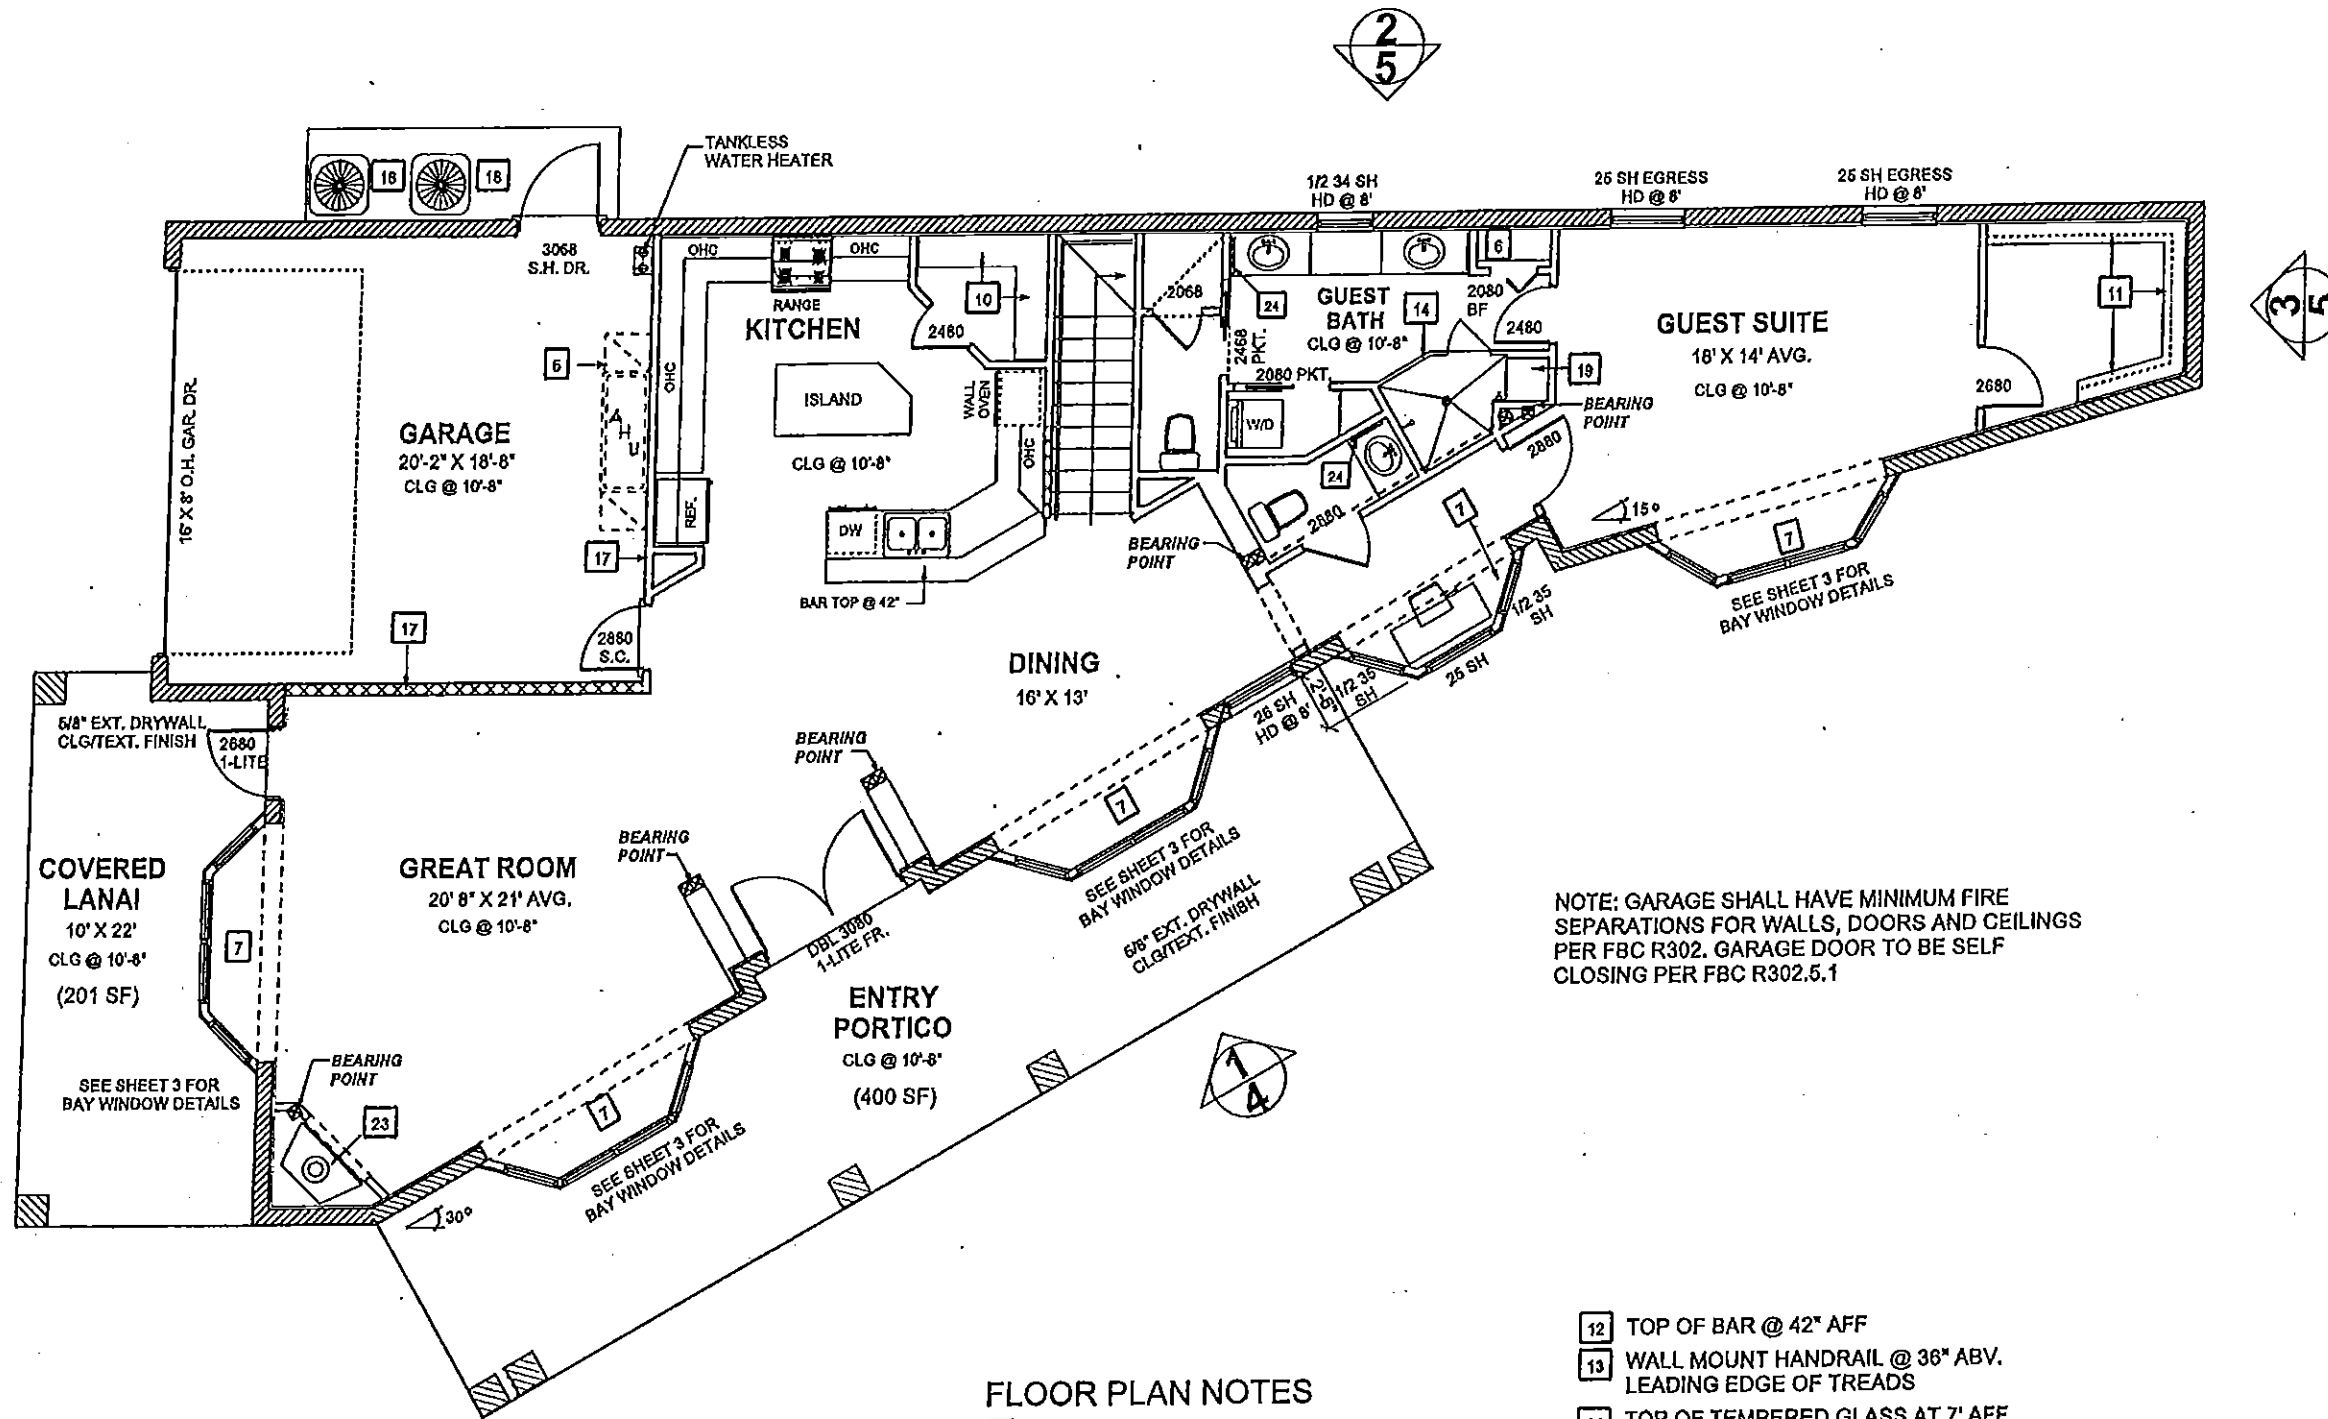

NOTE: GARAGE SHALL HAVE MINIMUM FIRE SEPARATIONS FOR WALLS, DOORS AND CEILING PER FBC R302. GARAGE DOOR TO BE SELF CLOSING PER FBC R302.5.1

**SQUARE FOOTAGES**

LIVING AREA (1ST FLR)	1672 SQ. FT.
LIVING AREA (2ND FLR)	1383 SQ. FT.
TOTAL LIVING AREA	3035 SQ. FT.
GARAGE	405 SQ. FT.
COVERED PORCH	201 SQ. FT.
COVERED LANAI	401 SQ. FT.
TOTAL UNDER ROOF:	4042 SQ. FT.
2ND FLR. BALCONY	148 SQ. FT.

**FLOOR PLAN NOTES**

- 1 DRYER VENT CHASE
- 2 HANSON BOX @ 42" AFF
- 3 12" WIRE SHELF @ 5'-8" AFF
- 4 WASHER/DRYER COMBO
- 5 AIR HANDLER UNIT SUSPENDED FROM CLG.
- 6 4-12" SHELVES
- 7 BAY CLG @ 9'-4"
- 8 6" STUD WALL
- 9 22" X 36" CLG ACCESS
- 10 (4) 16" SHELVES
- 11 12" SHELF
- 12 TOP OF BAR @ 42" AFF
- 13 WALL MOUNT HANDRAIL @ 36" ABV. LEADING EDGE OF TREADS
- 14 TOP OF TEMPERED GLASS AT 7" AFF
- 15 (2) 2X8 STAIR PLATFORM BEAM. BTM @ 7'-8" AFF
- 16 INSTALL 1/4" WATER LINE FOR ICEMAKER
- 17 R-13 BATT INSULATION
- 18 A/C COMPRESSOR UNIT.
- 19 SEAT @ 16" ABV. FLR
- 20 NOT USED
- 21 (4) 20" SHELVES
- 22 LOAD BEARING WALL 2X6 SYP @ 16" O/C
- 23 42" W DIRECT VENT GAS FIREPLACE
- 24 MEDICINE CABINET

**FIRST FLOOR NOTES**

SCALE 1/8" = 1'-0"

PLAN 3035

LOT 22 HAMILTON AVE  
SAFETY HARBOR


PLAN DATE
1. 12-06-2018
2. 12-11-2018
3. 12-27-2018
4. 02-08-2019
5. 02-18-2019

DEEB FAMILY  
HOMES, LTD.  
9400 RIVER CROSSING BLD.  
NEW PORT RICHEY, FL 34655

- 2. STRUCTURAL ENG. REVIEW (VERSION 5)
- 3. BAY WINDOW DETAIL UPDATES (VERSION 6)
- 4. BAY WINDOW/WINDOW/ROOF ADDITION
- 5. GUEST BATH & KITCHEN REVISIONS

2



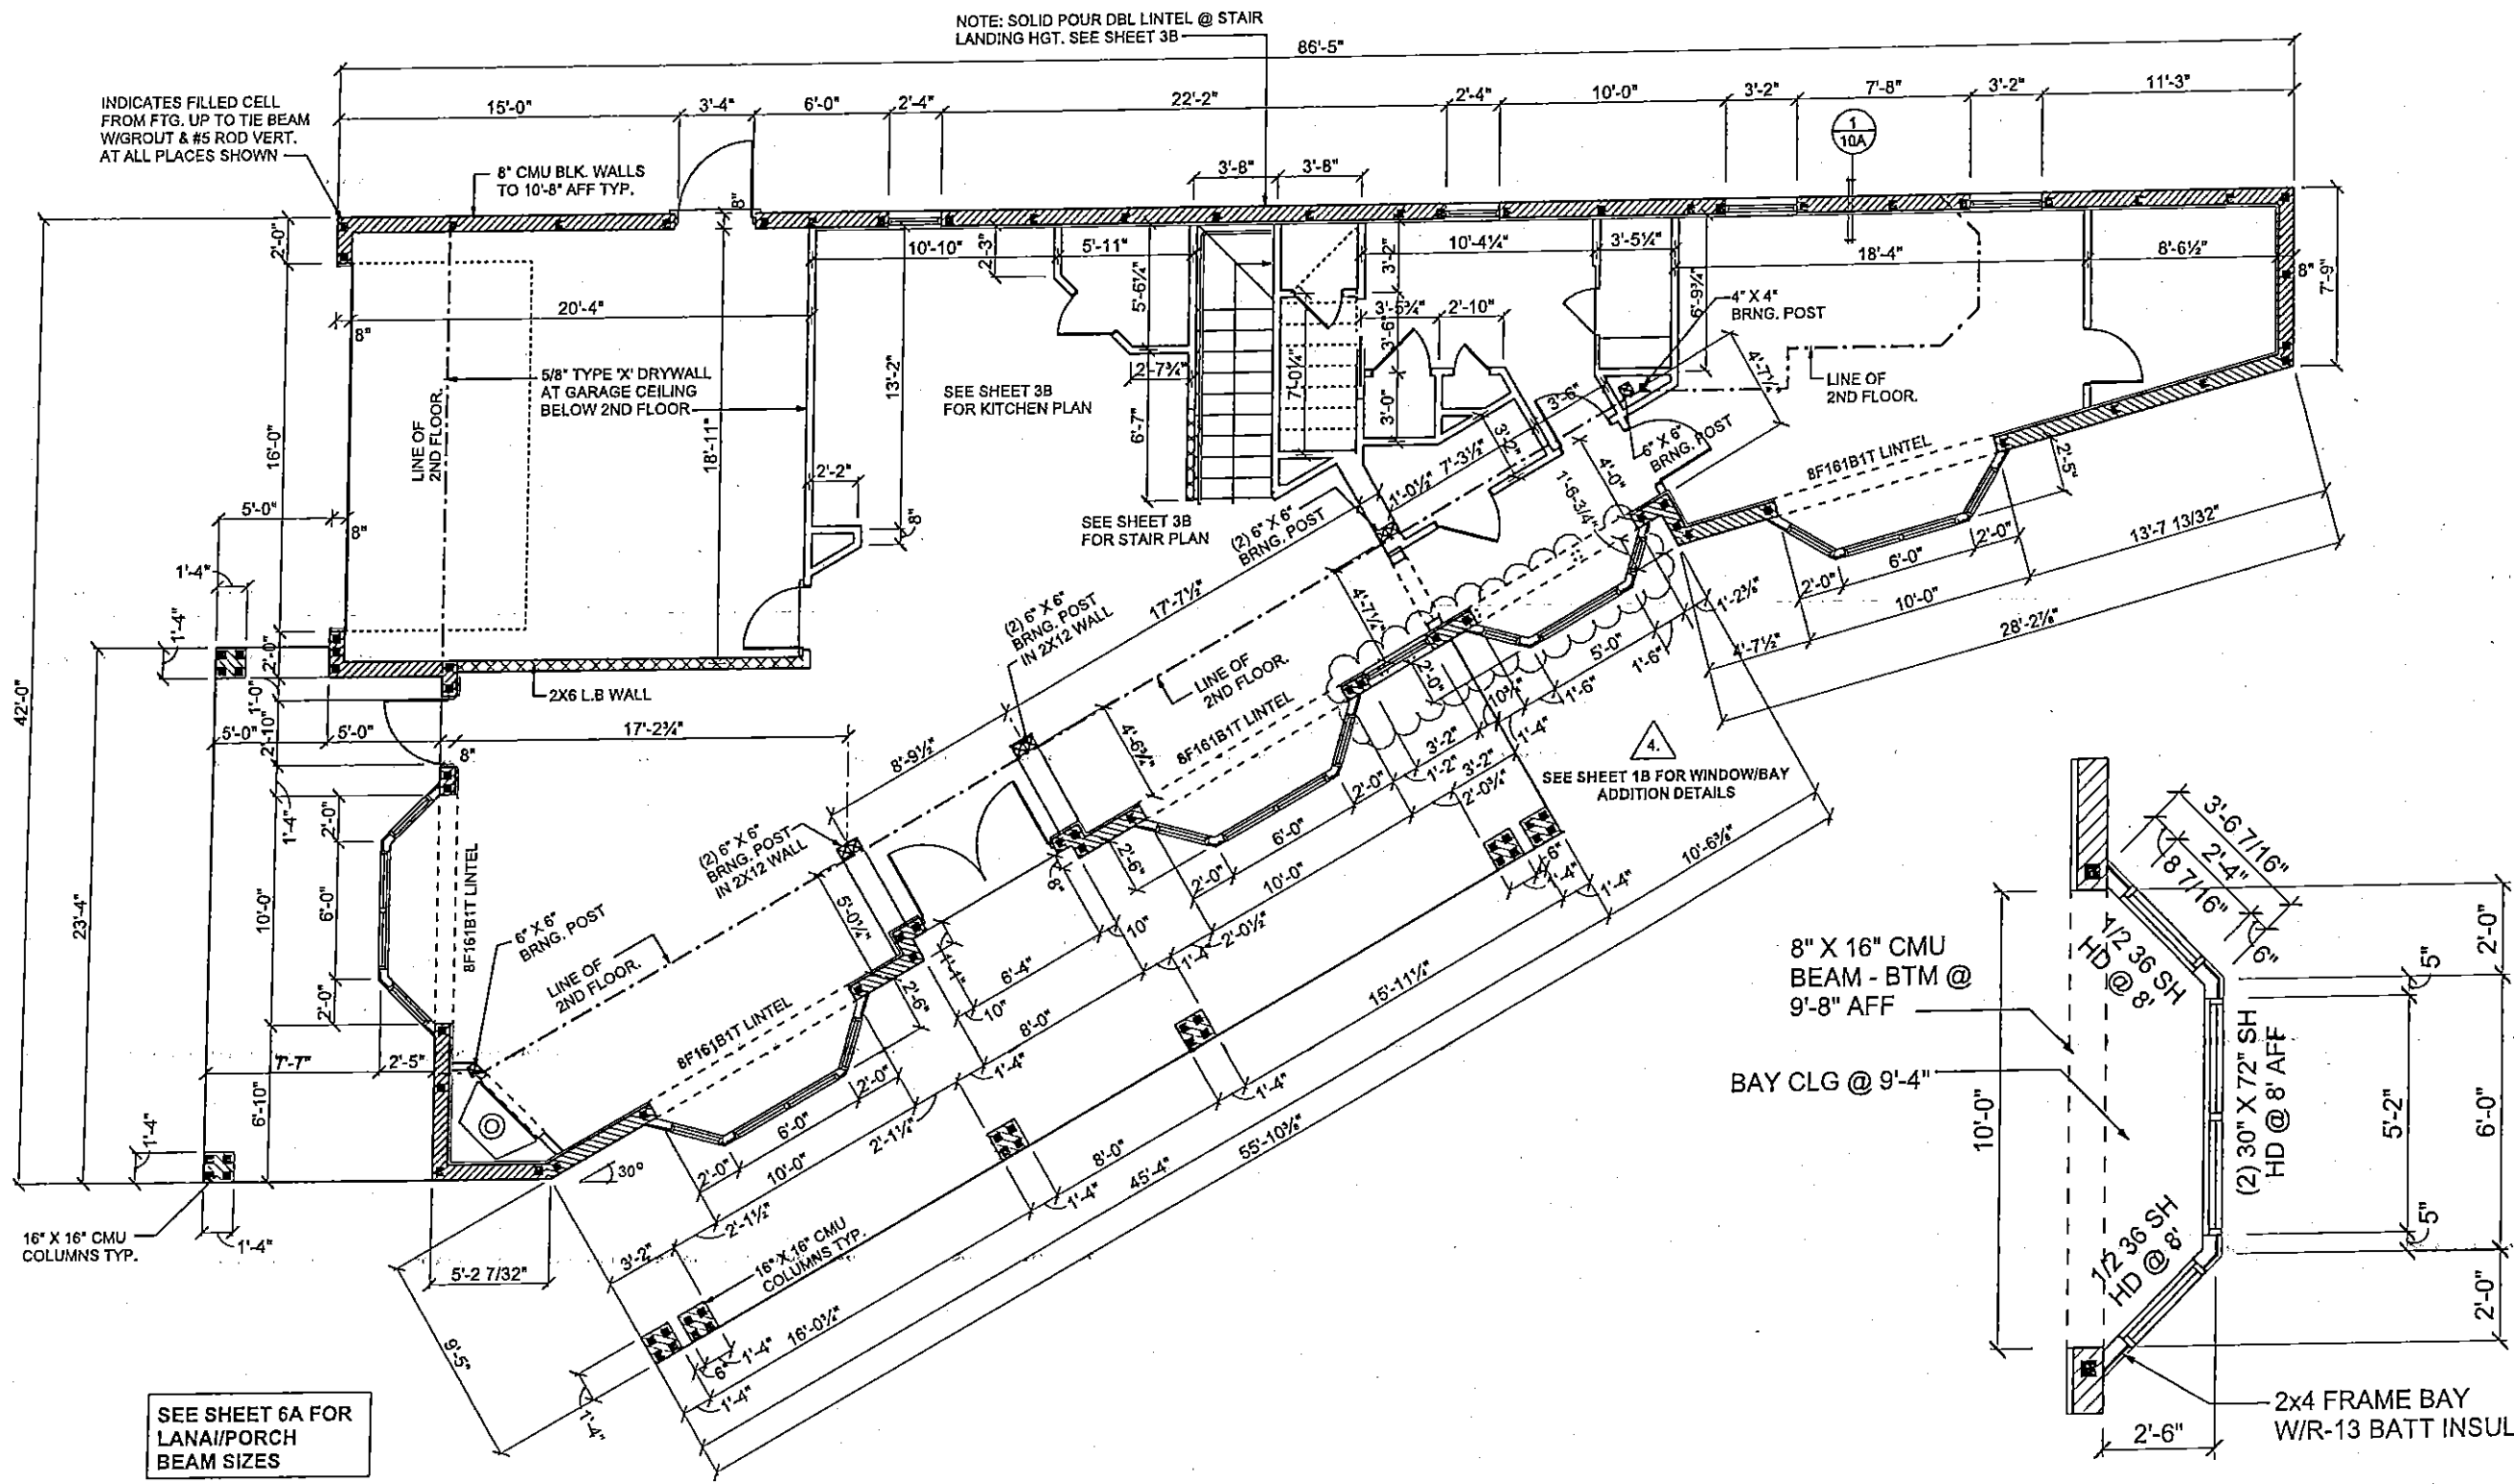

**BAY WINDOW DETAILS**  
(SEE SHEET 1B FOR BAY ADDITION)

SEE SHEET 6A FOR  
LANAI/PORCH  
BEAM SIZES

**PLAN 3035**

**ALLEN ENGINEERING & CONSTRUCTION SERVICES**  
RICH ALLEN PROFESSIONAL ENGINEER  
P.E. #56920 C.A. #9542  
8809 SKYMASTER DRIVE  
NEW PORT RICHEY, FL 34654  
727-842-6100  
richallenpe@gmail.com

**A.E.C.S. #18040**

HEREBY CERTIFY THAT I HAVE PERFORMED THE ATTACHED DESIGN TO COMPLY WITH ALL APPLICABLE WIND LOADS, EXPOSURE D AND IT IS IN COMPLIANCE WITH SECTION 304 OF THE 2017 FLORIDA RESIDENTIAL BUILDING CODE. I HAVE SEALED FOR THE STRUCTURE ONLY.

SIGNED: RICHARD E. ALLEN P.E. #56920

**SCALE 1/8" = 1'-0"**


**LOT 22 HAMILTON SAFETY HARBOR**

1. PRELIMINARY PLANS  
2. STRUCTURAL ENG. REVIEW (VERSION 8)  
3. BAY WINDOW DETAIL UPDATES (VERSION 8)  
4. BAY WINDOW/WINDOW ADDITION

**FIRST FLOOR DIMENSIONS**

PLAN DATE
1. 12-06-2018
2. 12-11-2018
3. 12-27-2018
4. 02-01-2019

**DEEB FAMILY HOMES, LTD.**  
9400 RIVER CROSSING BLD.  
NEW PORT RICHEY, FL 34655

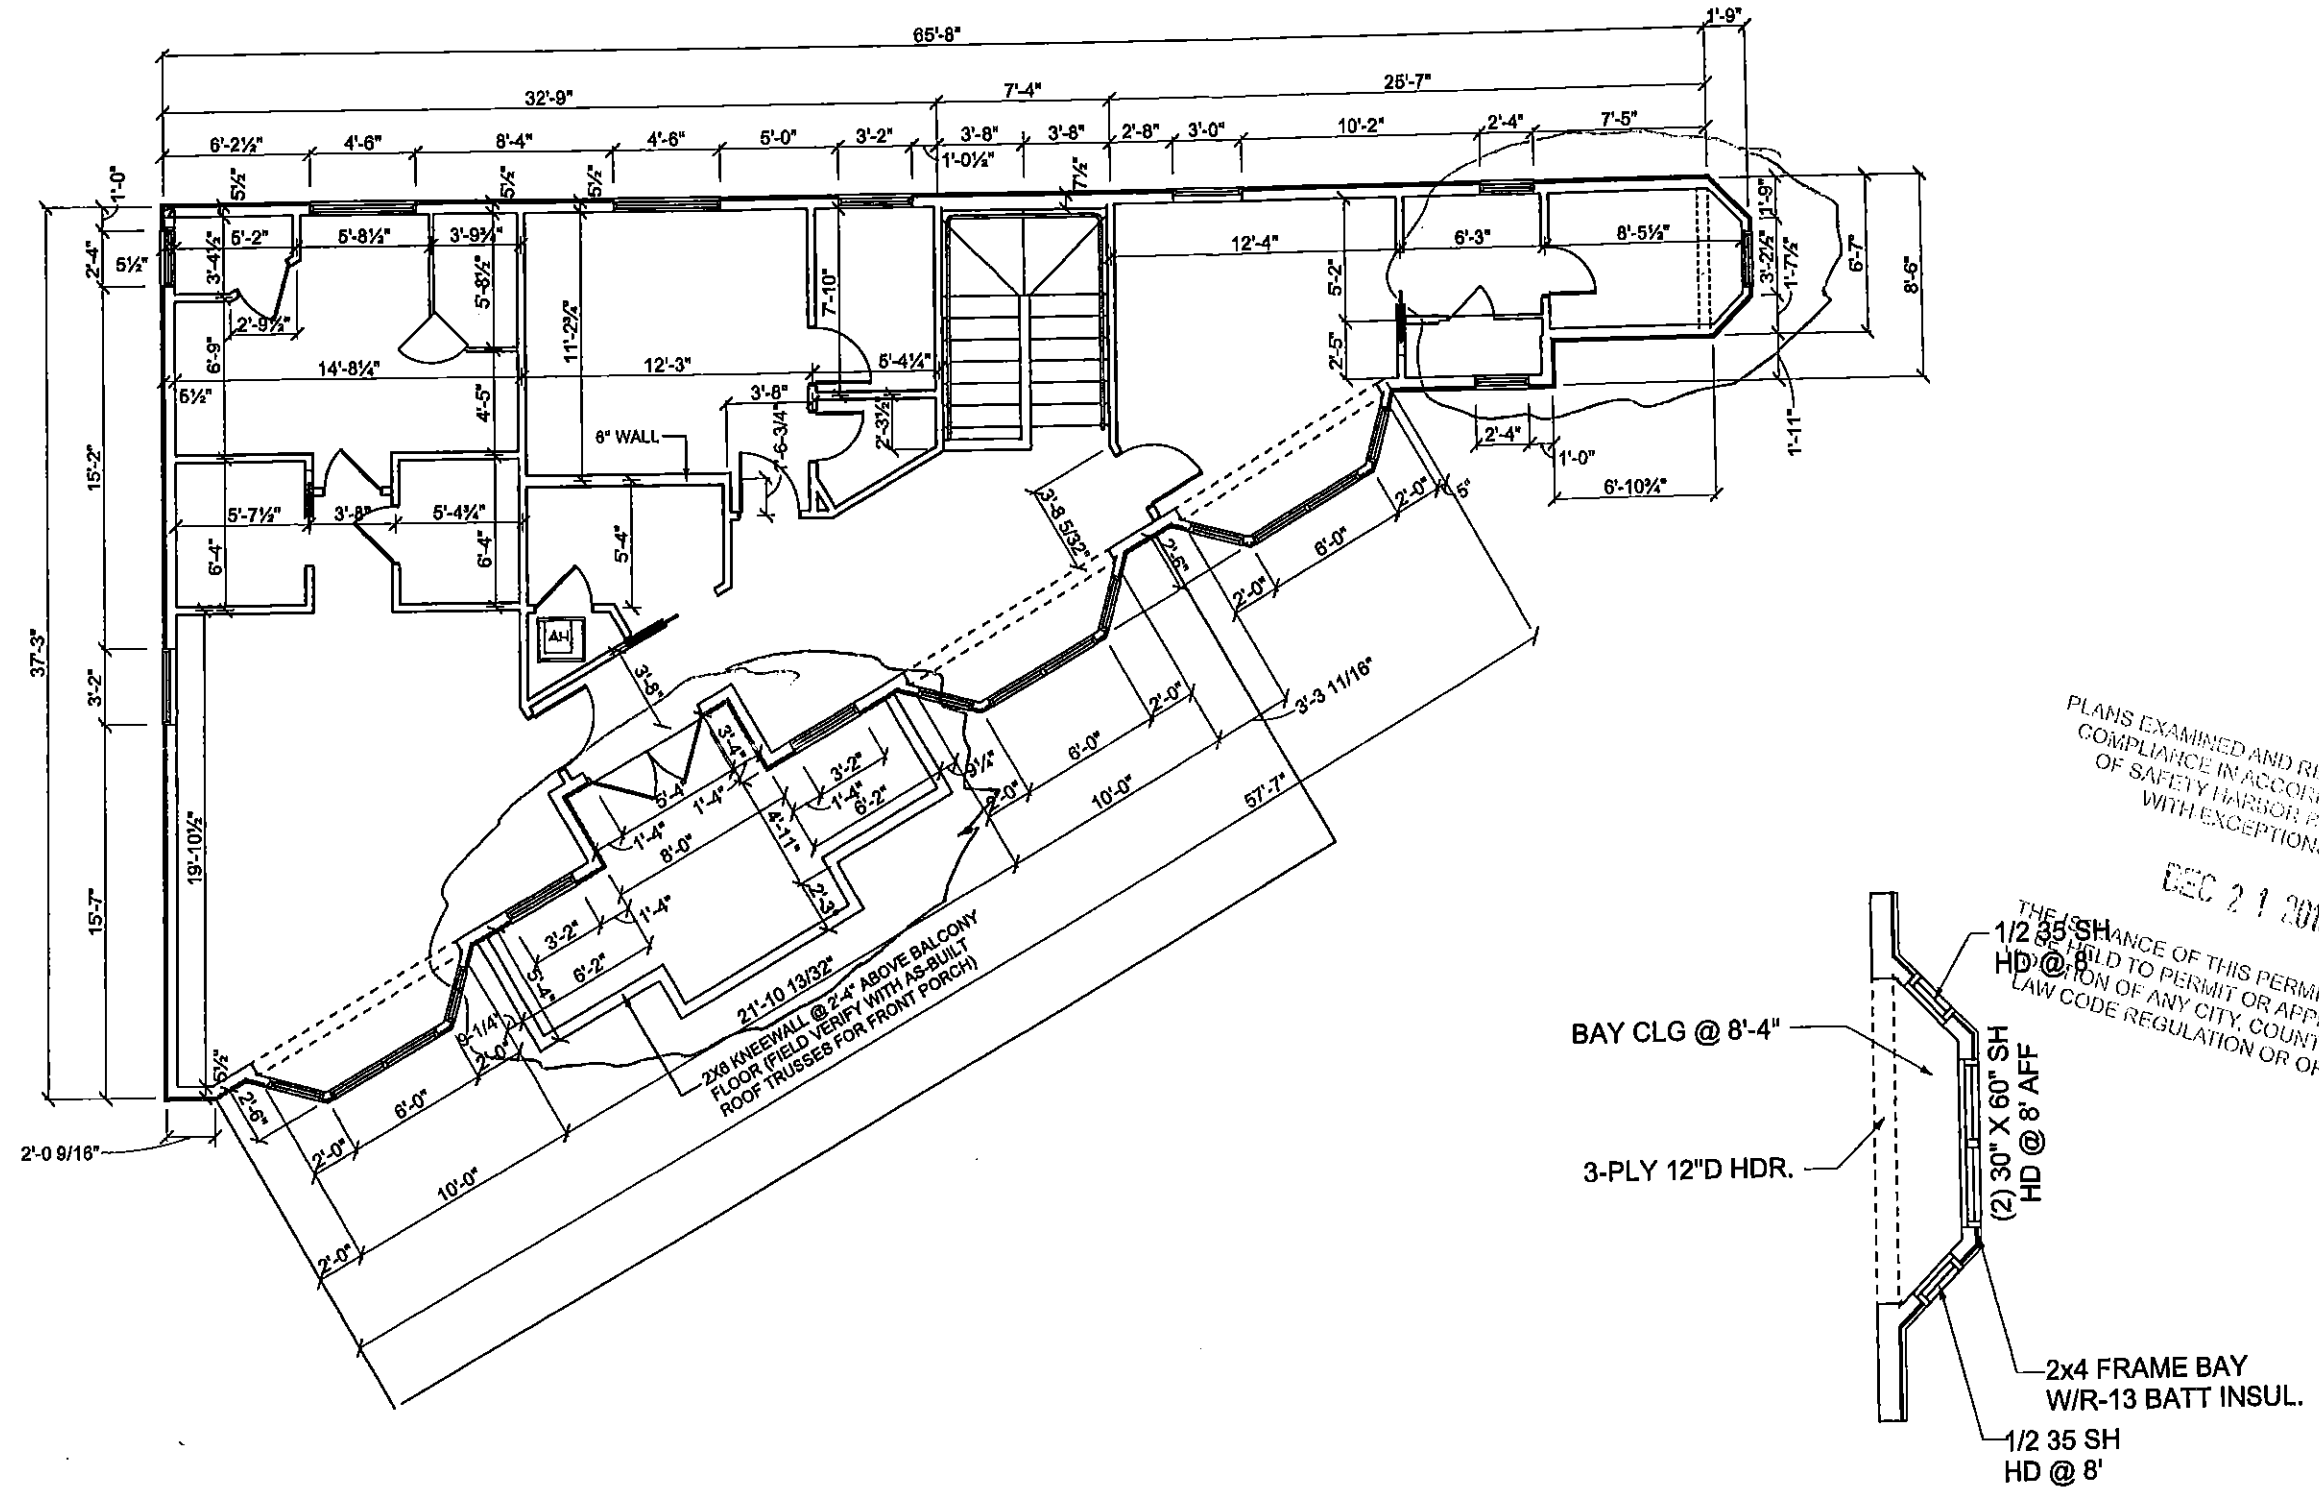

**BAY WINDOW DETAILS**

1/4" = 1'-0"

PLANS EXAMINED AND REVIEWED FOR COMPLIANCE IN ACCORDANCE WITH THE BUILDING CODE OF SAFETY HARBOR BUILDING DEPARTMENT WITH EXCEPTIONS NOTE  
 DEC 21 2018

THE ISSUANCE OF THIS PERMIT SHALL NOT BE HELD TO PERMIT OR APPROVE THE LOCATION OF ANY CITY, COUNTY OR STATE LAW CODE REGULATION OR ORDINANCE

**PLAN 3020**  
**ALLEN ENGINEERING & CONSTRUCTION SERVICES**  
 RICH ALLEN PROFESSIONAL ENGINEER  
 P.E. #56920 C.A. #9542  
 8809 SKYMASTER DRIVE  
 NEW PORT RICHEY, FL 34654  
 727-942-6100  
 richallenpe@gmail.com

**A.E.C.S. #18040**  
 I HEREBY CERTIFY THAT I HAVE PERFORMED THE NECESSARY DESIGN AND CALCULATIONS TO ASSURE THAT THE STRUCTURE IS IN COMPLIANCE WITH SECTION 301 OF THE 2017 FLORIDA RESIDENTIAL BUILDING CODE.  
 RICH ALLEN P.E. #56920


**SCALE 1/8" = 1'-0"**  
**LOT 22 HAMILTON SAFETY HARBOR**  
 1. PRELIMINARY PLANS  
 2. STRUCTURAL ENG. REVIEW (VERSION 8)

**2ND FLOOR DIMENSIONS**

PLAN DATE	REVISION
1. 12-06-2018	
2. 12-11-2018	


**DEEB FAMILY HOMES, LTD.**  
 9400 RIVER CROSSING BLD.  
 NEW PORT RICHEY, FL 34655

**3A**

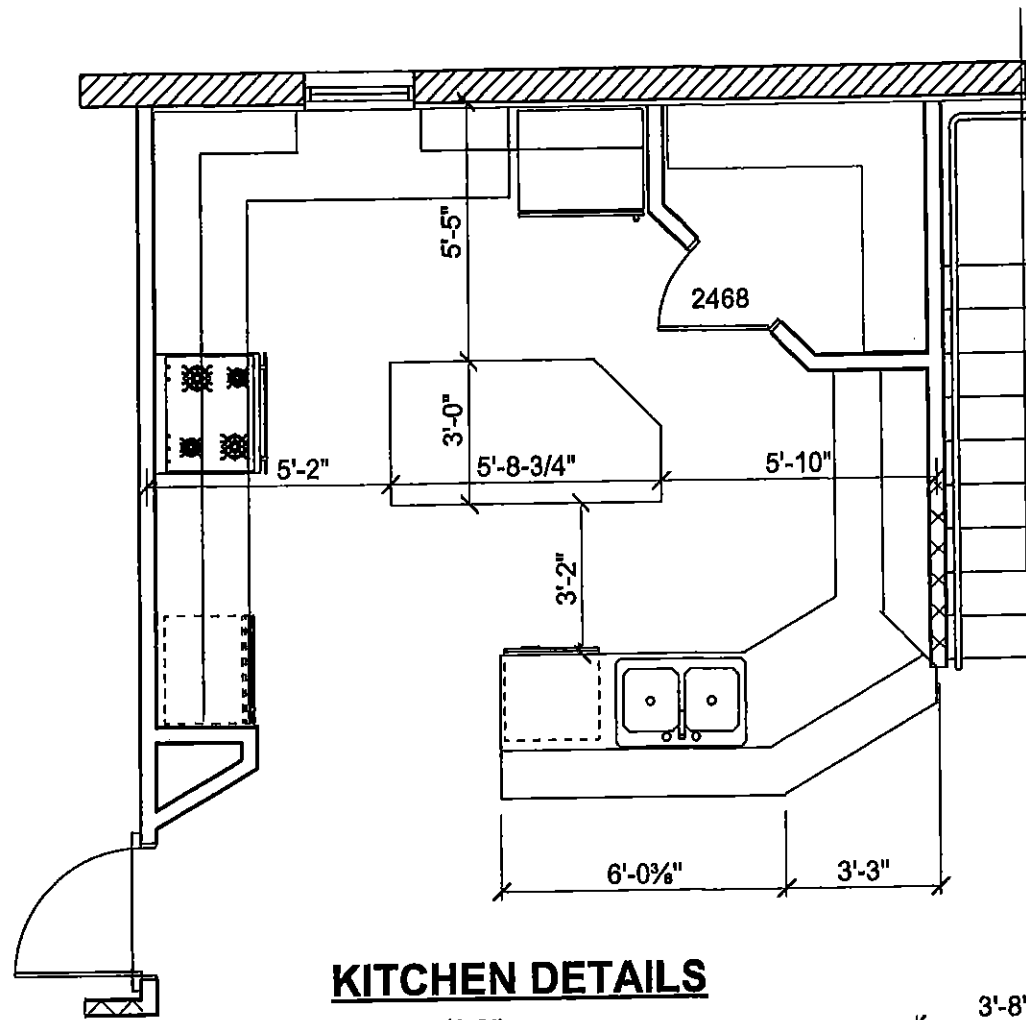


**KITCHEN DETAILS**

1/4" = 1'-0"

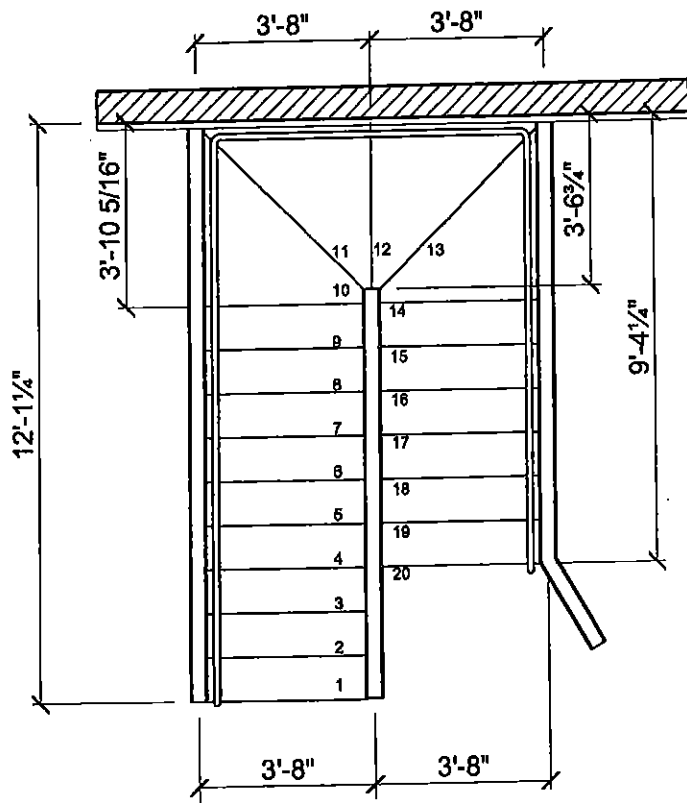

**STAIR PLAN**

1/4" = 1'-0"

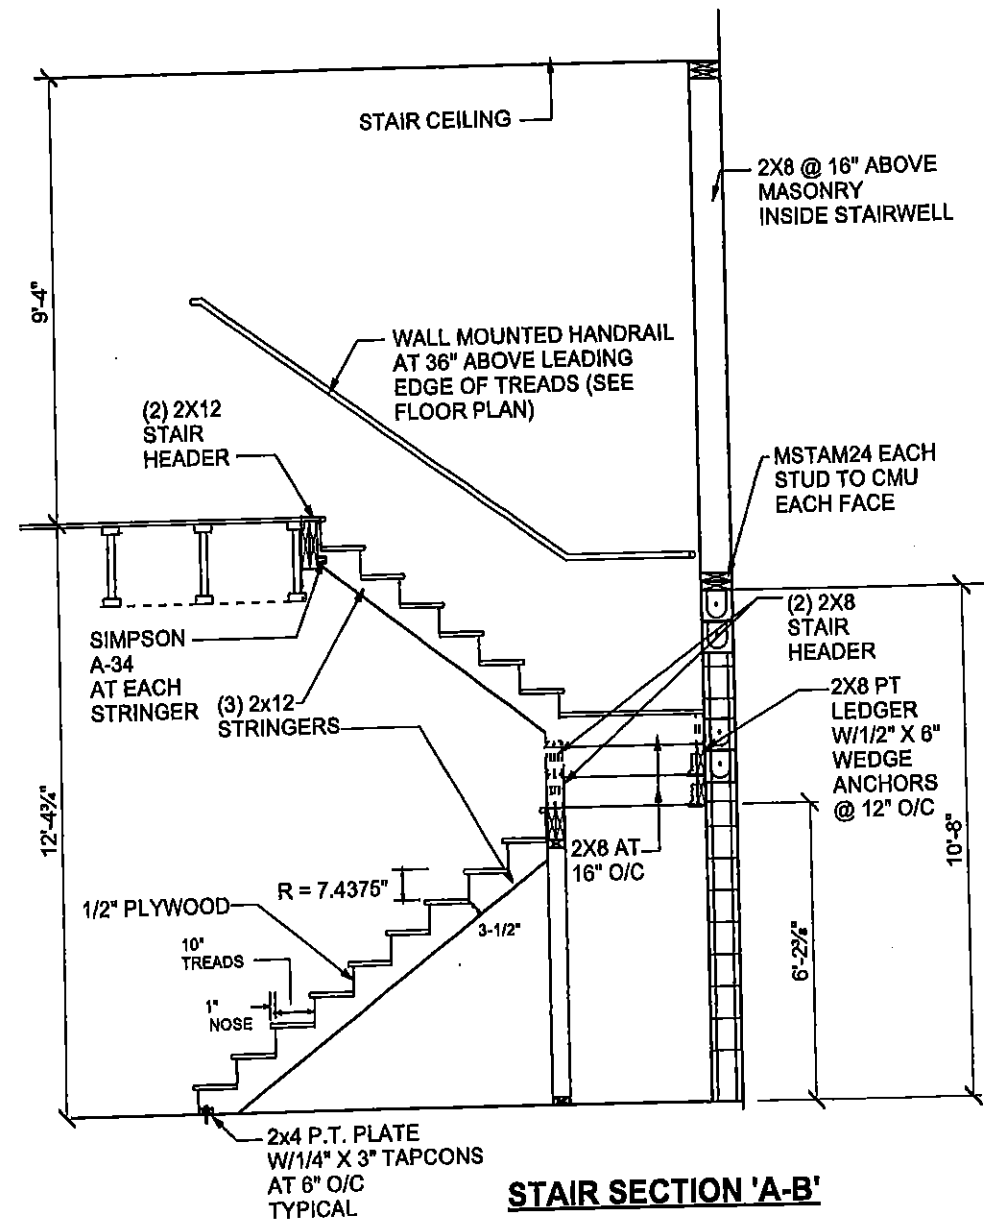

**STAIR SECTION 'A-B'**

3/8" PL. 4x10" EXAMINED AND REVIEWED FOR CODE COMPLIANCE IN ACCORDANCE WITH CITY OF SAFETY HARBOR BUILDING CODE WITH EXCEPTIONS NOTED

DEC 21 2018

THE ISSUANCE OF THIS PERMIT SHALL NOT BE HELD TO PERMIT OR APPROVE THE VIOLATION OF ANY CITY, COUNTY OR STATE LAW CODE REGULATION OR ORDINANCE

PLAN 3020

A.E.C.S. #18040

SCALE PER DRAWINGS

LOT 22 HAMILTON  
SAFETY HARBOR

PLAN DATE

1. 12-06-2018  
2. 12-11-2018

DEEB FAMILY  
HOMES, LTD.  
9400 RIVER CROSSING BLD.  
NEW PORT RICHEY, FL. 34655


SECTION DETAILS

3B


ALLEN ENGINEERING &  
CONSTRUCTION SERVICES  
RICH ALLEN PROFESSIONAL ENGINEER  
P.E. #56928 C.A. #9542  
8809 SKYMASTER DRIVE  
NEW PORT RICHEY, FL. 34654  
771-942-6100  
richallenpe@gmail.com

THESEY CERTIFY THAT I HAVE PERFORMED THE ATTACHED DESIGN TO COMPLY WITH ALL CITY, COUNTY AND STATE REQUIREMENTS AND IT IS IN COMPLIANCE WITH SECTION 901 OF THE 2017 FLORIDA RESIDENTIAL BUILDING CODE. I AM A REGISTERED PROFESSIONAL ENGINEER IN THE STATE OF FLORIDA. MY LICENSE NO. IS 56928. I HAVE REVIEWED AND APPROVED THESE DRAWINGS FOR CONSTRUCTION ONLY. SIGNATURE: RICH ALLEN P.E. #56928

1. PRELIMINARY PLANS  
2. STRUCTURAL ENG. REVIEW (VERSION 9)

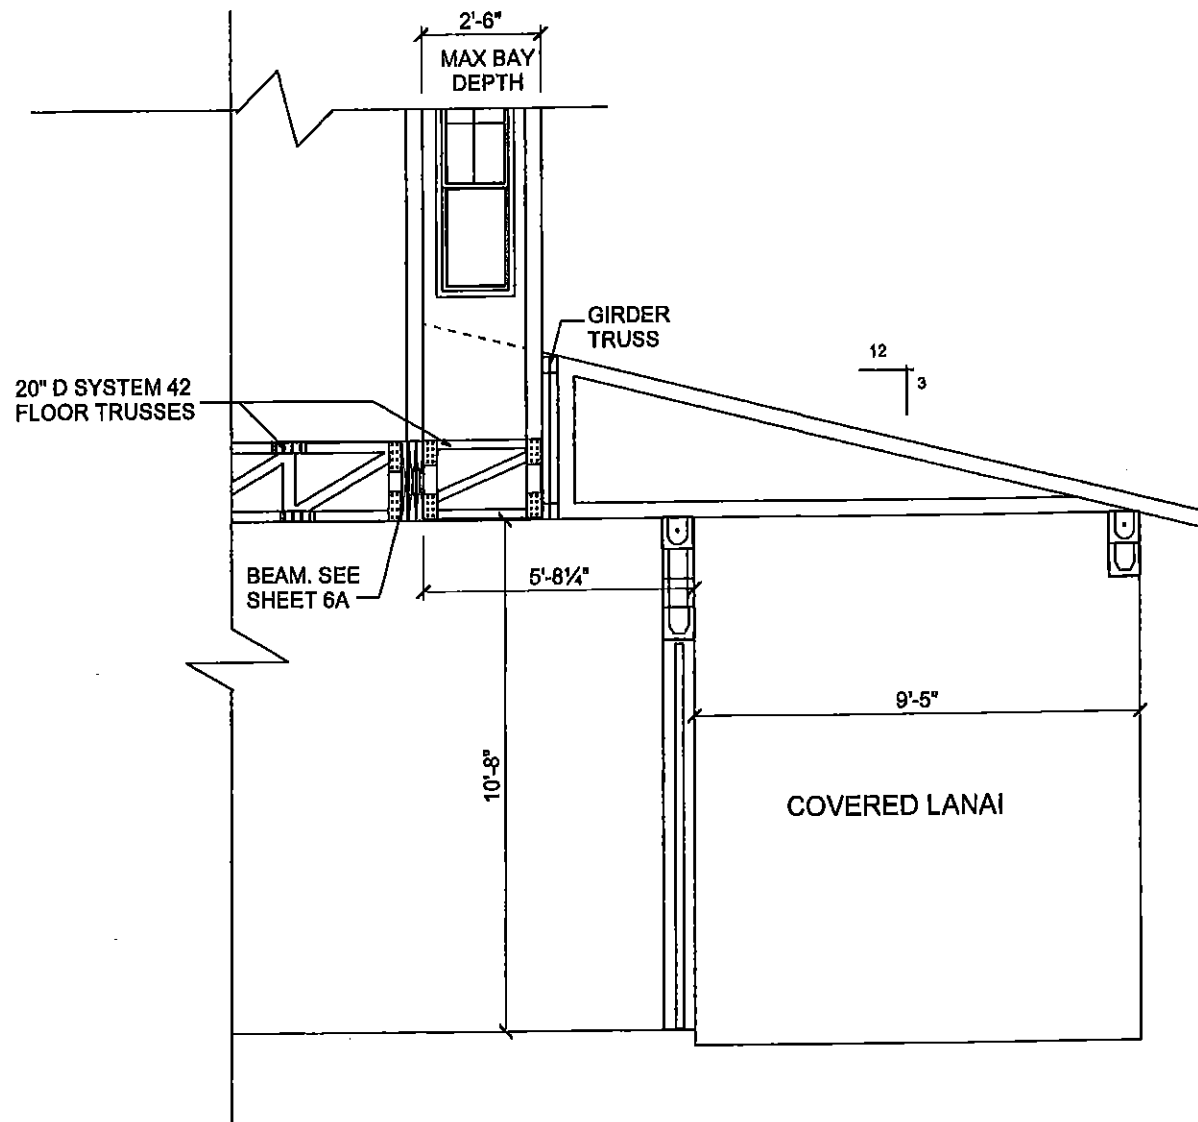

**BAY SECTION 2/3C**

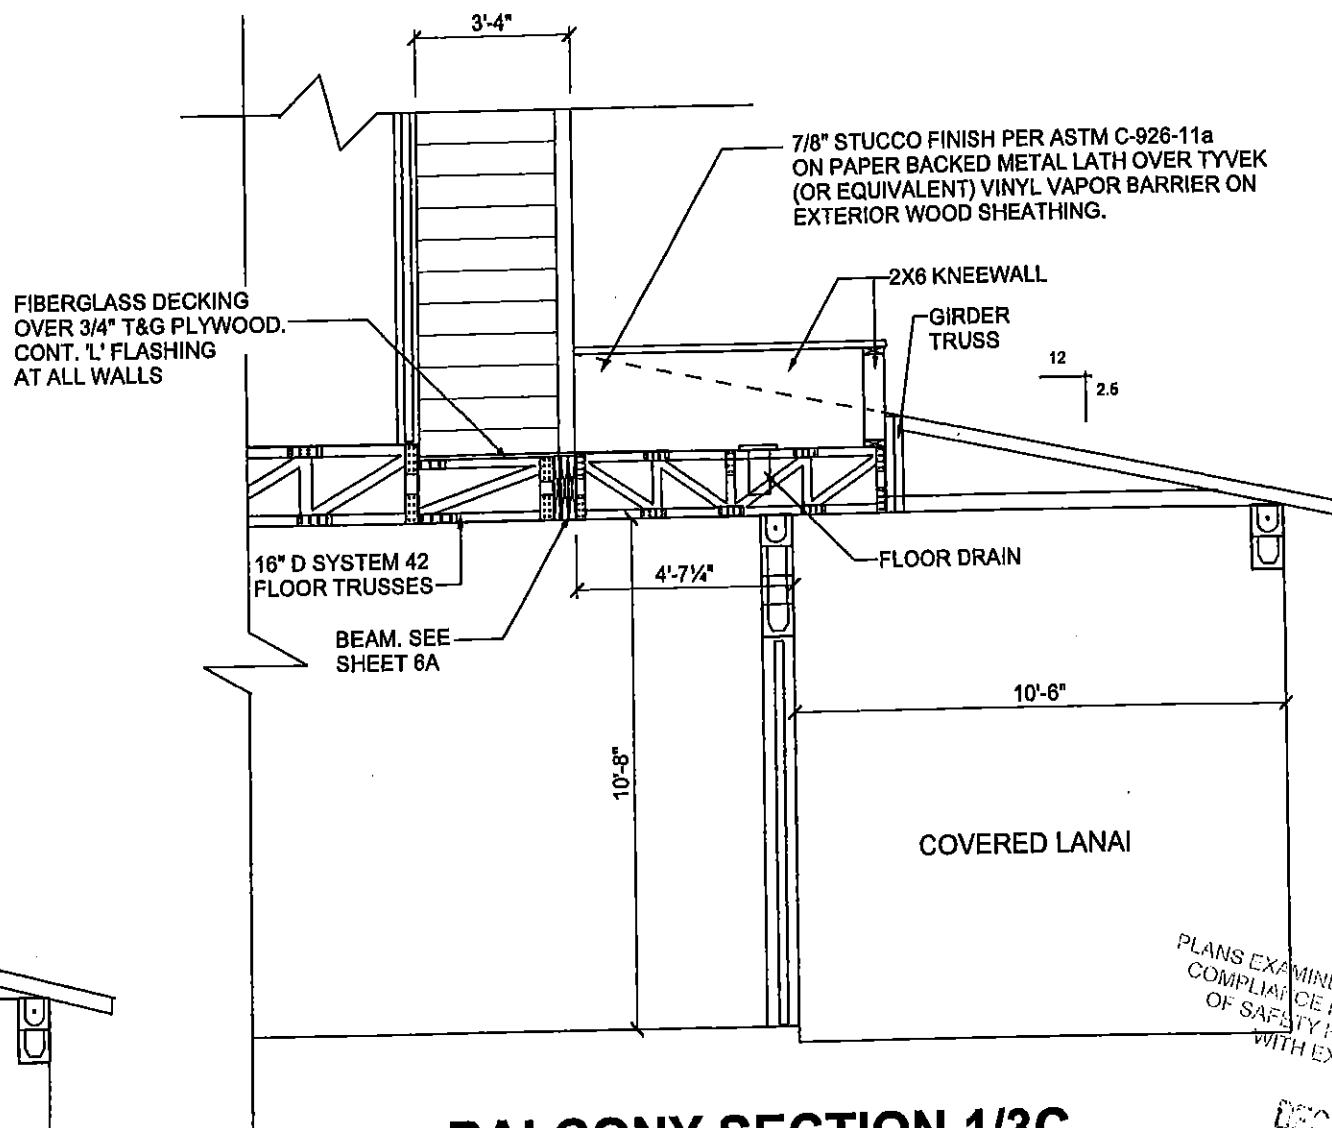

**BALCONY SECTION 1/3C**

PLANS EXAMINED AND REVIEWED FOR CODE COMPLIANCE IN ACCORDANCE WITH CITY OF SAFETY HARBOR BUILDING CODE WITH EXCEPTIONS NOTED

DEC 21 2018

THE ISSUANCE OF THIS PERMIT SHALL NOT BE HELD TO PERMIT OR APPROVE THE VIOLATION OF ANY CITY, COUNTY OR STATE LAW CODE REGULATION OR ORDINANCE

SECTION DETAILS

3C

DEEB FAMILY HOMES, LTD.  
9400 RIVER CROSSING BLD.  
NEW PORT RICHEY, FL 34655

PLAN DATE
1. 12-06-2018
2. 12-11-2018

1. PRELIMINARY PLANS  
2. STRUCTURAL ENG. REVIEW (VERSION 9)

LOT 22 HAMILTON SAFETY HARBOR

SCALE 1/4" = 1'-0"

A.E.C.S. #18040

THEIR COUNTY THAT HAVE PERFORMED THE ATTACHED DESIGN TO COMPLY WITH THE ULTIMATE WIND LOADS, EXCEPT AS NOTED IN COMPLIANCE WITH SECTION 901 OF THE 2017 FLORIDA RESIDENTIAL BUILDING CODE. THIS PERMIT IS VALID FOR 180 DAYS FROM THE DATE OF ISSUANCE.

SEAL OF RICHARD ALLEN F.E. 36560

PLAN 3020

ALLEN ENGINEERING & CONSTRUCTION SERVICES  
RICH ALLEN PROFESSIONAL ENGINEER  
P.E. #56920 C.A. #9542  
8809 SKYMASTER DRIVE  
NEW PORT RICHEY, FL 34654  
727-842-6100  
richallenpe@gmail.com



**1**  
**4**  
**HAMILTON AVE. ELEVATION**

**ELEVATION NOTES**

- 1** HORIZONTAL 8" LAP CEMENT BOARD SIDING
- 2** CEMENT BOARD CORNER TRIM
- 3** 4" CEMENT BOARD TRIM
- 4** 5/8" CEMENTITIOUS FIN. OVER CMU
- 5** NOT USED
- 6** NOT USED
- 7** 5V CRIMP GALV. METAL ROOF
- 8** 16" SQUARE CMU COLUMNS W/1/2" FOAM TRIM AND FAUX STONE VENEER (4) SIDES.
- 9** 4" SMOOTH BANDING
- 10** 7/8" STUCCO FINISH PER ASTM C-926-11a ON PAPER BACKED METAL LATH OVER TYVEK (OR EQUIVALENT) VINYL VAPOR BARRIER ON EXTERIOR WOOD SHEATHING
- 11** FRIEZE BOARD W/8" REVEAL
- 12** 3-LAYER FASCIA (TYP. FRONT ELEV)
- 13** 7/8" STUCCO FINISH PER ASTM C-926-11a ON PAPER BACKED METAL LATH OVER TYVEK (OR EQUIVALENT) VINYL VAPOR BARRIER ON EXTERIOR WOOD SHEATHING.
- 14** PRE-FAB/PRE-ENG. GUARDRAIL ABOVE KNEEWALL: TOTAL HEIGHT 48" ABV. BALCONY FLR.
- 15** FAUX STONE VENEER TYP.
- 16** 2-LAYER FASCIA
- 17** DECO TRIANGULAR LOUVER PER DETAIL THIS SHEET
- 18** 1/2" FOAM BANDING

**PORCH COLUMN DETAILS**

**FRC GUARDRAIL REQUIREMENTS:**

**R312.12 Height.** Required guards at open-sided walking surfaces, including stairs, porches, balconies or landings, shall not be less than 36 inches (914 mm) in height as measured vertically above the adjacent walking surface or the line connecting the leading edge of the treads.

**R312.12.1.3 Opening Limitations.** Required guards shall not have openings from the walking surface to the required guard height that allow passage of a sphere 4 inches (102 mm) in diameter



**TABLE R301.5**  
**MINIMUM UNIFORMLY DISTRIBUTED LIVE LOADS**  
(in pounds per square foot)  
(Edited to apply to Guardrails)

USE	LIVE LOAD
Guards and Handrails <sup>d</sup>	200 <sup>h</sup>
Guard In-fill components <sup>f</sup>	50 <sup>h</sup>



**d.** A single concentrated load applied in any direction at any point along the top

**f.** Guard in-fill components (all those except the handrail), balusters and panel fillers shall be designed to withstand a horizontally applied normal load of 50 pounds on an area equal to 1 square foot. This load need not be assumed to act concurrently with any other live load requirement.

**h.** Glazing used in handrail assemblies and guards shall be designed with a safety factor of 4. The safety factor shall be applied to each of the concentrated loads applied to the top of the rail, and to the load on the in-fill components. These loads shall be determined independent of one another, and the loads are assumed not to occur with any other live load.

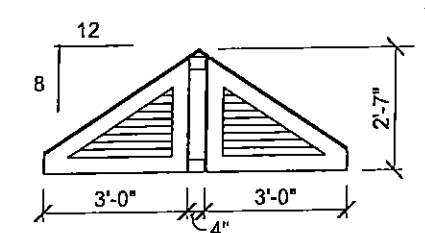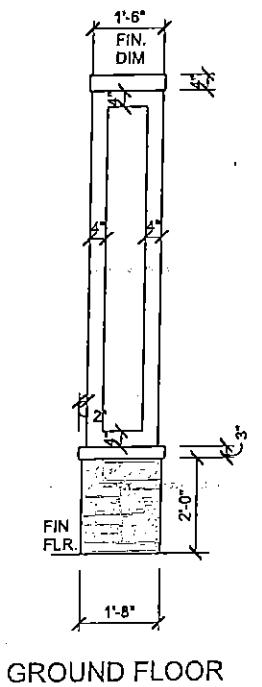


**HAMILTON AVE GABLE**  
(2ND FLR. BALCONY)

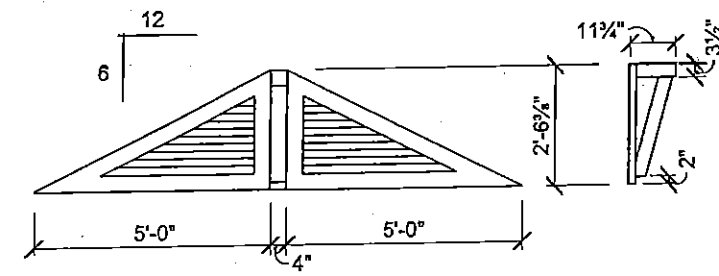

**JESSIE ST. GABLE**

**NOTE: FIELD VERIFY DIMENSIONS AND CLEARANCES PRIOR TO FABRICATION**

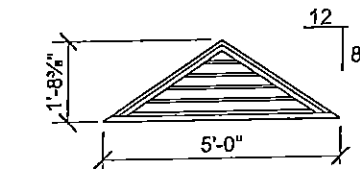

**GABLE LOUVER & BRACKET DETAILS**

SCALE 1/8" = 1'-0"

**EXTERIOR ELEVATIONS**

LOT 22 HAMILTON AVE  
SAFETY HARBOR

1. PRELIMINARY PLANS (VERSION 8)  
2. STRUCTURAL ENG. REVIEW (VERSION 8)  
3. BAY WINDOW DETAIL UPDATES (VERSION 8)  
4. BAY WINDOW/WINDOW/ROOF ADDITION


PLAN DATE	DESCRIPTION
1. 12-06-2018	
2. 12-11-2018	
3. 12-27-2018	
4. 02-01-2019	

DEEB FAMILY  
HOMES, LTD.  
9400 RIVER CROSSING BLD.  
NEW PORT RICHEY, FL 34655


4

**ELEVATION NOTES**


- 1 HORIZONTAL 8" LAP CEMENT BOARD SIDING
- 2 CEMENT BOARD CORNER TRIM
- 3 4" CEMENT BOARD TRIM
- 4 5/8" CEMENTITIOUS FIN. OVER CMU
- 5 NOT USED
- 6 NOT USED
- 7 5V CRIMP GALV. METAL ROOF
- 8 16" SQUARE CMU COLUMNS W/1/2" FOAM TRIM AND FAUX STONE VENEER (4) SIDES
- 9 4" SMOOTH BANDING
- 10 7/8" STUCCO FINISH PER ASTM C-926-11a ON PAPER BACKED METAL LATH OVER TYVEK (OR EQUIVALENT) VINYL VAPOR BARRIER ON EXTERIOR WOOD SHEATHING
- 11 FRIEZE BOARD W/8" REVEAL
- 12 3-LAYER FASCIA (TYP. FRONT ELEV)
- 13 7/8" STUCCO FINISH PER ASTM C-926-11a ON PAPER BACKED METAL LATH OVER TYVEK (OR EQUIVALENT) VINYL VAPOR BARRIER ON EXTERIOR WOOD SHEATHING.
- 14
- 15 FAUX STONE VENEER TYP.
- 16 2-LAYER FASCIA
- 17 DECO TRIANGULAR LOUVER PER DETAIL SHEET 4
- 18 1/2" FOAM BANDING

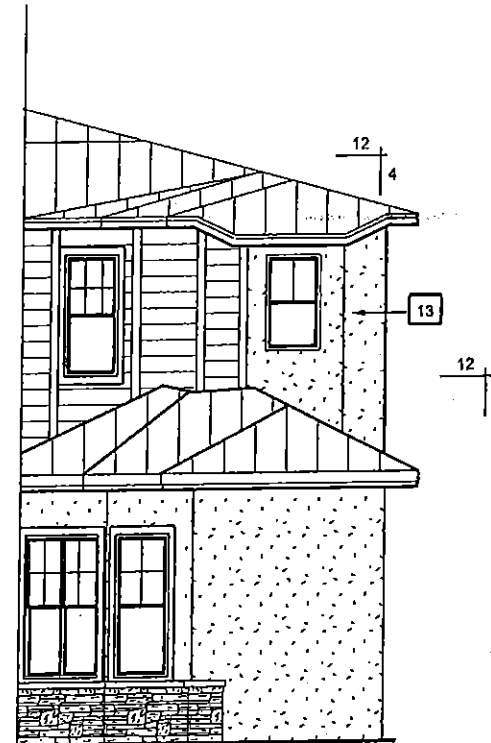

**3  
5 EAST ELEVATION**

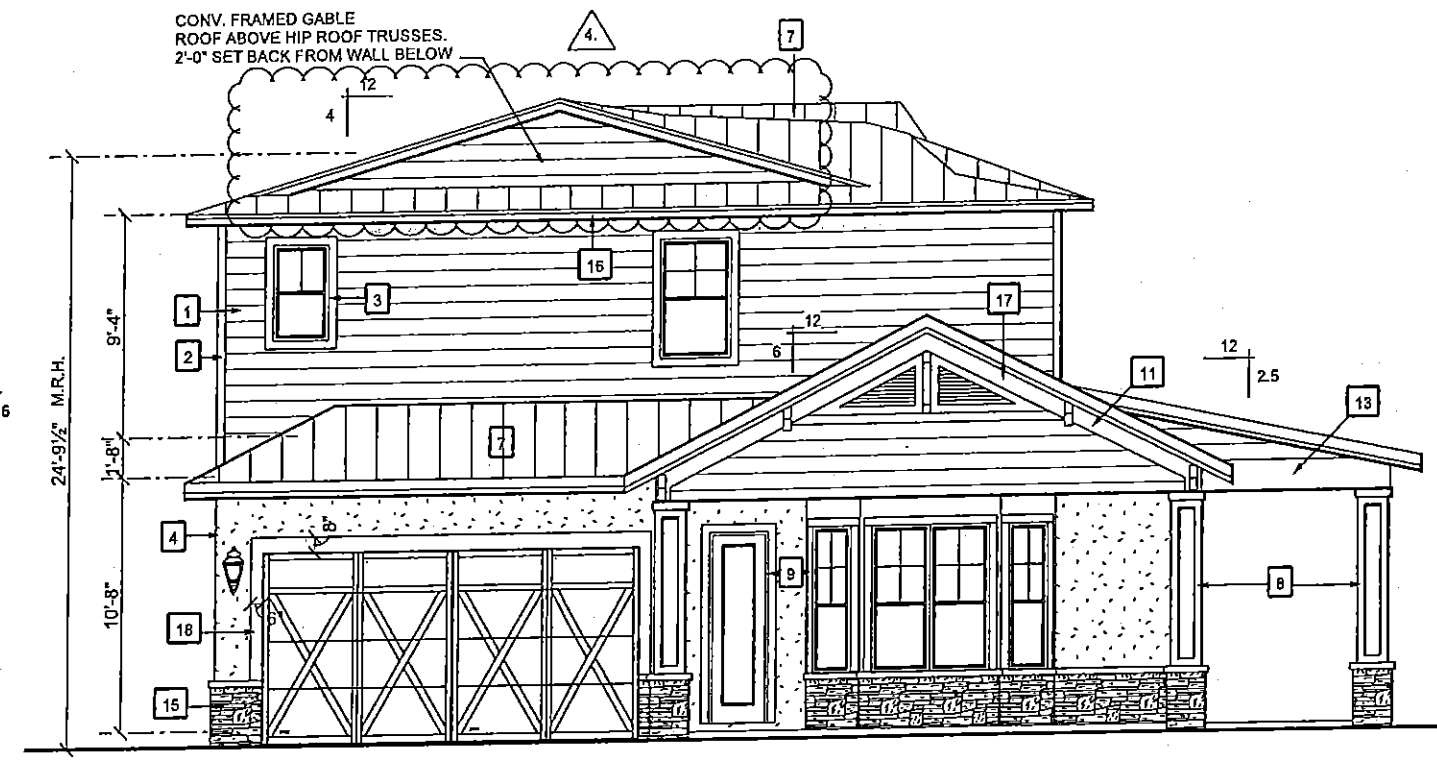

**1  
5 JESSIE AVE. ELEVATION**

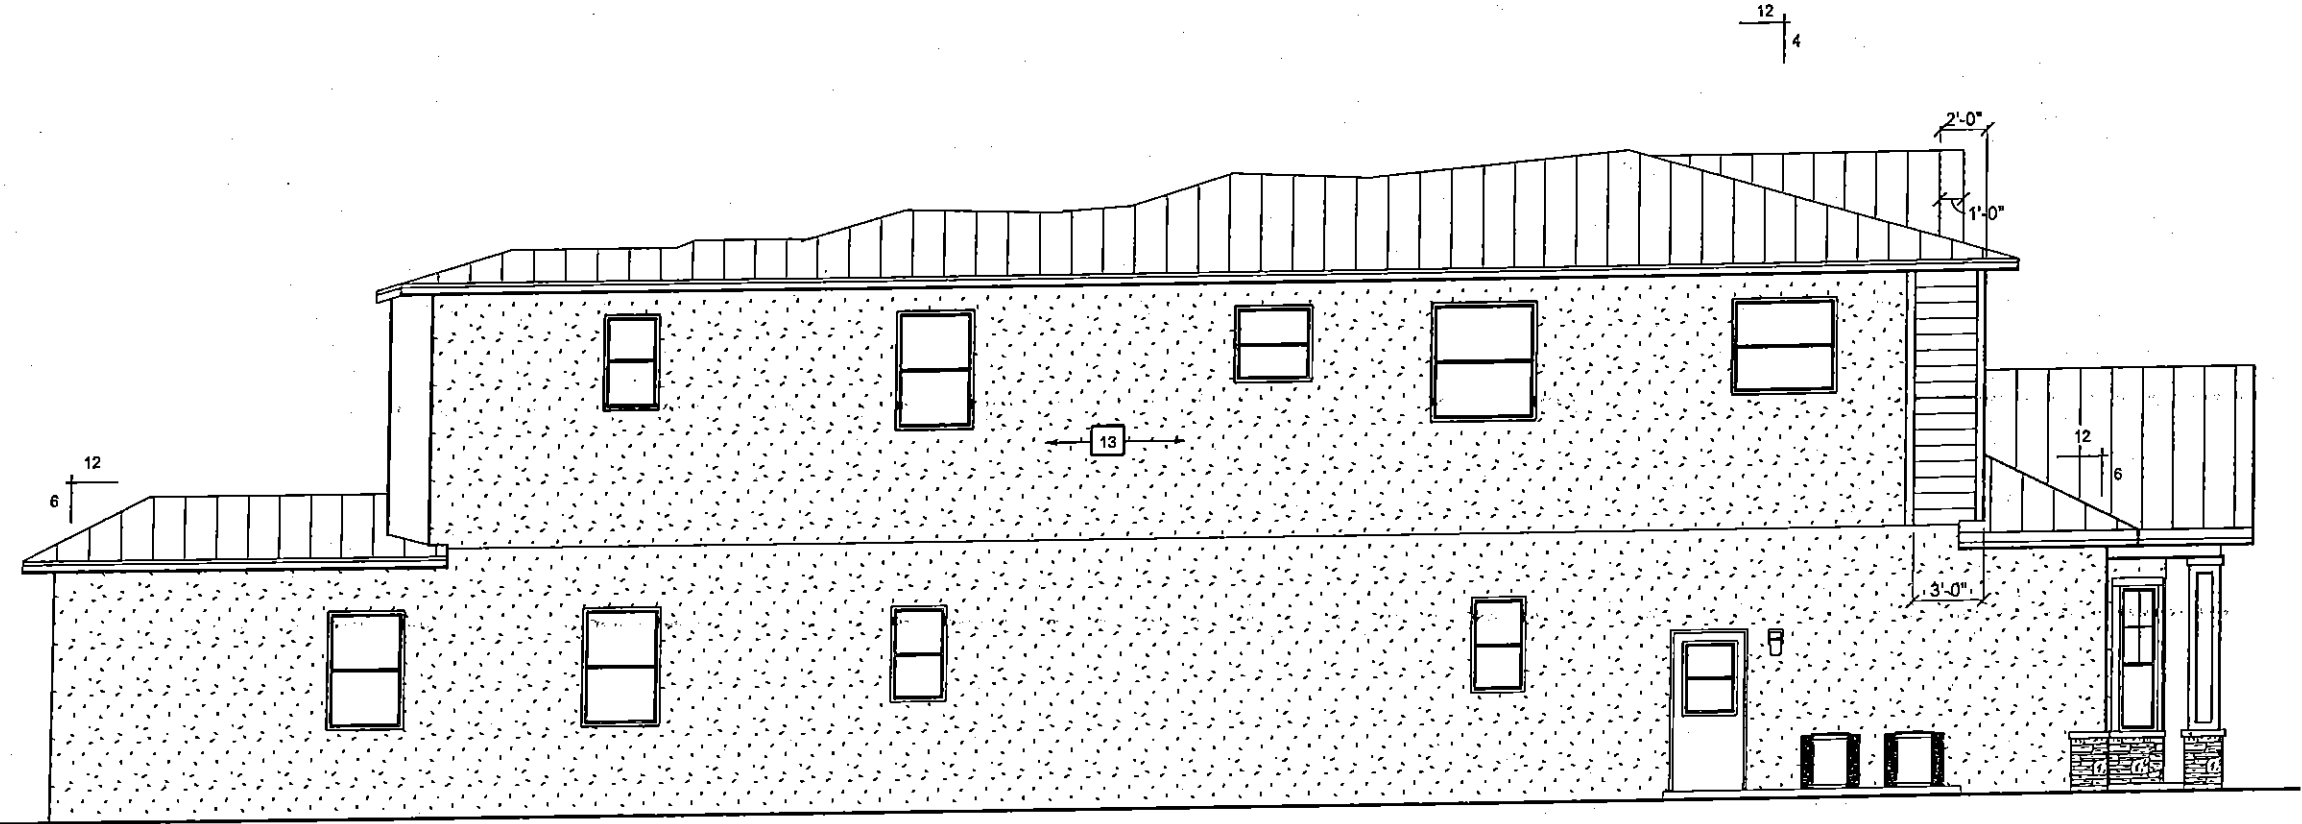

**2  
5 NORTH ELEVATION**

PLAN 3035

SCALE 1/8" = 1'-0"

EXTERIOR ELEVATIONS

LOT 22 HAMILTON AVE  
SAFETY HARBOR

PLAN DATE
1. 12-05-2018
2. 12-11-2018
3. 12-27-2018
4. 02-01-2019

- 1. PRELIMINARY PLANS (VERSION 8)
- 2. STRUCTURAL ENG. REVIEW (VERSION 8)
- 3. BAY WINDOW DETAIL UPDATES (VERSION 8)
- 4. BAY WINDOW/WINDOW/ROOF ADDITION

DEEB FAMILY  
HOMES, LTD.  
9400 RIVER CROSSING BLD.  
NEW PORT RICHEY, FL. 34655

**5**




TOTAL AREA TO BE VENTILATED = 2664 S.F.  
 2664/300 = 8.88 S.F OR 1278 SQUARE INCHES.

ROOF VENTS ARE RATED AT 36 SQUARE INCHES OF OPENING PER LINEAL FT.  
 1278 S.I. / 36 S.I. = 36 LINEAL FEET REQUIRED.

INSTALLATION FOR THIS ROOF IS (9) - 4 FOOT VENTS,  
 TOTALING 36 LINEAL FEET.

TOTAL NET FREE VENTILATING AREA SHALL NOT BE  
 LESS THAN 1 TO 300 PROVIDED THAT AT LEAST 50%  
 AND NOT MORE THAN 80% IS PROVIDED BY VENTILATORS  
 LOCATED IN THE UPPER PORTION OF THE SPACE TO BE  
 VENTILATED PER SECT. R806.2...

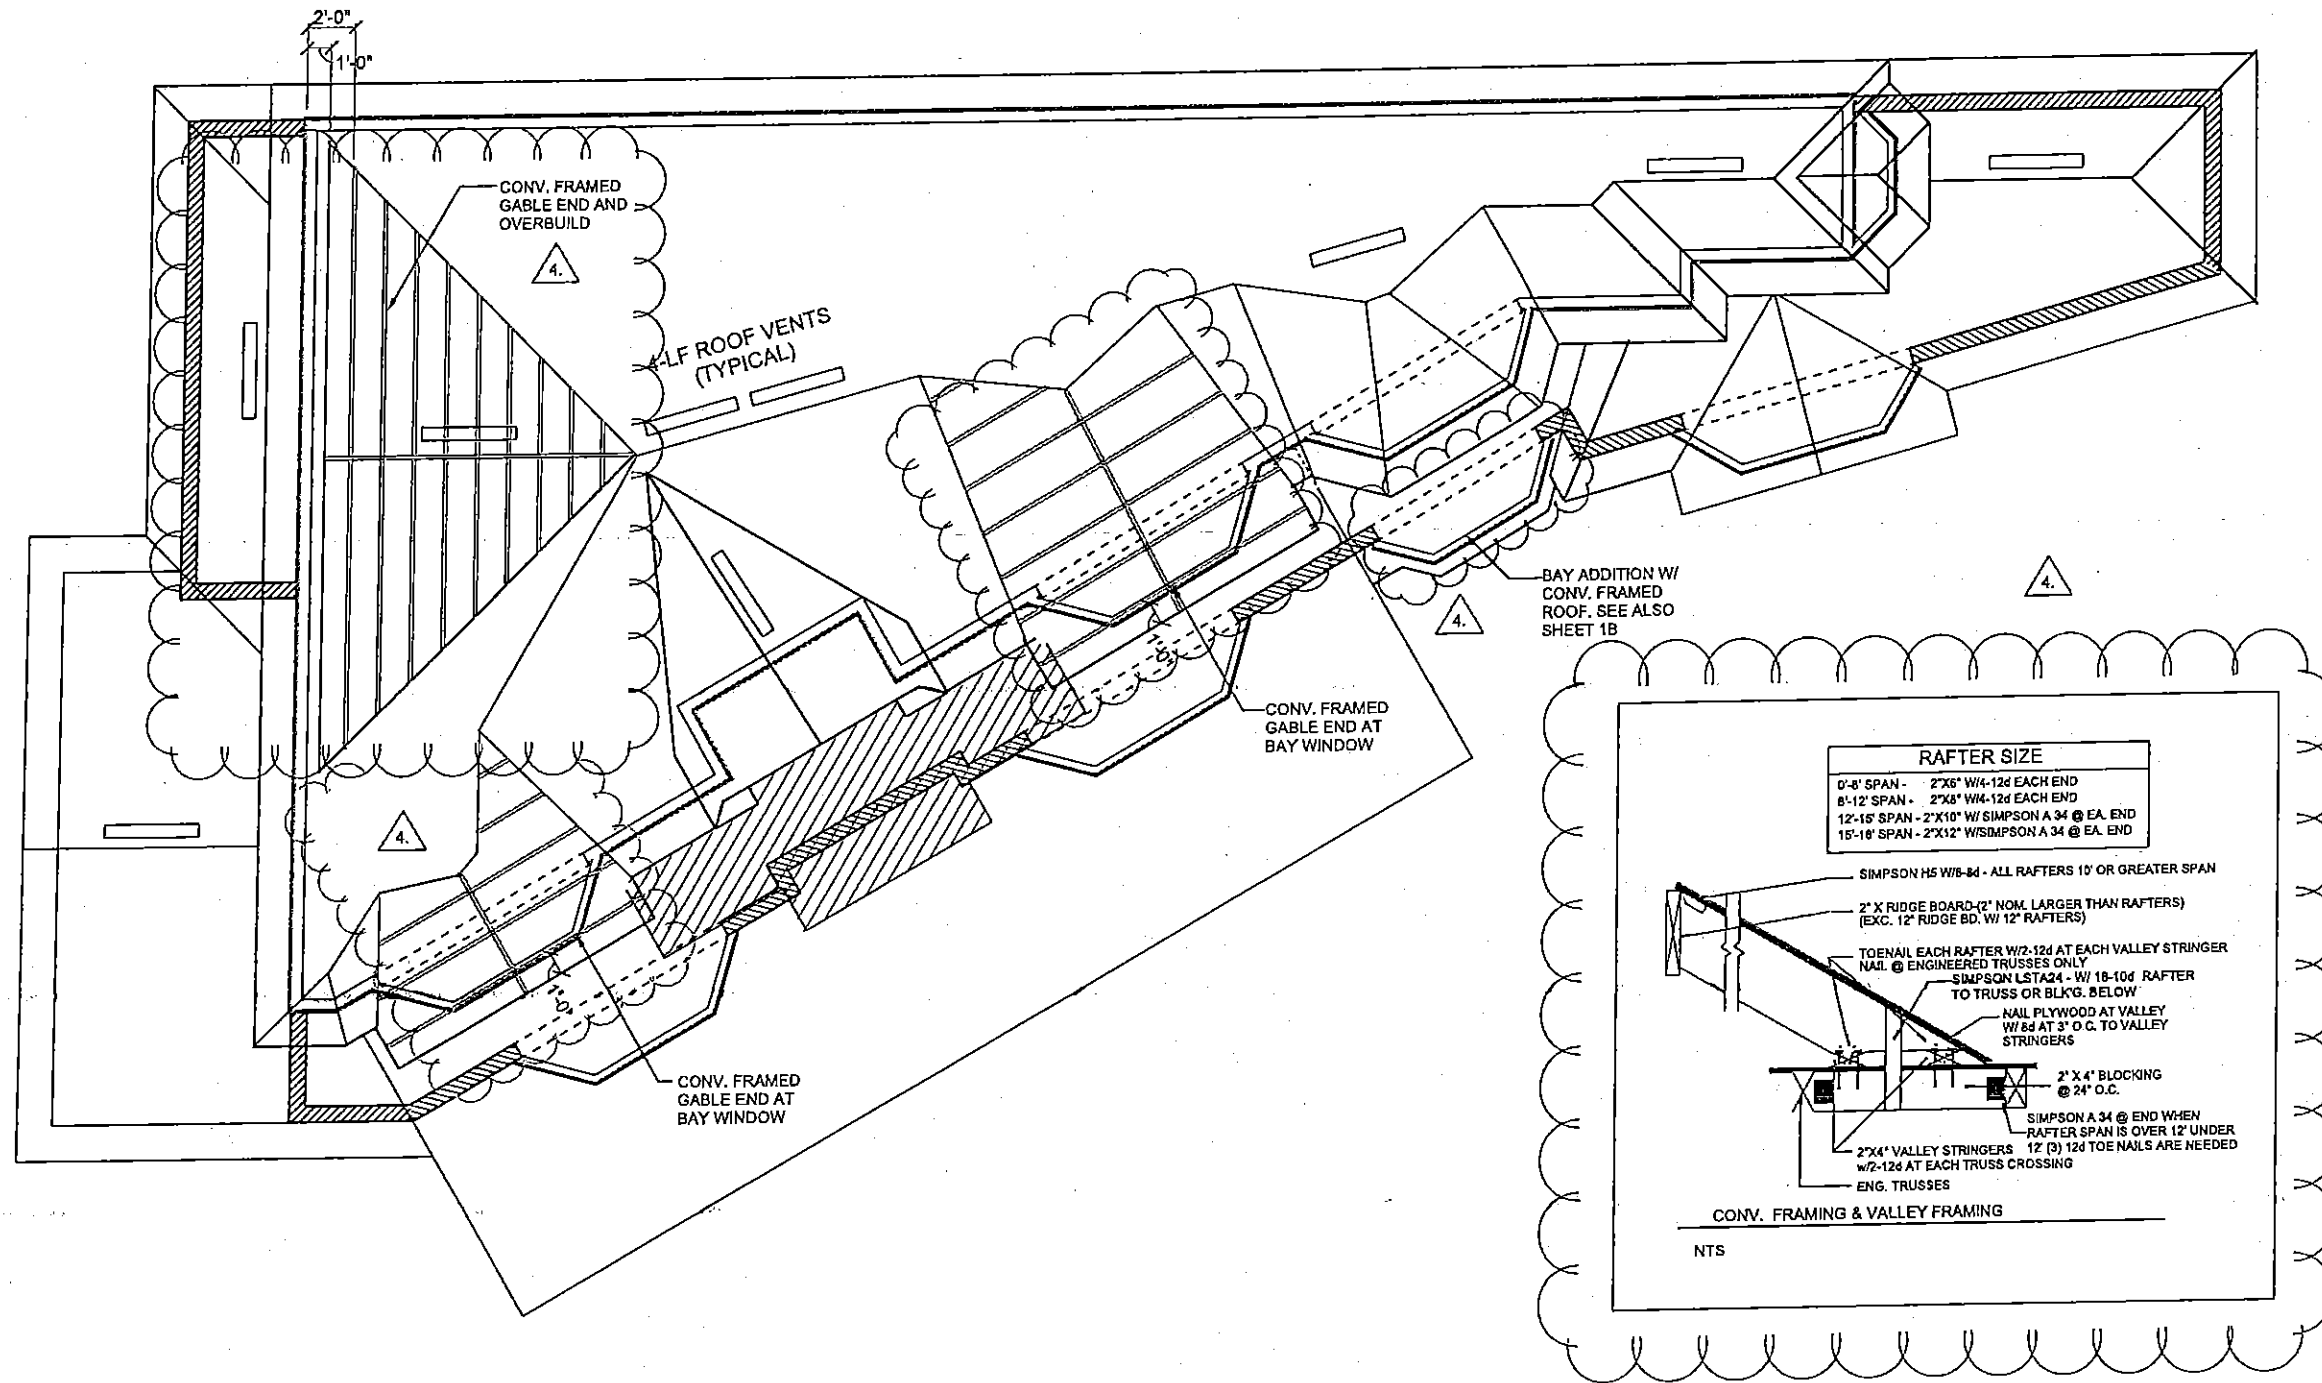

**ROOF PLAN**

SCALE 1/8" = 1'-0"

A.E.C.S. #18040

PLAN 3035

**6**

**DEEB FAMILY HOMES, LTD.**  
 9400 RIVER CROSSING BLD.  
 NEW PORT RICHEY, FL. 34655

PLAN DATE	DESCRIPTION
1. 12-06-2018	
2. 12-11-2018	
3. 12-27-2018	
4. 02-01-2019	


LOT 22 HAMILTON SAFETY HARBOR

1. PRELIMINARY PLANS  
 2. STRUCTURAL ENG. REVIEW (VERSION 8)  
 3. BAY WINDOW DETAIL, UPDATES (VERSION 8)  
 4. BAY WINDOW/WINDOW/ROOF ADDITION

THESEY CERTIFY THAT I HAVE PERFORMED THE ATTACHED DESIGN TO COMPLY WITH ALL APPLICABLE WIND LOADS, EXPOSURE D AND IT IS IN COMPLIANCE WITH SECTION 301 OF THE 2017 FLORIDA RESIDENTIAL BUILDING CODE.

SIGNED: RICHARD E. ALLEN P.E. #56920  
 RICHARD.E.ALLEN@GMAIL.COM

**ALLEN ENGINEERING & CONSTRUCTION SERVICES**  
 RICH ALLEN PROFESSIONAL ENGINEER  
 P.E. #56920 C.A. #9542  
 8809 SKYMASTER DRIVE  
 NEW PORT RICHEY, FL. 34654  
 727-842-6100  
 richallenpe@gmail.com

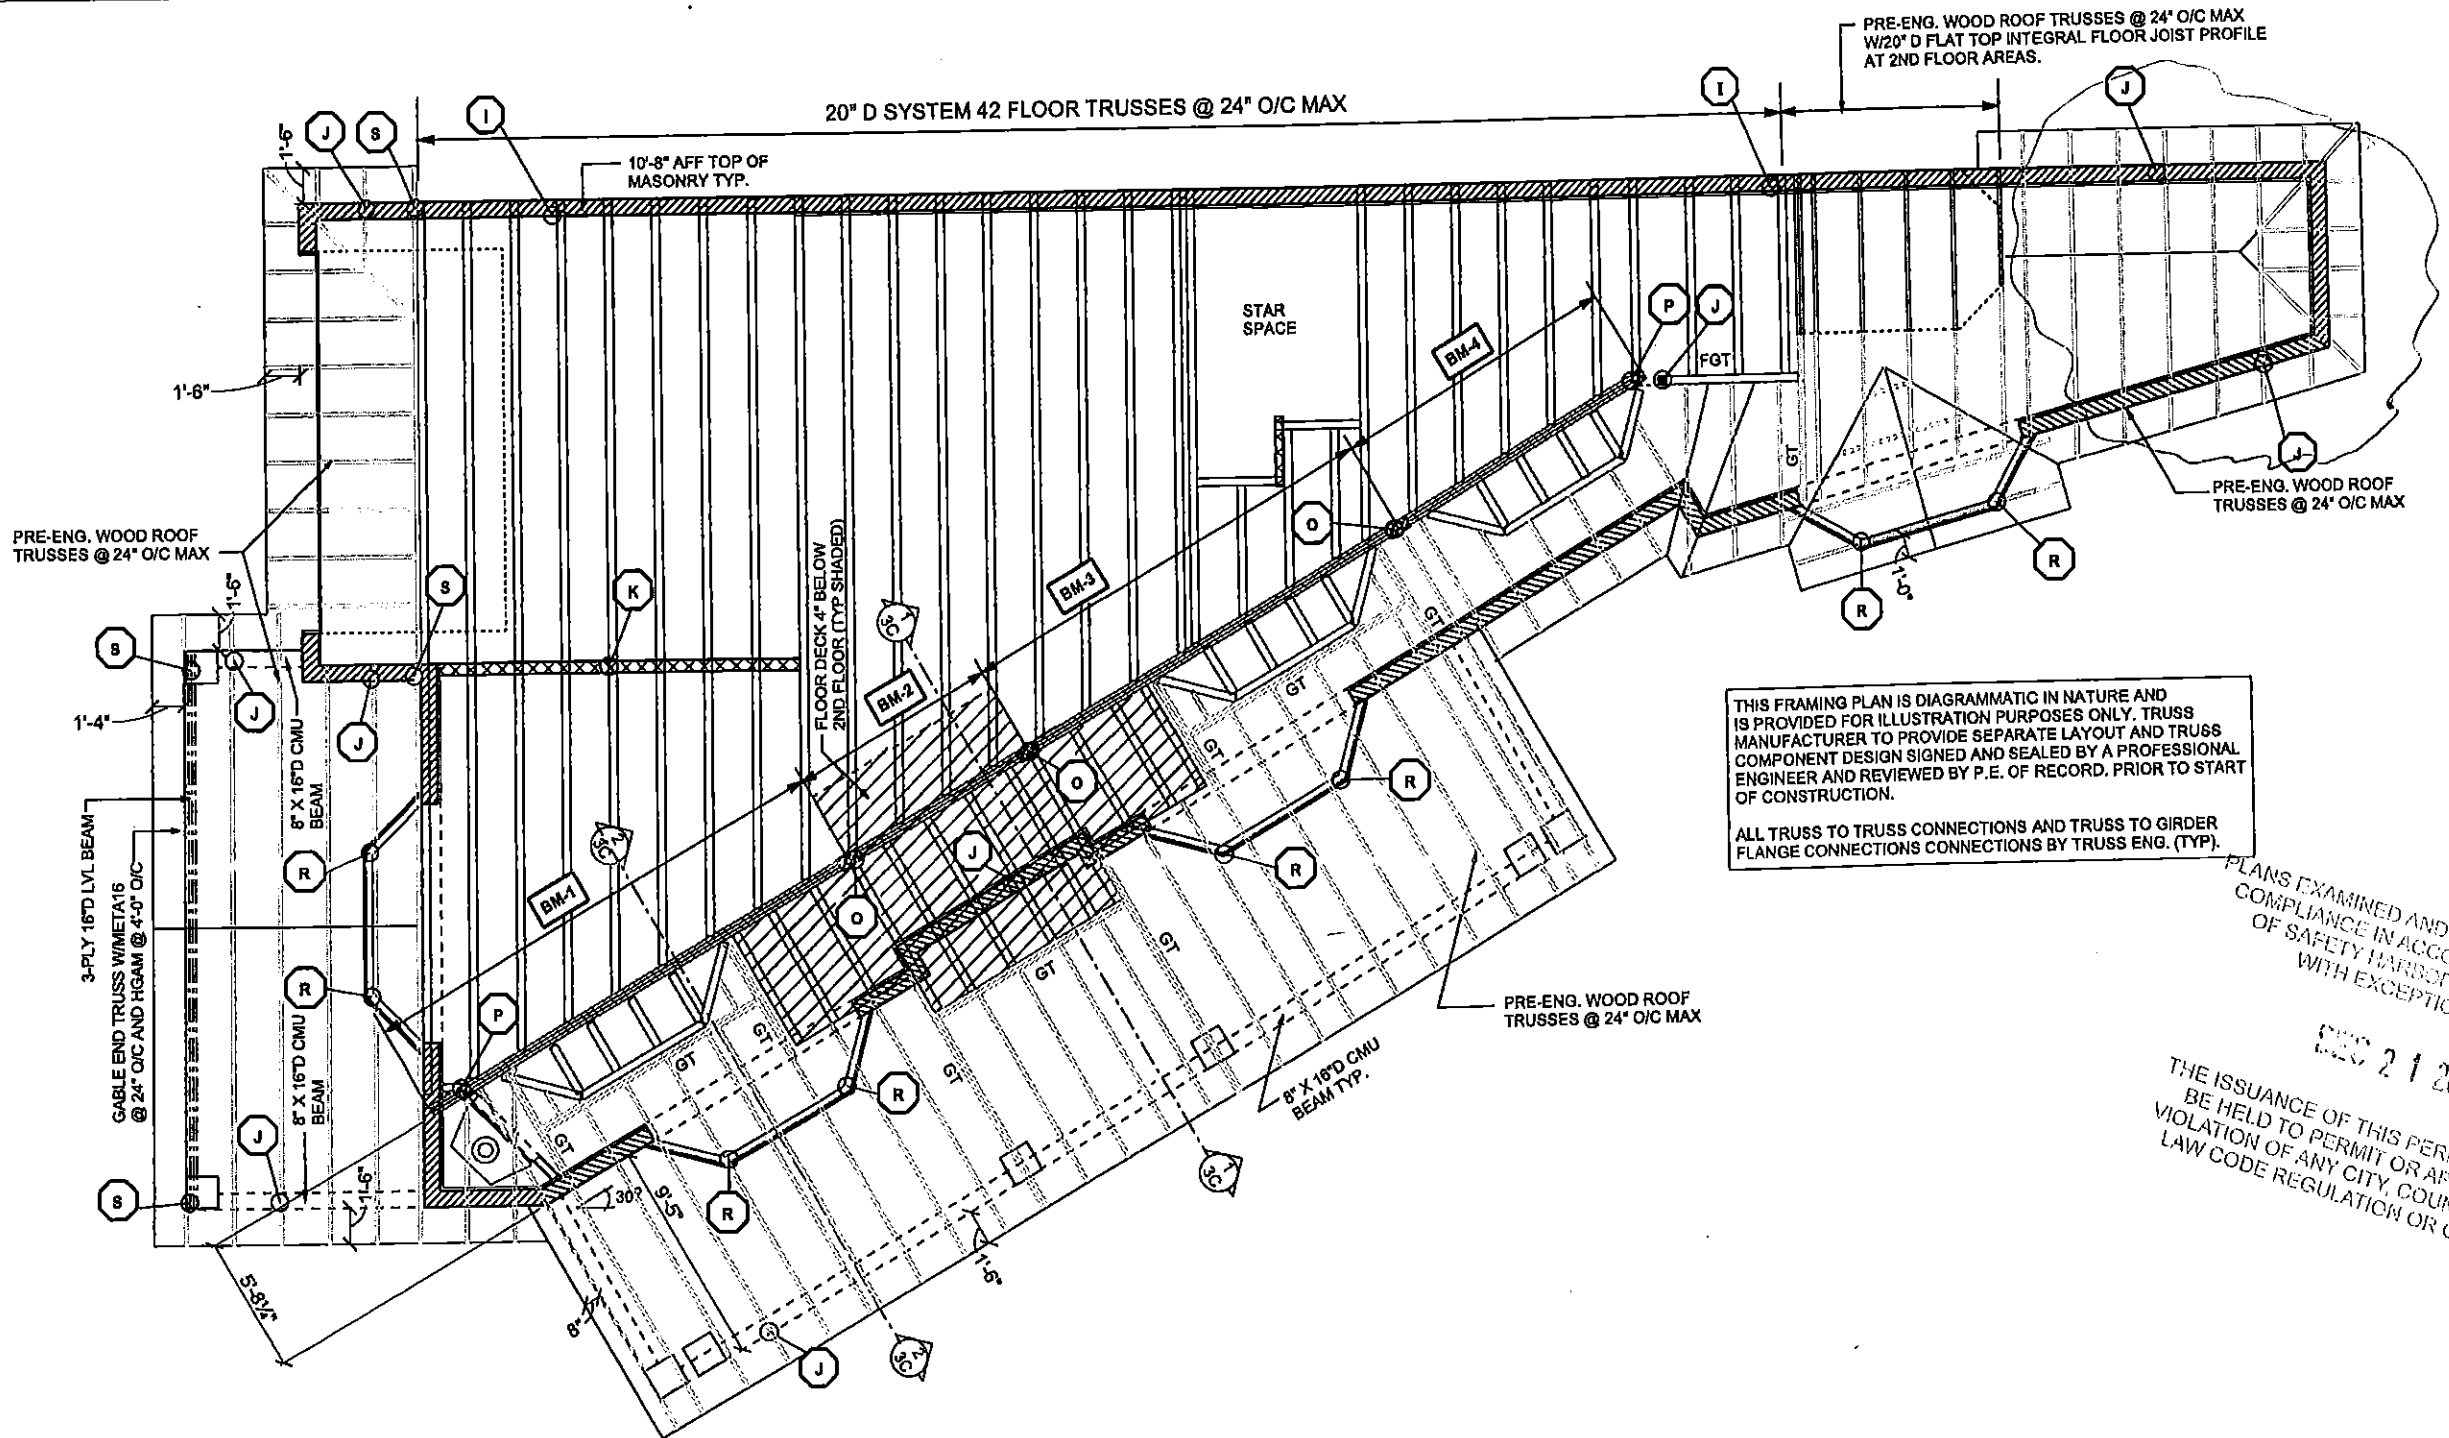

20" D SYSTEM 42 FLOOR TRUSSES @ 24" O/C MAX

PRE-ENG. WOOD ROOF TRUSSES @ 24" O/C MAX  
W/20" D FLAT TOP INTEGRAL FLOOR JOIST PROFILE  
AT 2ND FLOOR AREAS.

PRE-ENG. WOOD ROOF TRUSSES @ 24" O/C MAX

3-PLY 16"D LVL BEAM  
GABLE END TRUSS W/META16  
@ 24" O/C AND HGAM @ 4'-0" O/C

8" X 16"D CMU BEAM

FLOOR DECK 4" BELOW  
2ND FLOOR (TYP. SHADED)

PRE-ENG. WOOD ROOF TRUSSES @ 24" O/C MAX

8" X 16"D CMU BEAM TYP.

THIS FRAMING PLAN IS DIAGRAMMATIC IN NATURE AND IS PROVIDED FOR ILLUSTRATION PURPOSES ONLY. TRUSS MANUFACTURER TO PROVIDE SEPARATE LAYOUT AND TRUSS COMPONENT DESIGN SIGNED AND SEALED BY A PROFESSIONAL ENGINEER AND REVIEWED BY P.E. OF RECORD, PRIOR TO START OF CONSTRUCTION.

ALL TRUSS TO TRUSS CONNECTIONS AND TRUSS TO GIRDER FLANGE CONNECTIONS CONNECTIONS BY TRUSS ENG. (TYP).

PLANS EXAMINED AND REVIEWED FOR COMPLIANCE IN ACCORDANCE WITH CITY OF SAFETY HARBOR BUILDING CODE WITH EXCEPTIONS NOTED

DEC 21 2018

THE ISSUANCE OF THIS PERMIT SHALL NOT BE HELD TO PERMIT OR APPROVE THE VIOLATION OF ANY CITY, COUNTY OR STATE LAW CODE REGULATION OR ORDINANCE

SEE SHEET 8C FOR KEYNOTES

- BM-1 3-PLY 20"D LVL UPSET BEAM
- BM-2 3-PLY 16" D LVL UPSET BEAM
- BM-3 3-PLY 16"D LVL UPSET BEAM
- BM-4 3-PLY 16"D LVL UPSET BEAM

2ND FLOOR FRAMING

SCALE 1/8" = 1'-0"

A.E.C.S. #18040

PLAN 3020

DEEB FAMILY  
HOMES, LTD.  
9400 RIVER CROSSING BLD.  
NEW PORT RICHEY, FL. 34655

LOT 22 HAMILTON  
SAFETY HARBOR


I HEREBY CERTIFY THAT I HAVE PERFORMED THE ATTACHED DESIGN TO COMPLY WITH ALL APPLICABLE WIND LOADS, EGRESS AND ALL OTHER REQUIREMENTS OF THE BUILDING CODE. THIS DESIGN IS FOR STRUCTURE ONLY. SIGNED AND SEALED BY: [Signature]

ALLEN ENGINEERING & CONSTRUCTION SERVICES  
RICH ALLEN PROFESSIONAL ENGINEER  
P.E. #56920 C.A. #9542  
8809 SCYMASTER DRIVE  
NEW PORT RICHEY, FL. 34654  
727-842-6100  
richallenpe@gmail.com

6A

PLAN DATE
1. 12-06-2018
2. 12-11-2018

- 1. PRELIMINARY PLANS
- 2. STRUCTURAL ENG. REVIEW (VERSION 9)

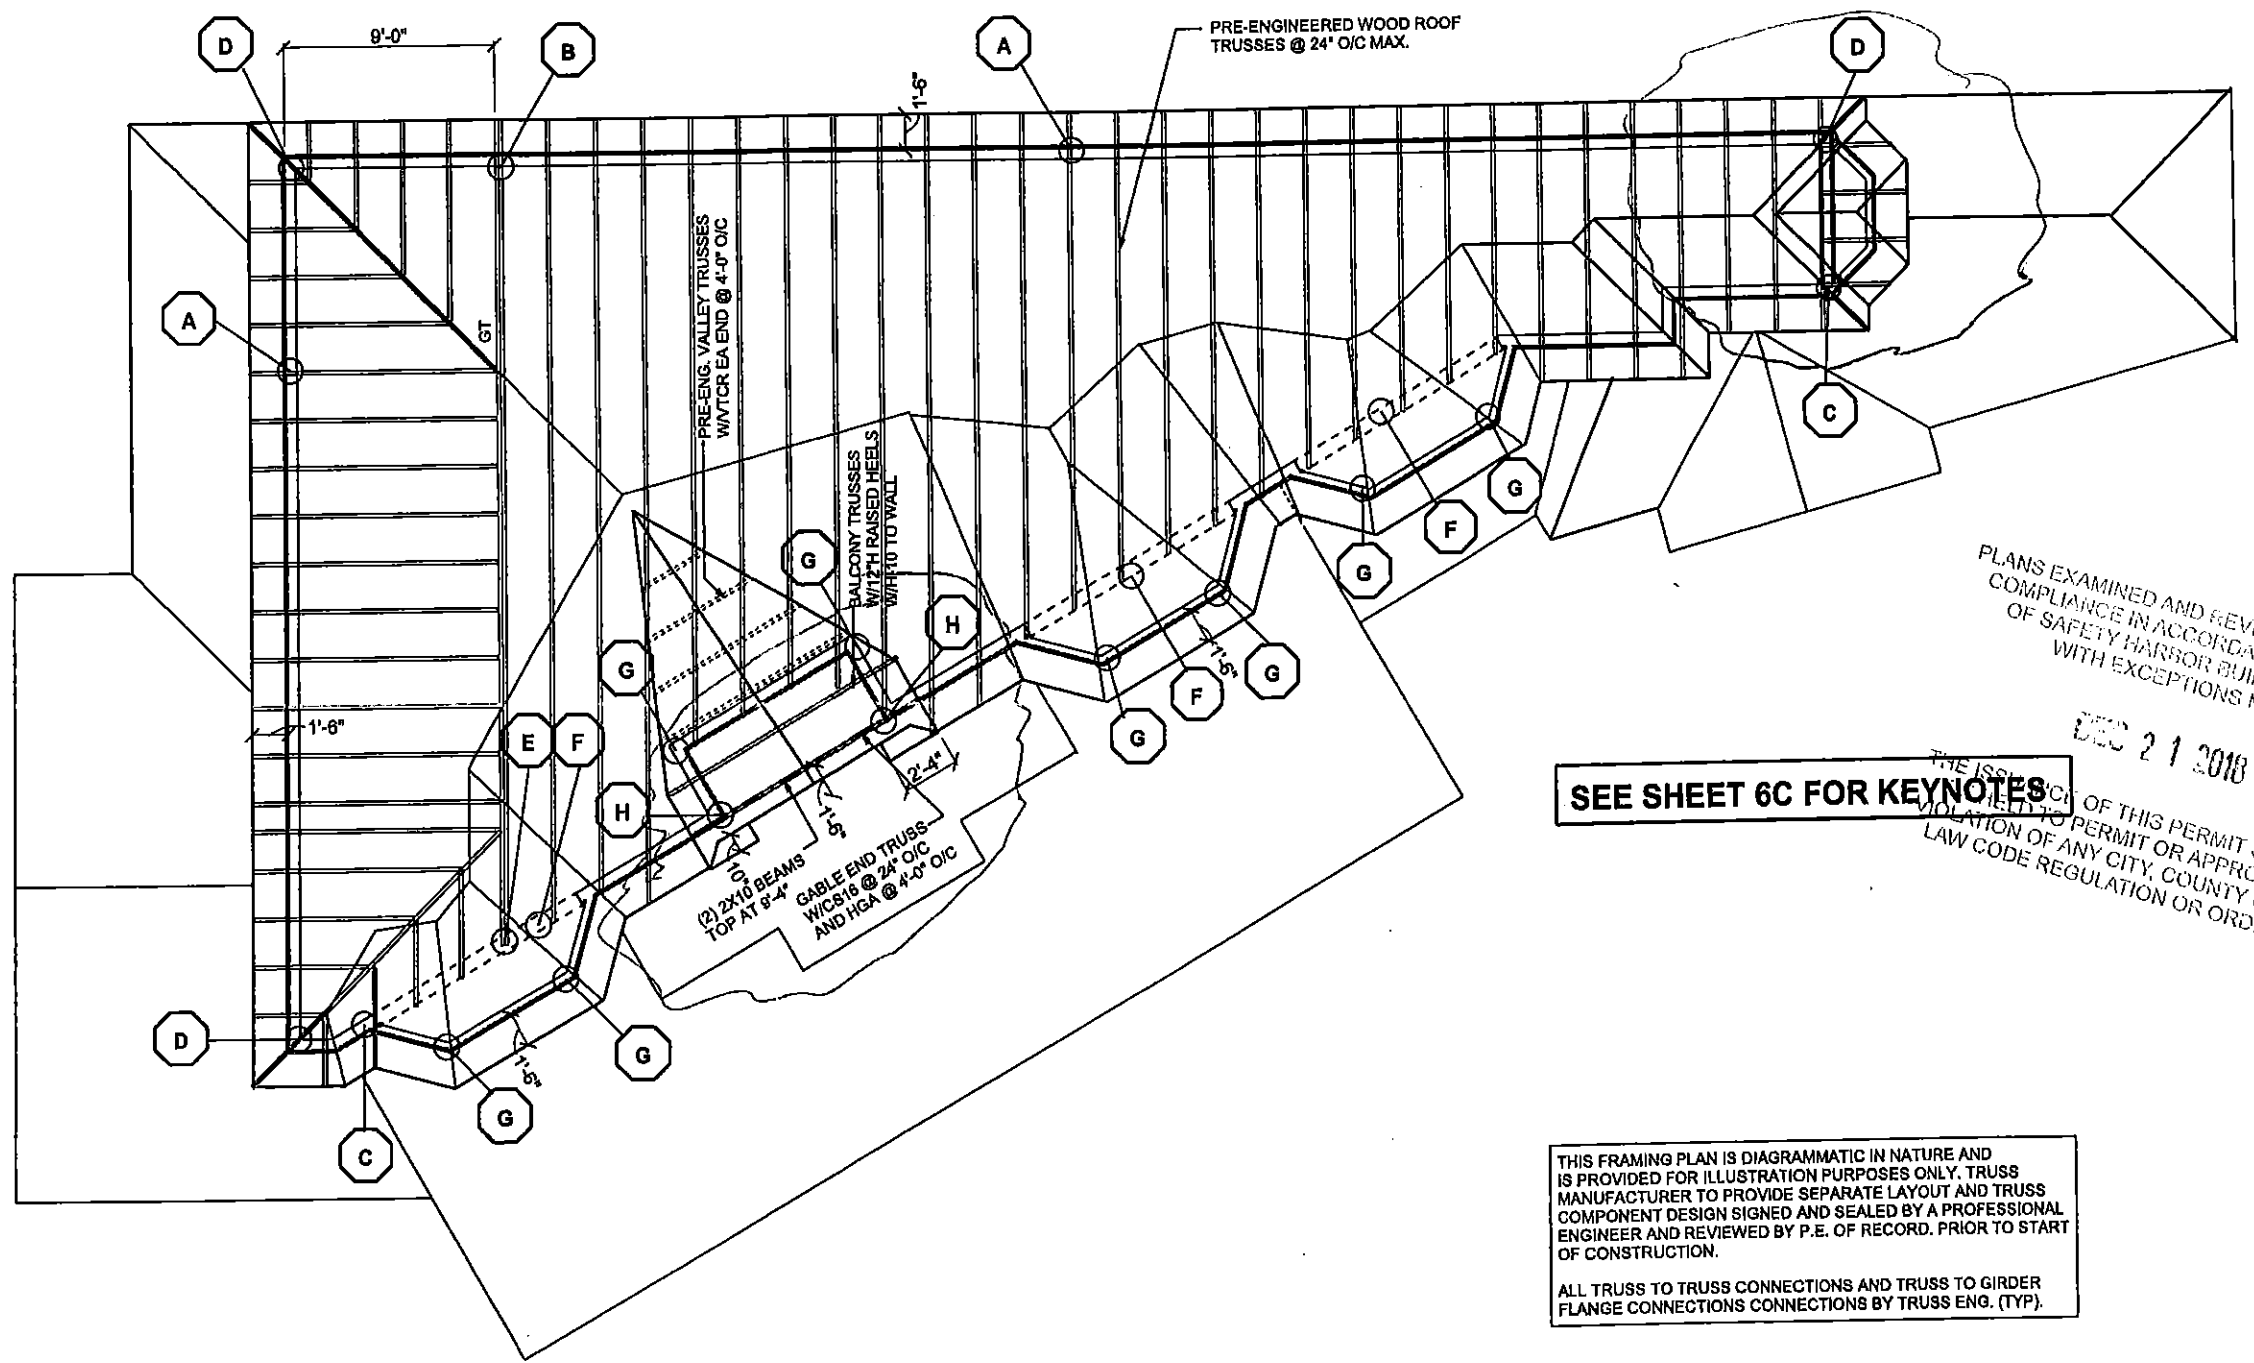

**SEE SHEET 6C FOR KEYNOTES**

THIS FRAMING PLAN IS DIAGRAMMATIC IN NATURE AND IS PROVIDED FOR ILLUSTRATION PURPOSES ONLY. TRUSS MANUFACTURER TO PROVIDE SEPARATE LAYOUT AND TRUSS COMPONENT DESIGN SIGNED AND SEALED BY A PROFESSIONAL ENGINEER AND REVIEWED BY P.E. OF RECORD. PRIOR TO START OF CONSTRUCTION.

ALL TRUSS TO TRUSS CONNECTIONS AND TRUSS TO GIRDER FLANGE CONNECTIONS CONNECTIONS BY TRUSS ENG. (TYP).

PLANS EXAMINED AND REVIEWED FOR COMPLIANCE IN ACCORDANCE WITH CITY OF SAFETY HARBOR BUILDING CODE WITH EXCEPTIONS NOTED

DEC 21 2018

**2ND ROOF TRUSSES**

A.E.C.S. #18040

PLAN 3020

**6B**

**DEEB FAMILY HOMES, LTD.**  
 9400 RIVER CROSSING BLD.  
 NEW PORT RICHEY, FL. 34655

PLAN DATE
1. 12-06-2018
2. 12-11-2018

LOT 22 HAMILTON SAFETY HARBOR

1. PRELIMINARY PLANS  
 2. STRUCTURAL ENG. REVIEW (VERSION 8)

THEIRY CERTIFY THAT HAVE PERFORMED THE ATTACHED DESIGN TO COMPLY WITH ALL APPLICABLE CODES AND IT IS IN COMPLIANCE WITH SECTION 901 OF THE 2017 FLORIDA RESIDENTIAL BUILDING CODE. THIS PLAN IS FOR THE USE OF THE BUILDING CODE OFFICIALS ONLY. SIGNED AND SEALED BY: RICHIE ALLEN, P.E. #56920

**ALLEN ENGINEERING & CONSTRUCTION SERVICES**  
 RICE ALLEN PROFESSIONAL ENGINEER  
 P.E. #56920 C.A. #9542  
 8309 SKYMASTER DRIVE  
 NEW PORT RICHEY, FL. 34654  
 727-842-6100  
 rchallenge@gmail.com

**LOT 22 Hamilton Ave**

- A. H-10 Typical pre engineered truss to dbl top plate
- B. Girder truss to window header beam.
  - a. LGT2 & HTS16 to header
  - b. Header - Triple 2 x12 w/(2) 1/2" flitch plates.
  - c. (2) jacks and (2) king studs each stud pack.
  - d. (2) CS16 each stud pack to header
  - e. (1) MSTCM60 each stud pack to header.
- C. 5-stud corner column with (3) CS16 to floor truss or beam below.
- D. 5 stud corner column with (1) MSTCM60 to cmu below.
- E. (2) HTS16 Girder to beam
- F. 3 ply 1.75" x 12" LVL header
  - a. (2) CS16 each end to column
  - b. 3.5" X 5.25" Versa Lam columns with (2) CS16 to truss below.
- G. 3 stud corner column with CS16 to floor truss below.
- H. 5 stud corner column
  - a. (2) CS16 to beam above and (3) CS16 to truss or beam below.
- I. META24 typical.
- J. META16 typical.
- K. H6 typical.
- L. 2x4 SYP #2 @ 12" O/C with SP2 top plates, SP1 bottom plate and 1/2" anchor bolt at 48" O/C.
- M. 2x4 SYP #2 @16" O/C with SP2 top plates, SP1 bottom plate and 1/2" anchor bolt at 48" O/C.
- O. (2) 5.25" X 5.25" Versa Lam columns - 1 for each beam
  - a. Beam to column - ECCQ7.1-6SDS2.5 Verify size w/beam design.
  - b. Columns to foundation - HDU8 with 1/4" steel plate under columns
  - c. Beam to beam - (2) MSTC66
- P. (1) 5.25" X 5.25" Versa Lam columns
  - a. Beam to column - ECCQ7.1 - 6SDS2.5. Verify size W/beam design
  - c. Columns to foundation - HDU8 with 1/4" steel plate under columns.

- d. Beam to girder - (4) CS16 to top and bottom chords.
- Q. 3.5" X 3.5" Versa Lam column
  - a. Girder to column - (2) CS16
  - b. Columns to foundation - HTT4 with 1/4" steel plate under columns.
- R. 3-stud corner column with LTT20B to foundation. W/dbl 2x12 Header W/CS16 header to stud packs.
- S. HTT5
- T. 3.5" X 3.5" Versa Lam column W/HTT5 to foundation W/(2) CS16 to girder truss.

PLANS EXAMINED AND REVIEWED FOR CODE COMPLIANCE IN ACCORDANCE WITH CITY OF SAFETY HARBOR BUILDING CODE WITH EXCEPTIONS NOTED

DEC 21 2018

THE ISSUANCE OF THIS PERMIT SHALL NOT BE HELD TO PERMIT OR APPROVE THE VIOLATION OF ANY CITY, COUNTY OR STATE LAW CODE REGULATION OR ORDINANCE

PLAN 3020

A.E.C.S. #18040

SCALE 1/8" = 1'-0"

**ALLEN ENGINEERING & CONSTRUCTION SERVICES**  
 RICH ALLEN PROFESSIONAL ENGINEER  
 P.E. #56970 C.A. #9542  
 8809 SKYMASTER DRIVE  
 NEW PORT RICHEY, FL 34654  
 727-842-6100  
 richallenpe@gmail.com

I HEREBY CERTIFY THAT I HAVE PERFORMED THE ATTACHED DESIGN TO COMPLY WITH ALL APPLICABLE CODES AND ORDINANCES AND THAT THE WORK SHOWN IS IN ACCORDANCE WITH SECTION 901 OF THE 2017 FLORIDA RESIDENTIAL BUILDING CODE. THIS SEAL IS VALID FOR STRUCTURES ONLY.  
 RICHARD E. ALLEN P.E. #56970


LOT 22 HAMILTON SAFETY HARBOR

1. PRELIMINARY PLANS  
 2. STRUCTURAL ENG. REVIEW (VERSION 9)

PLAN DATE	
1. 12-06-2018	
2. 12-11-2018	

**DEEB FAMILY HOMES, LTD.**  
 9400 RIVER CROSSING BLD.  
 NEW PORT RICHEY, FL. 34655

**6C**

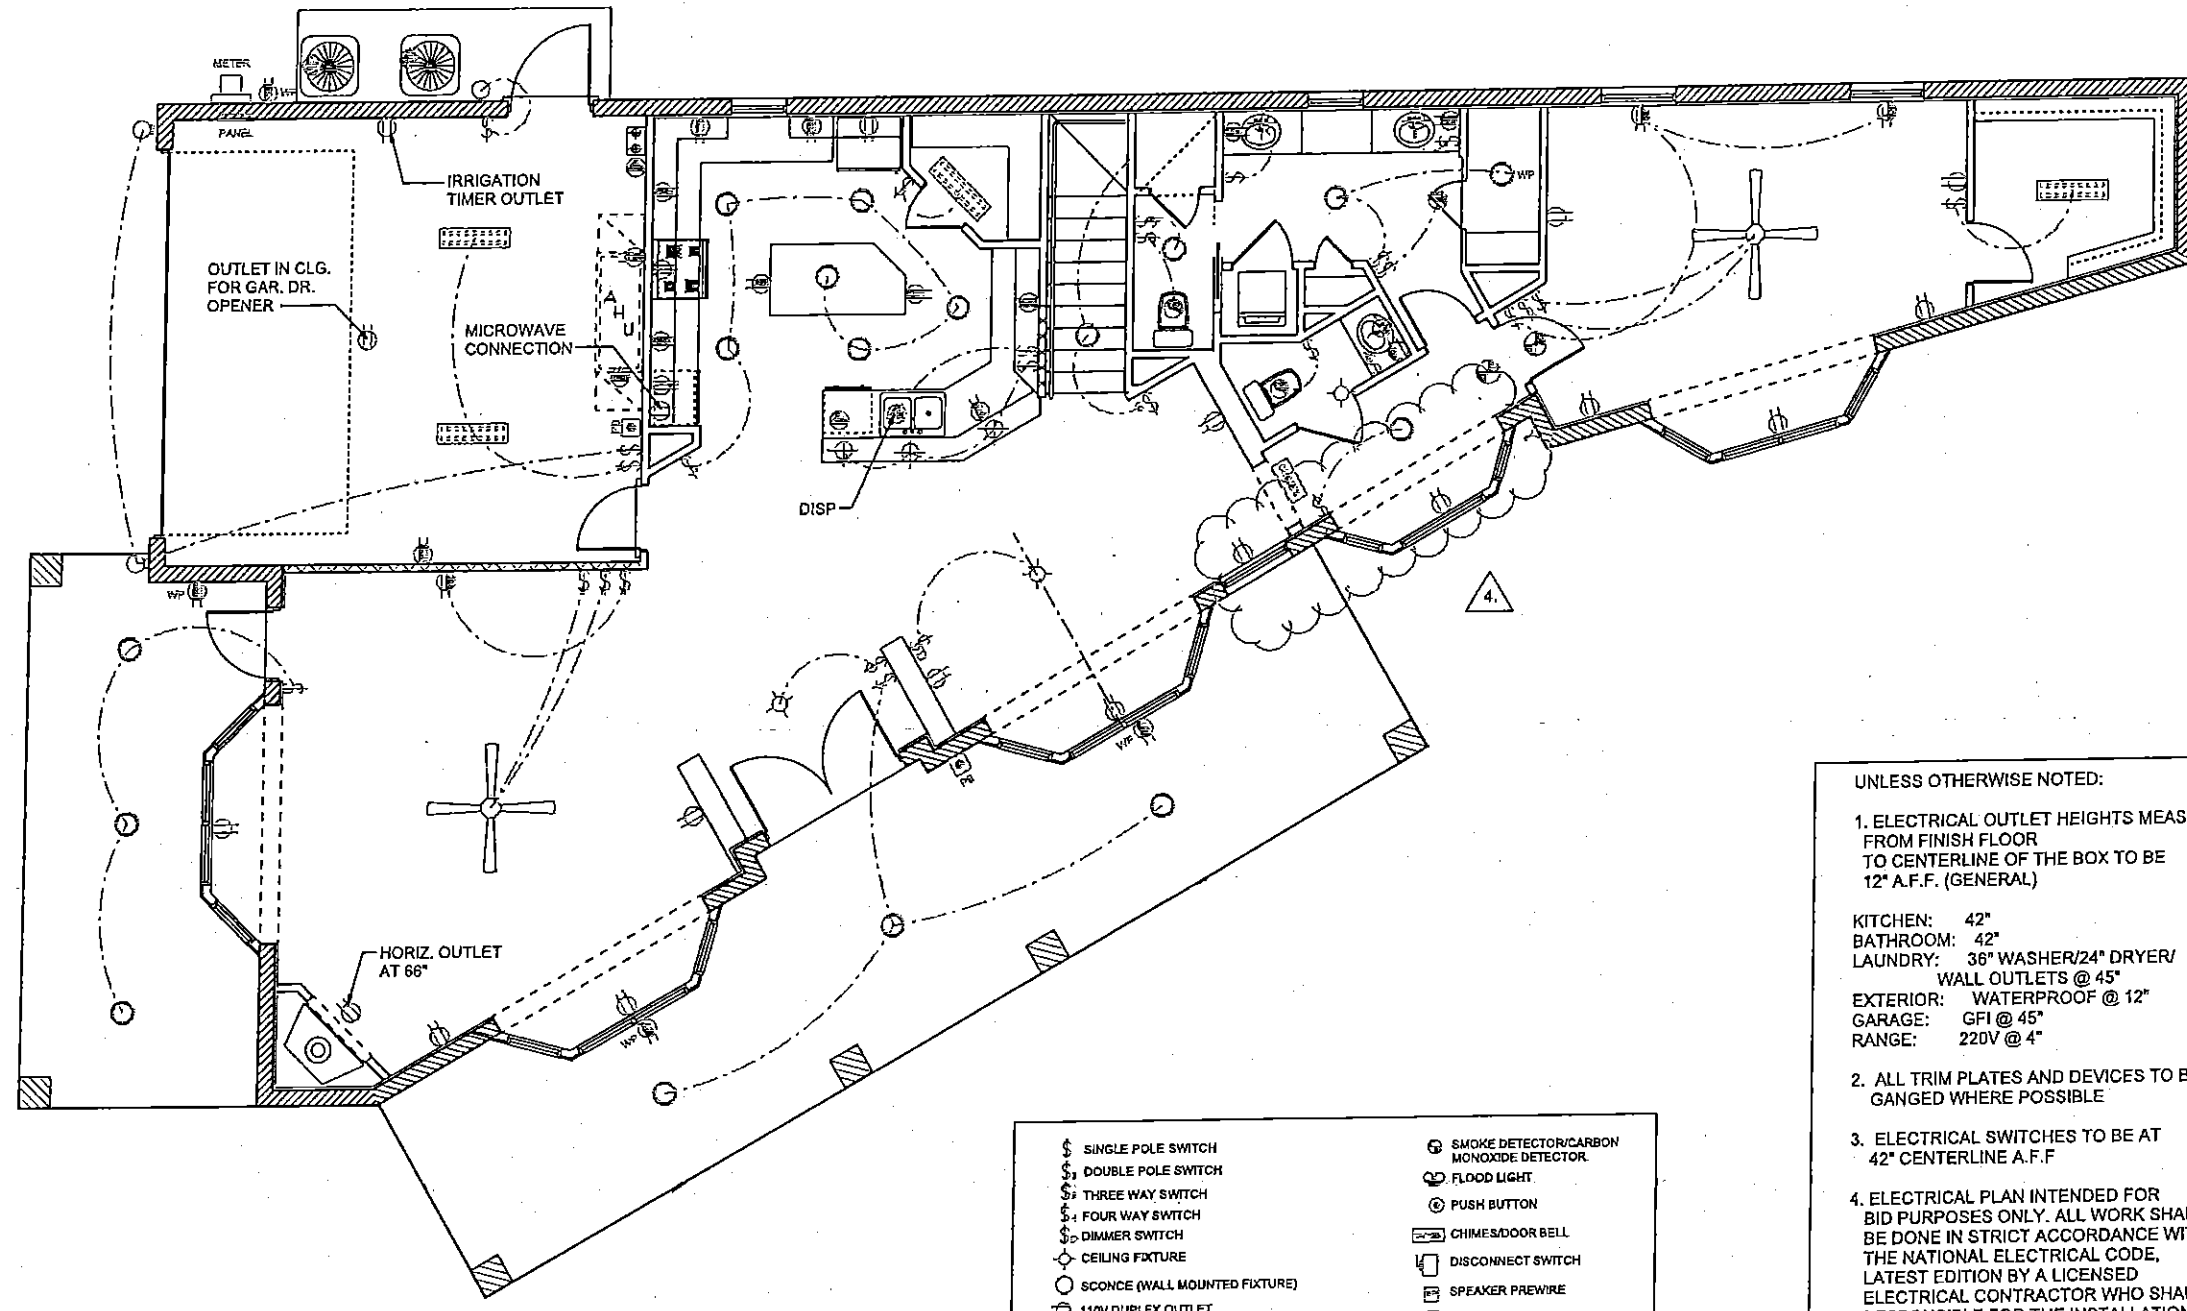

⊗ SINGLE POLE SWITCH	⊗ SMOKE DETECTOR/CARBON MONOXIDE DETECTOR
⊕ DOUBLE POLE SWITCH	⊗ FLOOD LIGHT
⊗ THREE WAY SWITCH	⊗ PUSH BUTTON
⊗ FOUR WAY SWITCH	⊗ CHIMES/DOOR BELL
⊗ DIMMER SWITCH	⊗ DISCONNECT SWITCH
⊗ CEILING FIXTURE	⊗ SPEAKER PREWIRE
⊗ SCONCE (WALL MOUNTED FIXTURE)	⊗ JUNCTION BOX
⊗ 110V DUPLEX OUTLET	⊗ THERMOSTAT
⊗ SWITCHED OUTLET (1/2)	⊗ LOW VOLTAGE LIGHTING
⊗ GROUND FAULT INTERRUPT OUTLET	⊗ INTERCOM
⊗ WATER PROOF GFI OUTLET	⊗ CEILING FAN
⊗ 220V OUTLET	⊗ TRACK LIGHTING
⊗ SPECIAL SERVICES OUTLET	⊗ FLUORESCENT LIGHTING
⊗ TV CABLE OUTLET	⊗ GAS DROP
⊗ TELEPHONE CABLE OUTLET	
⊗ RECESSED LIGHTING	
⊗ WATER PROOF RECESSED LIGHTING	
⊗ BATH FAN	
⊗ BATH FAN WITH LIGHT	

UNLESS OTHERWISE NOTED:

1. ELECTRICAL OUTLET HEIGHTS MEASURED FROM FINISH FLOOR TO CENTERLINE OF THE BOX TO BE 12" A.F.F. (GENERAL)
2. ALL TRIM PLATES AND DEVICES TO BE GANGED WHERE POSSIBLE
3. ELECTRICAL SWITCHES TO BE AT 42" CENTERLINE A.F.F
4. ELECTRICAL PLAN INTENDED FOR BID PURPOSES ONLY. ALL WORK SHALL BE DONE IN STRICT ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE, LATEST EDITION BY A LICENSED ELECTRICAL CONTRACTOR WHO SHALL BE RESPONSIBLE FOR THE INSTALLATION AND SIZING OF ALL ELECTRICAL WIRING AND ACCESSORIES.
5. SMOKE DETECTORS SHALL BE IN ACCORDANCE WITH 2017 FLORIDA RESIDENTIAL CODE, SECTION 314, AND WITH UL 217 AND NFPA 720.
6. PROVIDE ARC FAULT INTERRUPTERS PER 2014 NEC. 210.12
7. ALL RECEPTACLES TO BE TAMPER PROOF PER NEC. SECT. 406.11

KITCHEN: 42"  
 BATHROOM: 42"  
 LAUNDRY: 36" WASHER/24" DRYER/  
 WALL OUTLETS @ 45"  
 EXTERIOR: WATERPROOF @ 12"  
 GARAGE: GFI @ 45"  
 RANGE: 220V @ 4"

**ELECTRICAL PLAN**

PLAN 3035


SCALE 1/8" = 1'-0"

LOT 22 HAMILTON AVE  
 SAFETY HARBOR

PLAN DATE	1. 12-06-2018	2. 12-11-2018	3. 12-27-2018	4. 02-01-2019
-----------	---------------	---------------	---------------	---------------

DEEB FAMILY  
 HOMES, LTD.  
 9400 RIVER CROSSING BLD.  
 NEW PORT RICHEY, FL. 34655

- ⊞ SINGLE POLE SWITCH
- ⊞ DOUBLE POLE SWITCH
- ⊞ THREE WAY SWITCH
- ⊞ FOUR WAY SWITCH
- ⊞ DIMMER SWITCH
- ⊞ CEILING FIXTURE
- ⊞ BOONCE (WALL MOUNTED FIXTURE)
- ⊞ 110V DUPLEX OUTLET
- ⊞ SWITCHED OUTLET (1/2)
- ⊞ GROUND FAULT INTERRUPT OUTLET
- ⊞ WATER PROOF GFI OUTLET
- ⊞ 220V OUTLET
- ⊞ SPECIAL SERVICES OUTLET
- ⊞ TV CABLE OUTLET
- ⊞ TELEPHONE CABLE OUTLET
- ⊞ RECESSED LIGHTING
- ⊞ WATER PROOF RECESSED LIGHTING
- ⊞ BATH FAN
- ⊞ BATH FAN WITH LIGHT
- ⊞ SMOKE DETECTOR/CARBON MONOXIDE DETECTOR
- ⊞ FLOOD LIGHT
- ⊞ PUSH BUTTON
- ⊞ CHIMES/DOOR BELL
- ⊞ DISCONNECT SWITCH
- ⊞ SPEAKER PREWIRE
- ⊞ JUNCTION BOX
- ⊞ THERMOSTAT
- ⊞ LOW VOLTAGE LIGHTING
- ⊞ INTERCOM
- ⊞ CEILING FAN
- ⊞ TRACK LIGHTING
- ⊞ FLUORESCENT LIGHTING
- ⊞ GAS DROP

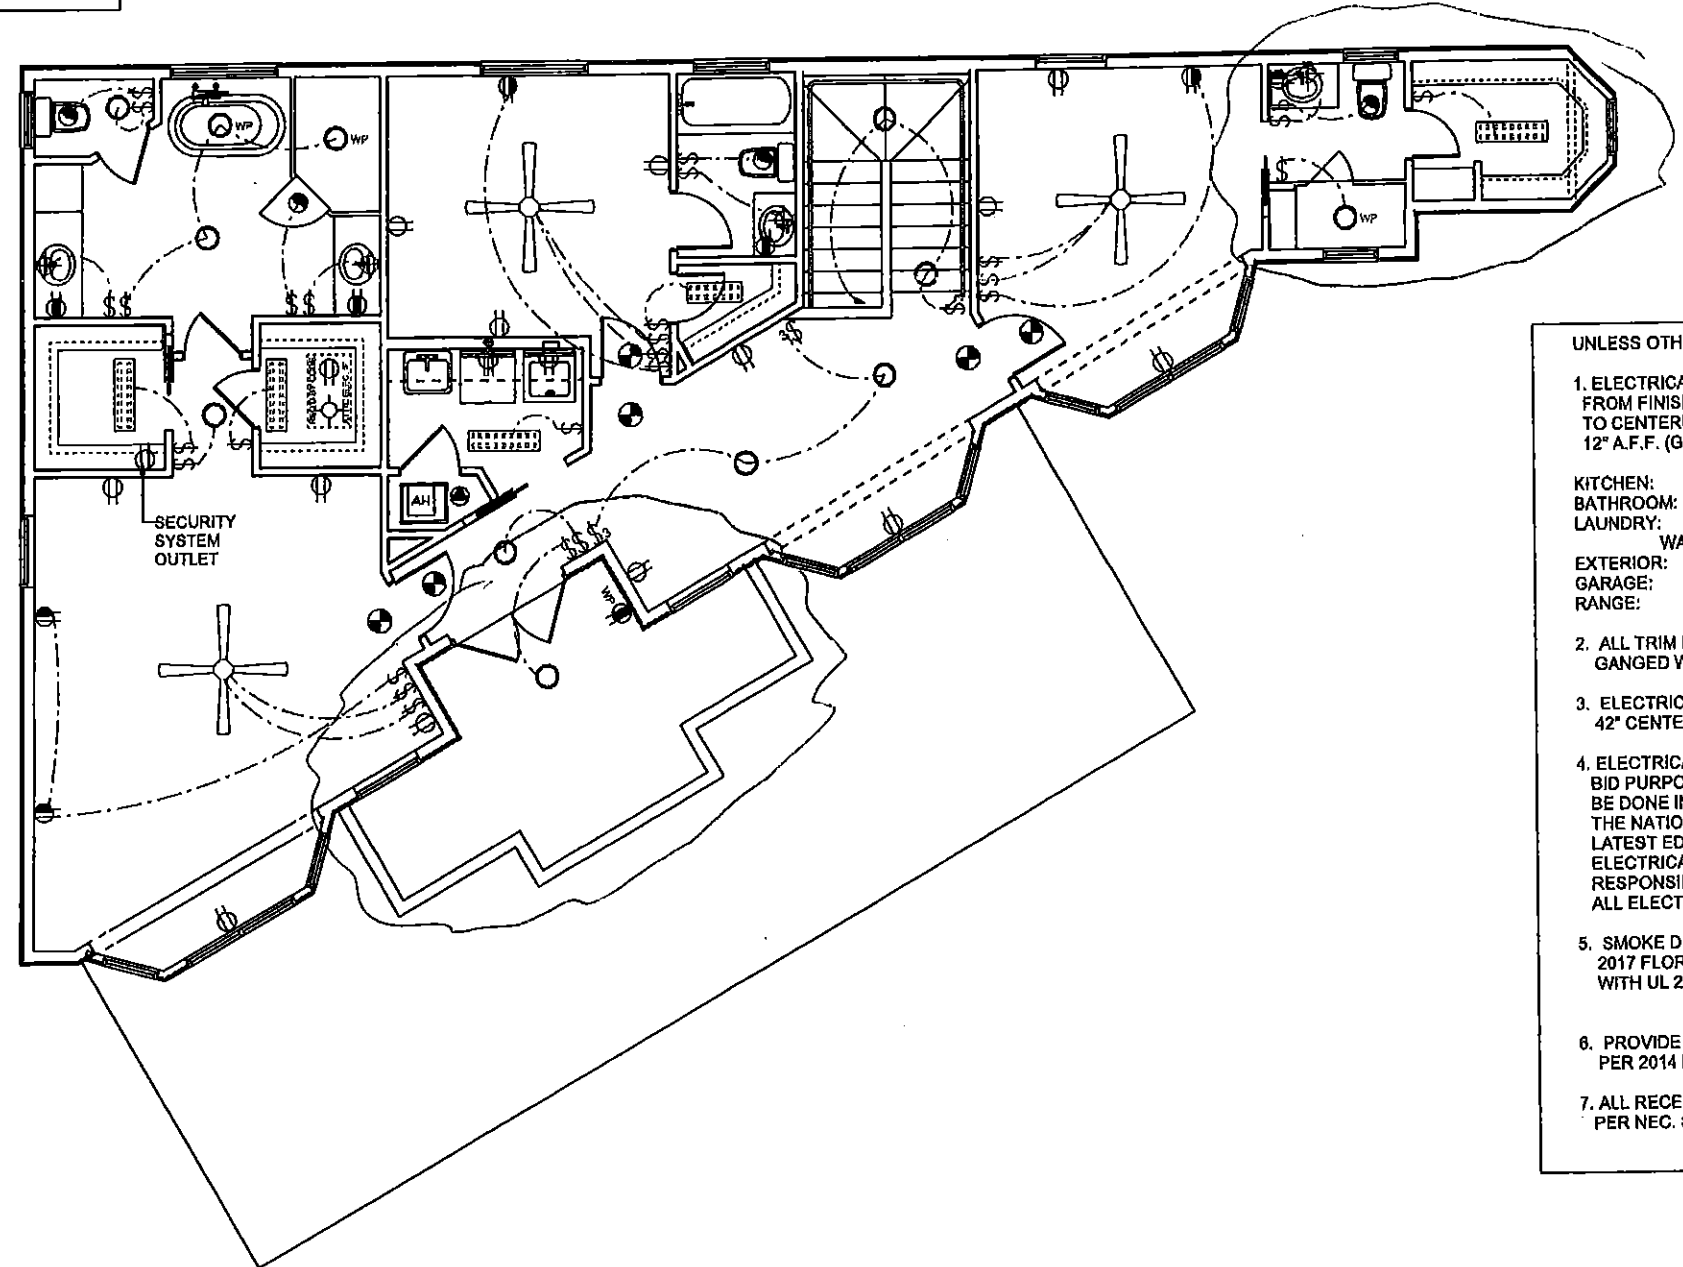

- UNLESS OTHERWISE NOTED:
1. ELECTRICAL OUTLET HEIGHTS MEASURED FROM FINISH FLOOR TO CENTERLINE OF THE BOX TO BE 12" A.F.F. (GENERAL)
  2. ALL TRIM PLATES AND DEVICES TO BE GANGED WHERE POSSIBLE
  3. ELECTRICAL SWITCHES TO BE AT 42" CENTERLINE A.F.F.
  4. ELECTRICAL PLAN INTENDED FOR BID PURPOSES ONLY. ALL WORK SHALL BE DONE IN STRICT ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE, LATEST EDITION BY A LICENSED ELECTRICAL CONTRACTOR WHO SHALL BE RESPONSIBLE FOR THE INSTALLATION AND SIZING OF ALL ELECTRICAL WIRING AND ACCESSORIES.
  5. SMOKE DETECTORS SHALL BE IN ACCORDANCE WITH 2017 FLORIDA RESIDENTIAL CODE, SECTION 314, AND WITH UL 217 AND NFPA 720.
  6. PROVIDE ARC FAULT INTERRUPTERS PER 2014 NEC. 210.12
  7. ALL RECEPTACLES TO BE TAMPER PROOF PER NEC. SECT. 408.11

PLANS EXAMINED AND REVIEWED FOR COMPLIANCE IN ACCORDANCE WITH THE BUILDING CODE OF SAFETY HARBOR BUILDING CODE WITH EXCEPTIONS NOTED  
 FEB 21 2018  
 THE ISSUANCE OF THIS PERMIT SHALL BE HELD TO PERMIT OR APPROVE THE VIOLATION OF ANY CITY, COUNTY OR STATE LAW CODE REGULATION OR ORDINANCE

PLAN 3020

SCALE 1/8" = 1'-0"

2ND FLOOR ELECTRICAL PLAN










LOT 22 HAMILTON AVE  
SAFETY HARBOR

1. PRELIMINARY PLANS (VERSION 8)  
2. STRUCTURAL ENG. REVIEW (VERSION 8)

PLAN DATE
1. 12-06-2018
2. 12-11-2018

DEEB FAMILY HOMES, LTD.  
9400 RIVER CROSSING BLD.  
NEW PORT RICHEY, FL. 34655

7A

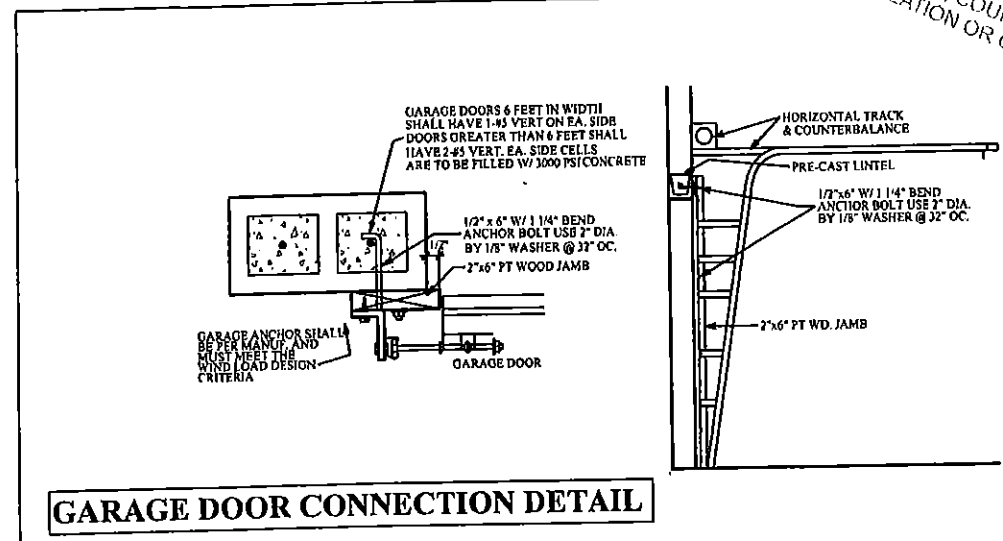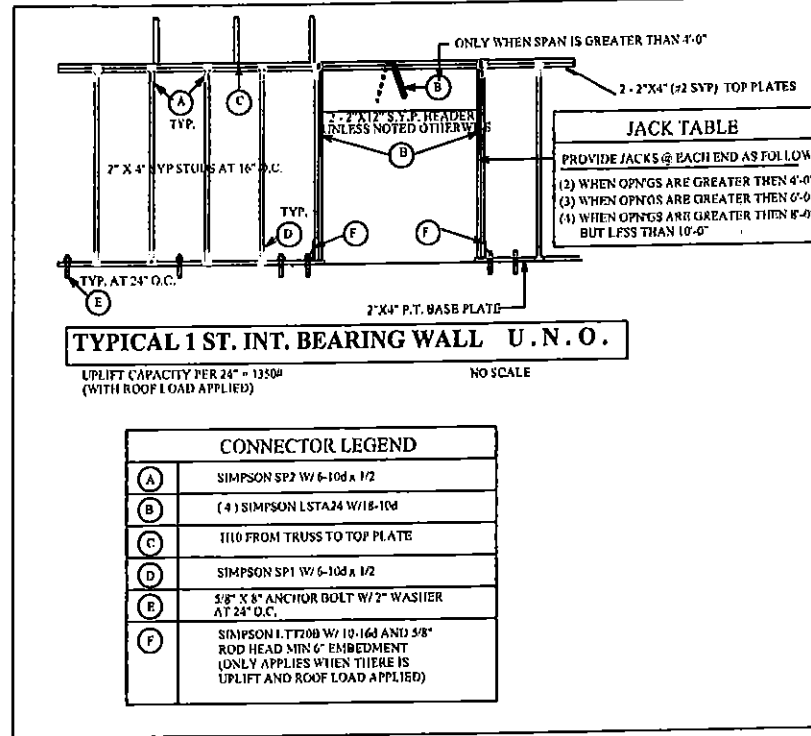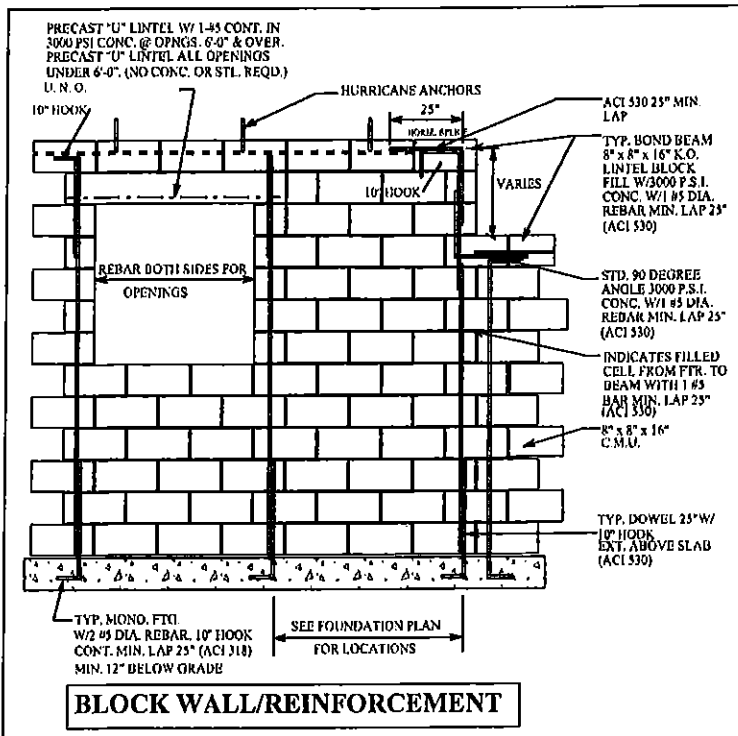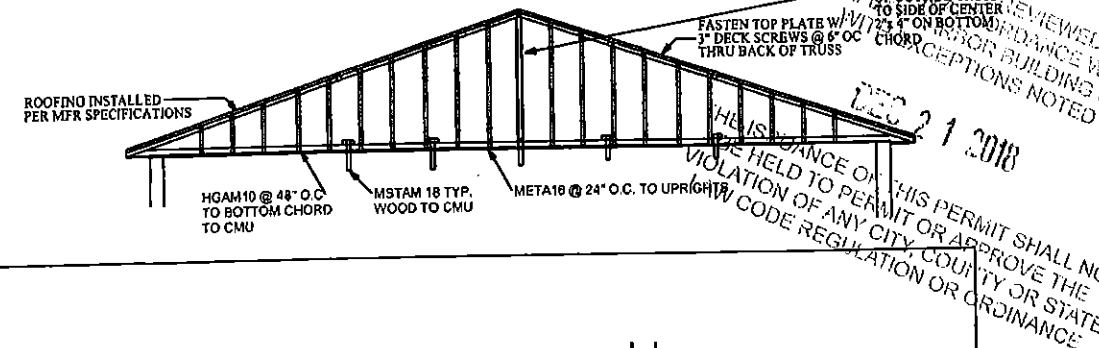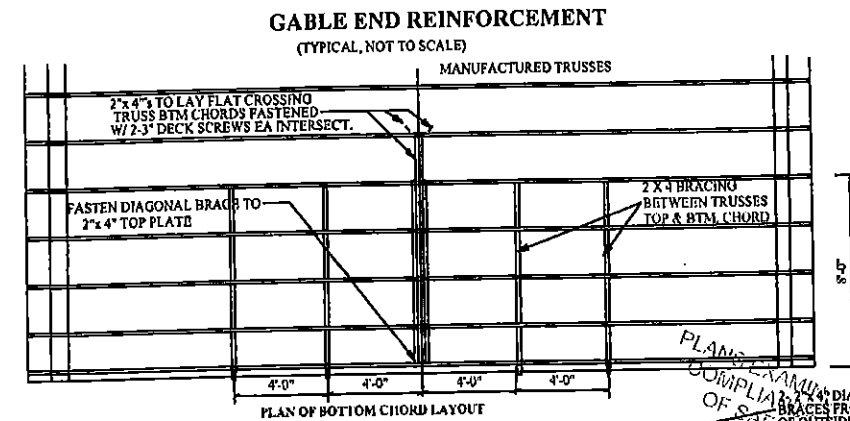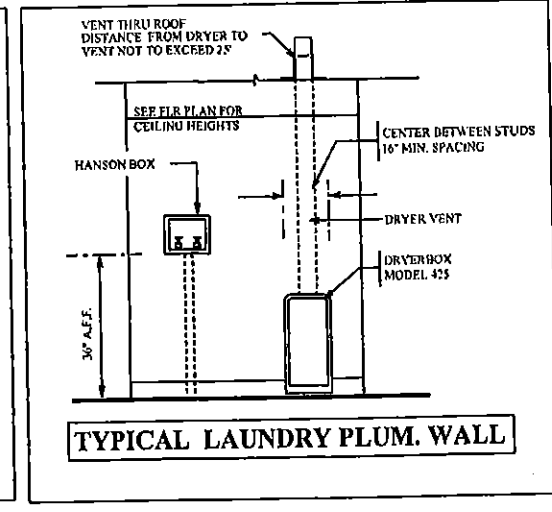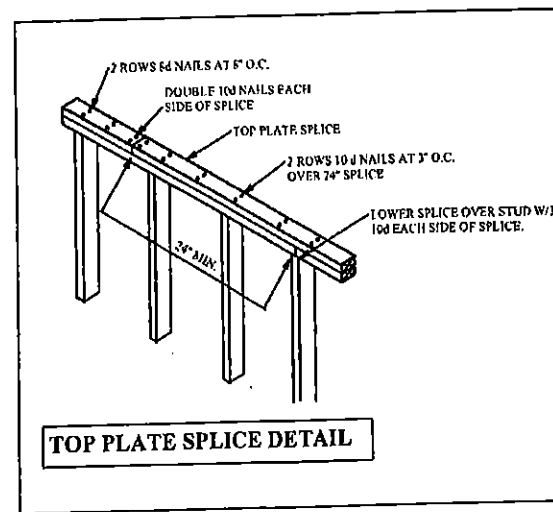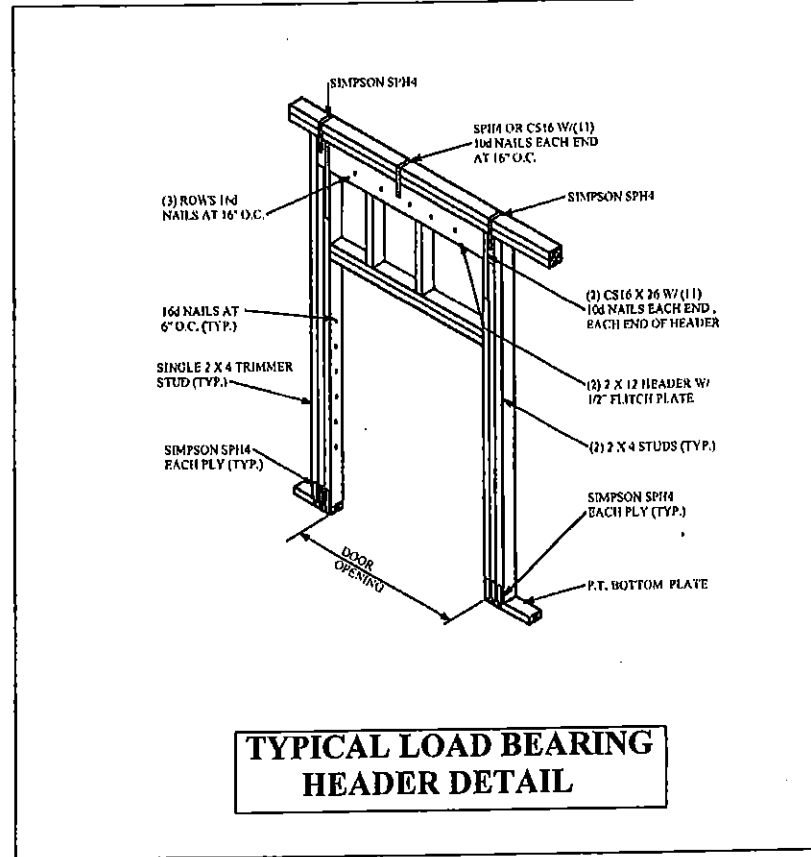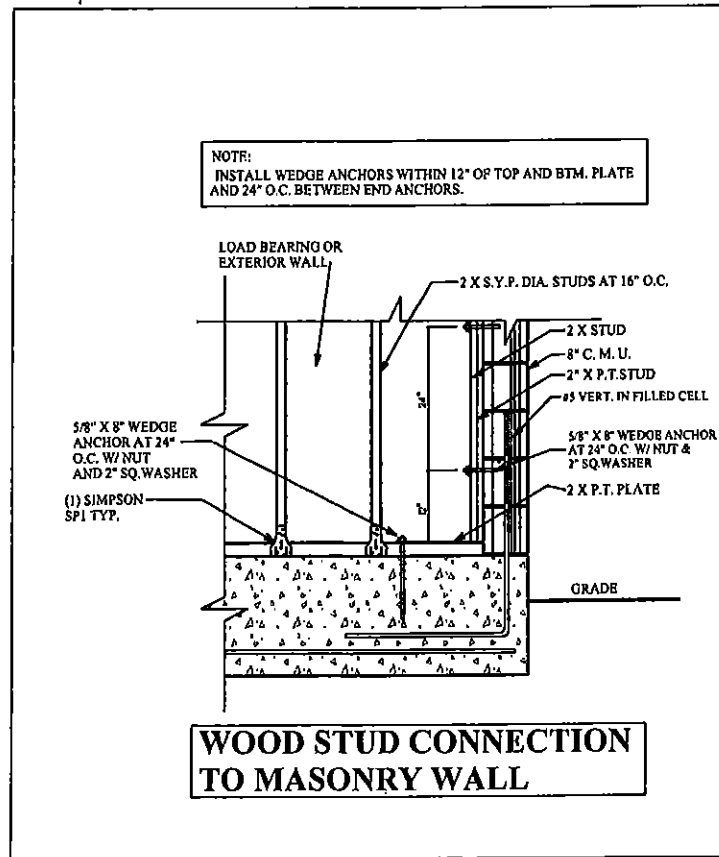

A.E.C.S.: 18040 PLAN 3020

CONST. DETAILS

ALLEN ENGINEERING & CONSTRUCTION SERVICES  
RICH ALLEN PROFESSIONAL ENGINEER  
P.E. # 56820 C.A. # 9542  
8809 SKYMASTER DR.  
NEW PORT RICHEY, FL. 34654  
727-942-6100  
richallenpe@gmail.com


EVERY CERTIFICATE I HAVE PERFORMED THE ATTACHED DESIGN TO COMPLY WITH 145 MPH ULTIMATE WIND LOADS AND IT IS IN COMPLIANCE WITH SECT. 307 OF THE 2017 FLORIDA RESIDENTIAL BUILDING CODE SEALED FOR STRUCTURE ONLY  
SIGNATURE: RICH ALLEN P.E. # 56820

INVENTORY LOT 22  
365 HAMILTON AVE  
SAFETY HARBOR

PLAN DATE
07-17-18
09-17-18
12-11-18

DEEB FAMILY HOMES, LTD.  
9400 RIVER CROSSING BLD.  
NEW PORT RICHEY, FL. 34655  
727-376-6831

8

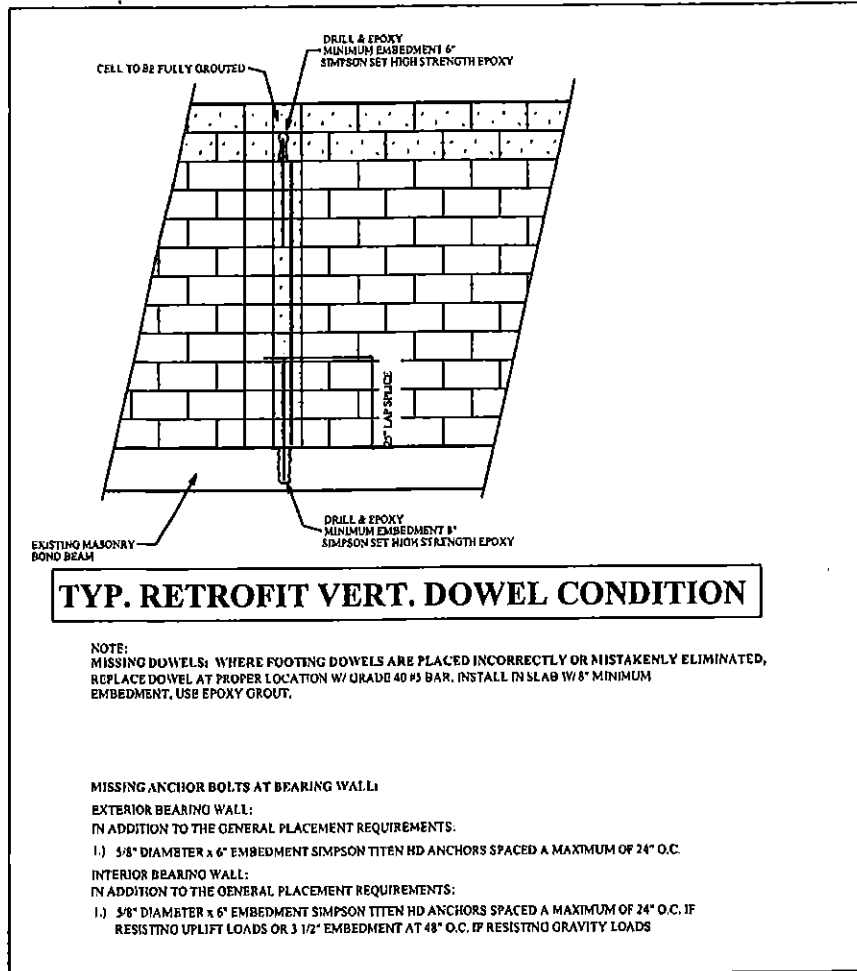


**TYP. RETROFIT VERT. DOWEL CONDITION**

NOTE:  
MISSING DOWELS: WHERE FOOTING DOWELS ARE PLACED INCORRECTLY OR MISTAKENLY ELIMINATED, REPLACE DOWEL AT PROPER LOCATION W/ GRADE 40 #5 BAR. INSTALL IN SLAB W/ 8" MINIMUM EMBEDMENT. USE EPOXY GROUT.


**MISSING ANCHOR BOLTS AT BEARING WALL:**

- EXTERIOR BEARING WALL:  
IN ADDITION TO THE GENERAL PLACEMENT REQUIREMENTS:  
1) 5/8" DIAMETER x 6" EMBEDMENT SIMPSON TITEN HD ANCHORS SPACED A MAXIMUM OF 24" O.C.
- INTERIOR BEARING WALL:  
IN ADDITION TO THE GENERAL PLACEMENT REQUIREMENTS:  
1) 5/8" DIAMETER x 6" EMBEDMENT SIMPSON TITEN HD ANCHORS SPACED A MAXIMUM OF 24" O.C. IF RESISTING UPLIFT LOADS OR 3 1/2" EMBEDMENT AT 48" O.C. IF RESISTING GRAVITY LOADS

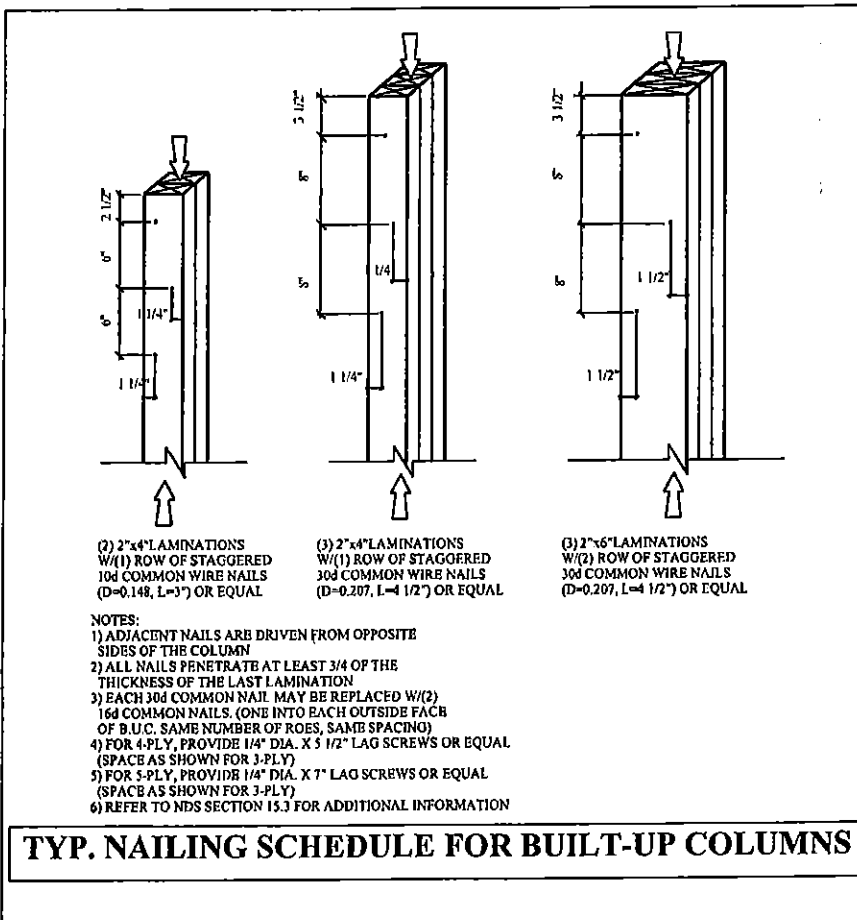


**TYP. NAILING SCHEDULE FOR BUILT-UP COLUMNS**

- NOTES:  
1) ADJACENT NAILS ARE DRIVEN FROM OPPOSITE SIDES OF THE COLUMN  
2) ALL NAILS PENETRATE AT LEAST 3/4 OF THE THICKNESS OF THE LAST LAMINATION  
3) EACH 30d COMMON NAIL MAY BE REPLACED W/ (2) 16d COMMON NAILS. (ONE INTO EACH OUTSIDE FACE OF B.U.C. SAME NUMBER OF ROWS, SAME SPACING)  
4) FOR 4-PLY, PROVIDE 1/4" DIA. X 5 1/2" LAG SCREWS OR EQUAL (SPACE AS SHOWN FOR 3-PLY)  
5) FOR 3-PLY, PROVIDE 1/4" DIA. X 7" LAG SCREWS OR EQUAL (SPACE AS SHOWN FOR 3-PLY)  
6) REFER TO NDS SECTION 15.3 FOR ADDITIONAL INFORMATION

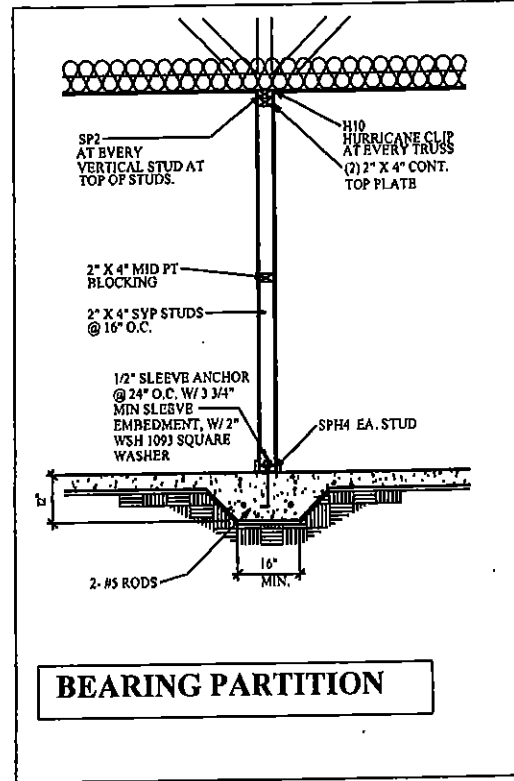

**BEARING PARTITION**

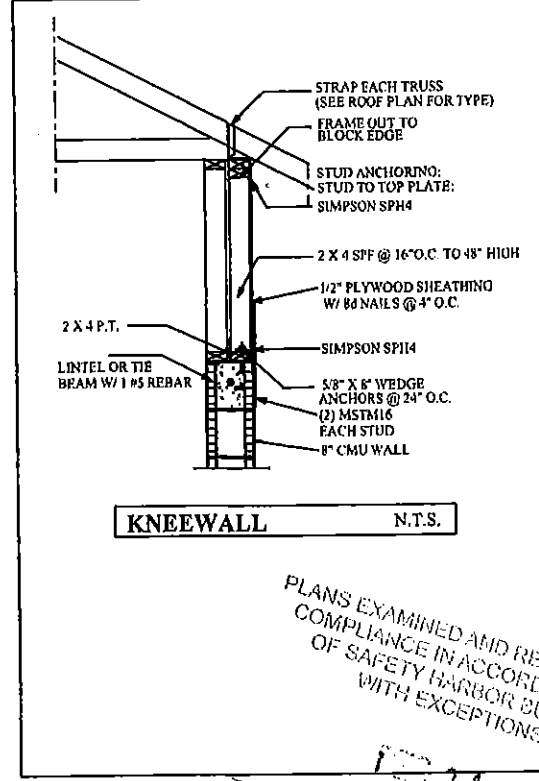

**KNEEWALL N.T.S.**

PLANS EXAMINED AND REVIEWED FOR CODE COMPLIANCE IN ACCORDANCE WITH CITY OF SAFETY HARBOR BUILDING CODE WITH EXCEPTIONS NOTED

FEB 21 2018

THE ISSUANCE OF THIS PERMIT SHALL NOT BE HELD TO PERMIT OR APPROVE THE VIOLATION OF ANY CITY, COUNTY OR STATE LAW CODE REGULATION OR ORDINANCE

**CONST. DETAILS**

**INVENTORY LOT 22**  
**365 HAMILTON AVE**  
**SAFETY HARBOR**

**PLAN DATE**  
07-17-18;  
09-17-18;  
12-11-18;

**DEEB FAMILY HOMES, LTD.**  
9400 RIVER CROSSING BLD.  
NEW PORT RICHEY, FL 34655  
727-376-6831

**A.E.C.S. 18040 PLAN 3020**

**ALLEN ENGINEERING & CONSTRUCTION SERVICES**  
RICH ALLEN PROFESSIONAL ENGINEER  
P.E. # 56920 C.A. # 9542  
8809 SKYMASTER DR.  
NEW PORT RICHEY, FL 34654  
727-842-6100  
richallenpe@gmail.com


HEREBY CERTIFY THAT I HAVE PERFORMED THE ATTACHED DESIGN TO COMPLY WITH THE APPLICABLE WIND LOADS AND ULS IN COMPLIANCE WITH SECT. 301 OF THE 2017 FLORIDA RESIDENTIAL BUILDING CODE SEALED FOR STRUCTURE ONLY  
SIGNED: RICH ALLEN P.E. #56920

**9**



**CONNECTOR TABLE**

SIMPSON	FLORIDA PRODUCT NUMBERS PER INDEX 2-25-2011
MBHA3.56/11.88	10866.12
H2	10458.10
H8	10456.19
H10	10456.6
LQ12	11470.6
ND1	11470.7
LSTA18	10852.4
LSTA24	10852.4
SP1	10450.41
SP2	10450.42
HTS20	10450.23
HTS18	10450.22
META18	11473.17
L30	10440.11
MSTAM24	11473.19
MSTAM36	11473.19
MSTCM60	11473.19
CS18	10852.1
SPH4	10450.48
SPH8	10450.47
HTT4	11400.2
HTT6	11400.2
ABU68	10849.8
LEC4	11478.4

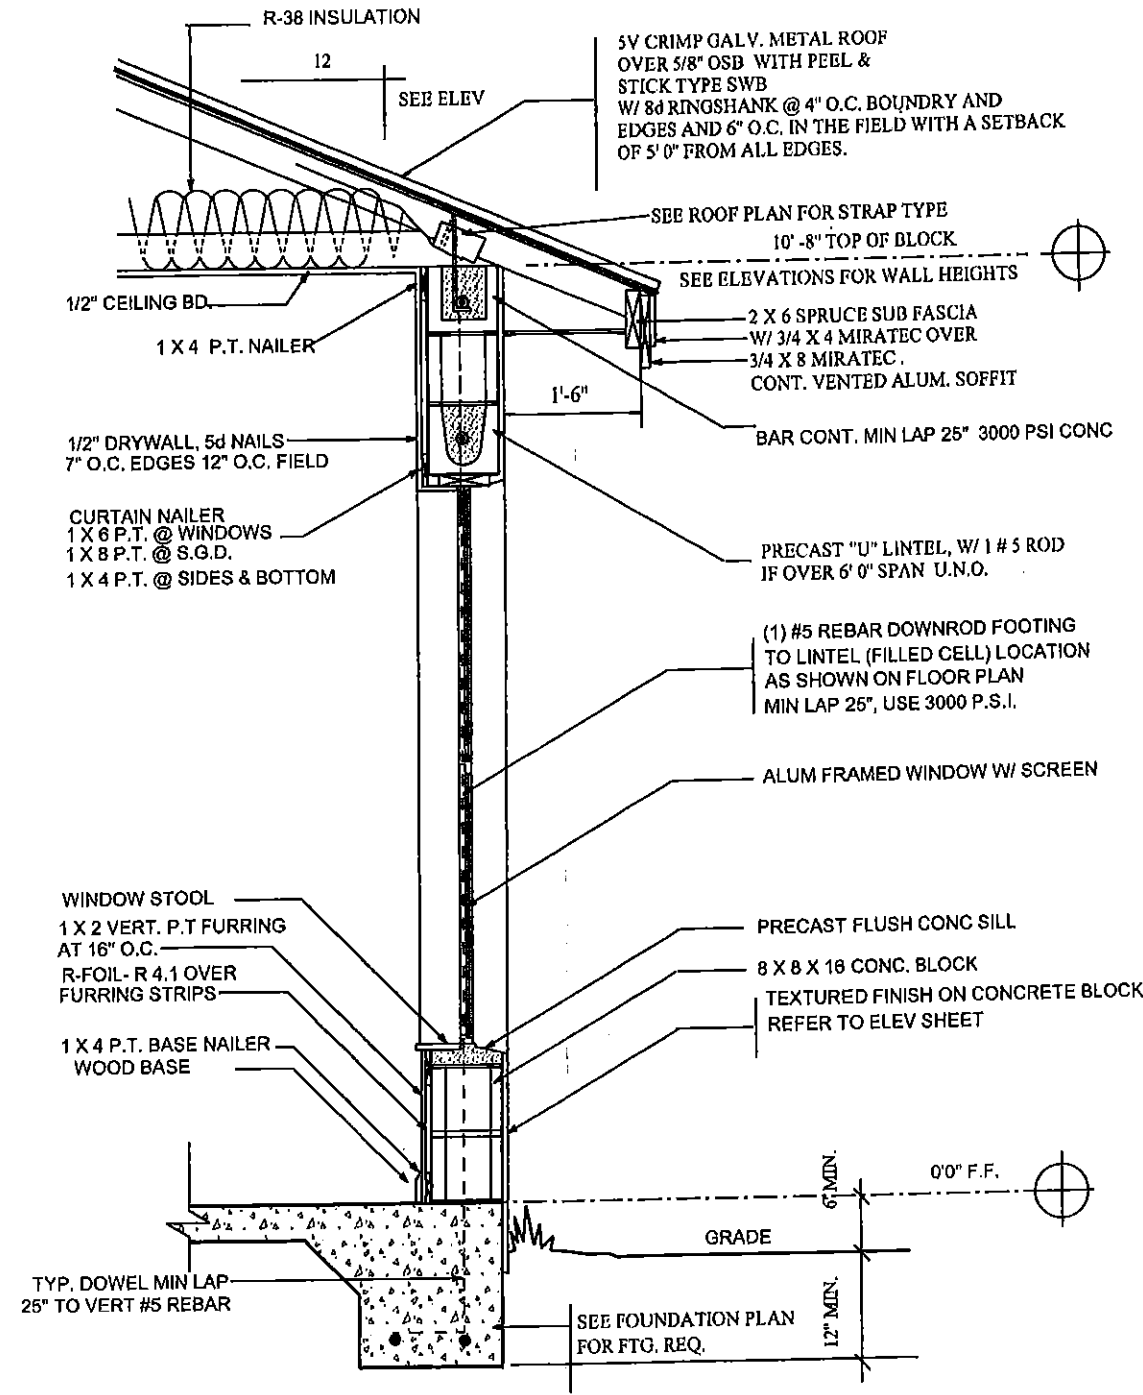


**TYPICAL WALL SECTION**

**TERMITE SPECIFICATIONS:**  
 INSTALL "BORA-CARE" TERMITE PROTECTION SYSTEM PER MANUF. SPECIFICATIONS


PLANS EXAMINED AND REVIEWED FOR COMPLIANCE IN ACCORDANCE WITH THE CITY OF SAFETY HARBOR BUILDING CODE WITH EXCEPTIONS NOTED

21 2018

THE ISSUANCE OF THIS PERMIT SHALL NOT BE HELD TO PERMIT OR APPROVE THE COMPLIANCE OF ANY CITY, COUNTY OR STATE LAW CODE REGULATIONS OR ORDINANCE

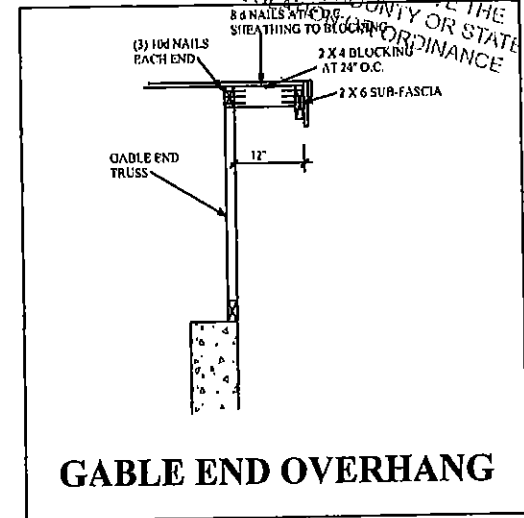

**GABLE END OVERHANG**

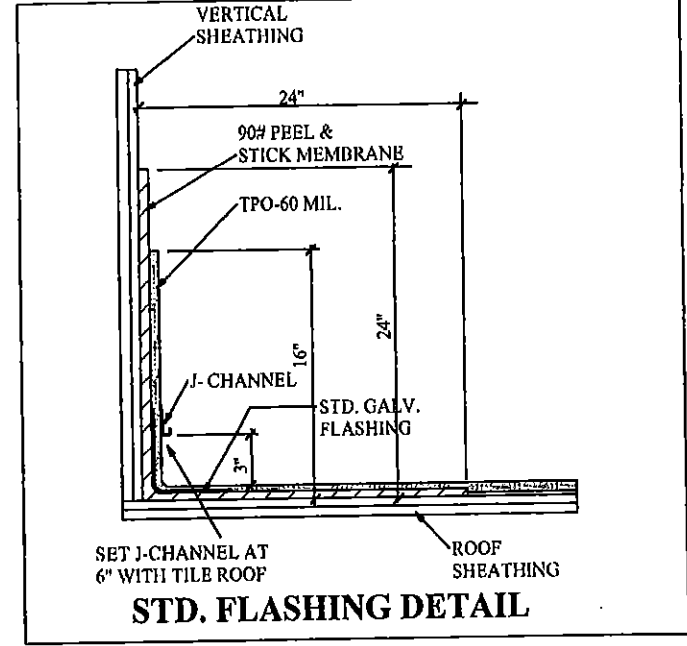

**STD. FLASHING DETAIL**

PLAN 3020

A.E.C. 18040

INVENTORY LOT 22  
 365 HAMILTON AVE  
 SAFETY HARBOR

PLAN DATE
07-17-18
09-17-18
12-11-18


CONST. DETAILS

DEEB FAMILY HOMES, LTD.  
 9400 RIVER CROSSING BLD.  
 NEW PORT RICHEY, FL 34655  
 727-376-6831

10

ALLEN ENGINEERING & CONSTRUCTION SERVICES  
 RICH ALLEN PROFESSIONAL ENGINEER  
 P.E. # 56928 C.A. # 9542  
 8809 SKYMASTER DR.  
 NEW PORT RICHEY, FL 34654  
 727-842-6100  
 richallenpe@gmail.com

HEREBY CERTIFY THAT I HAVE PERFORMED THE ATTACHED DESIGN TO COMPLY WITH 145 MPH ULTIMATE WIND LOADS AND IT IS IN COMPLIANCE WITH SECT. 301 OF THE 2017 FLORIDA RESIDENTIAL BUILDING CODE SEALED FOR STRUCTURE ONLY  
 SIGNATURE: RICH ALLEN  
 P.E. # 56928

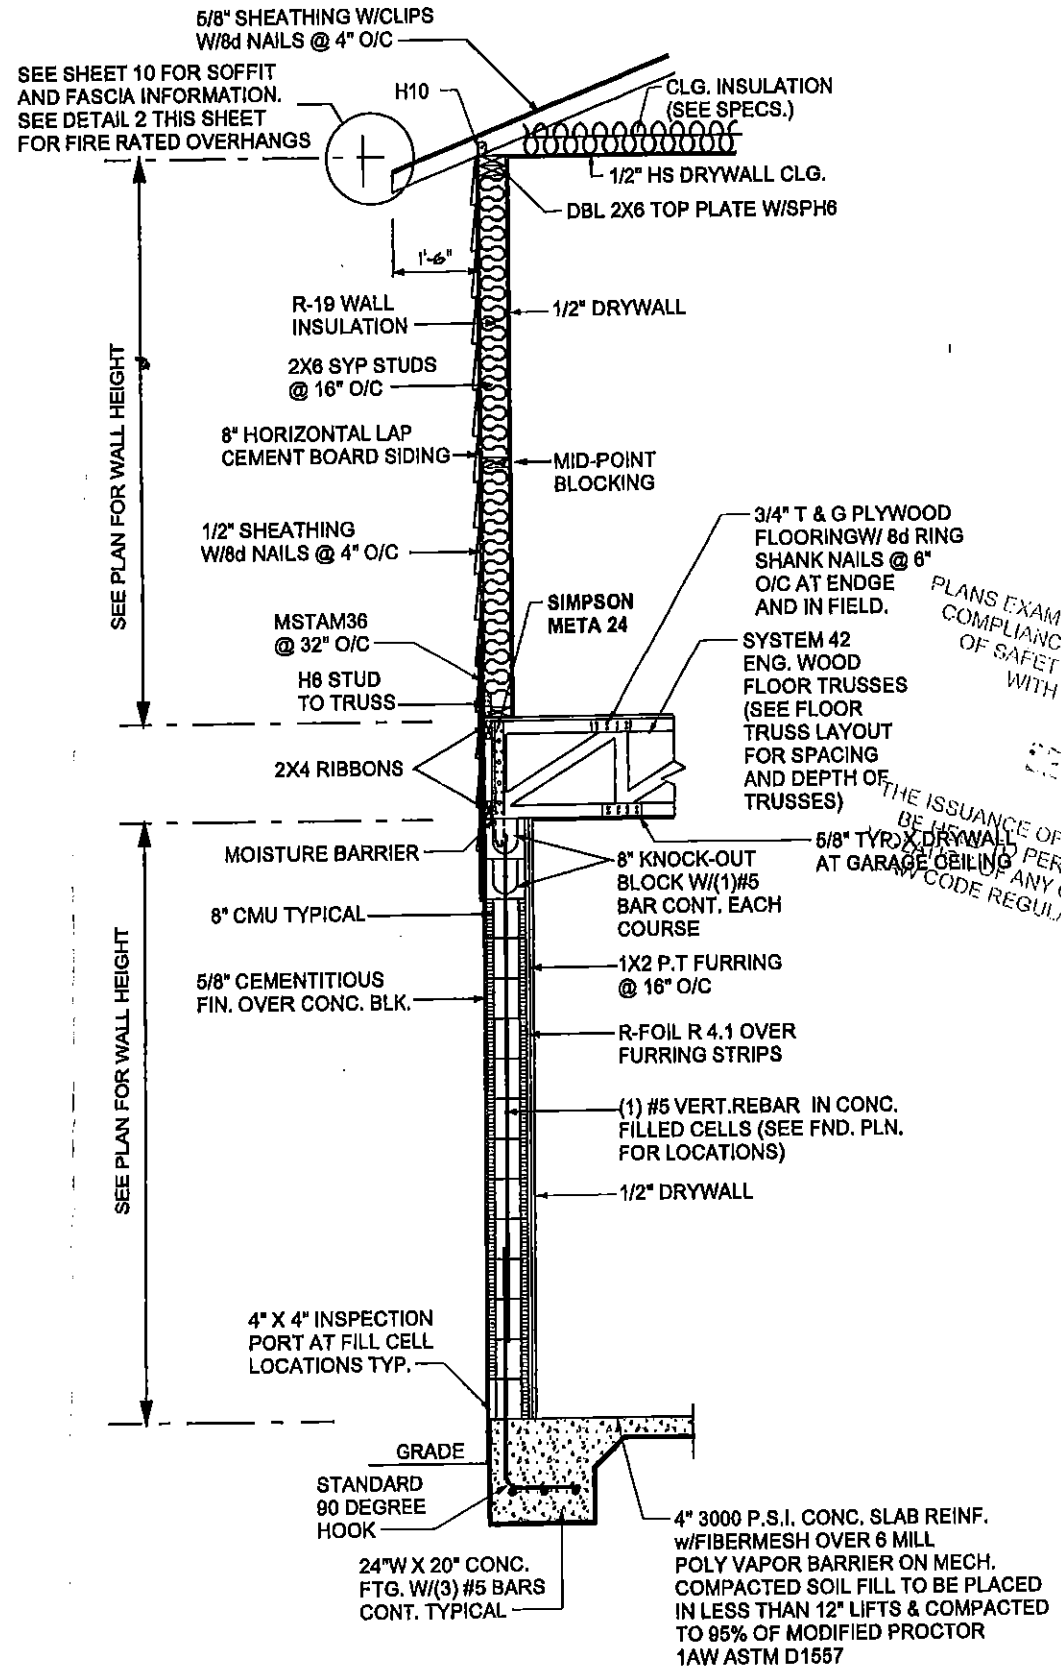

1 TYP. 2-STORY WALL SECT.

2-STORY WALL SECTIONS

PLAN 3020  
A.E.C.S. #18040

10A

DEEB FAMILY  
HOMES, LTD.  
9400 RIVER CROSSING BLD.  
NEW PORT RICHEY, FL. 34655

PLAN DATE
1. 12-06-2018
2. 12-11-2018


LOT 22 HAMILTON  
SAFETY HARBOR

1. PRELIMINARY PLANS  
2. STRUCTURAL ENG. REVIEW (VERSION 9)


I HEREBY CERTIFY THAT I HAVE  
PERFORMED THE ATTACHED DESIGN  
TO COMPLY WITH THE MINIMUM  
WIND LOADS, EXPOSURE D AND IT IS  
IN COMPLIANCE WITH SECTION 901 OF  
THE 2017 FLORIDA RESIDENTIAL  
BUILDING CODE.  
SEAL AND SIGNATURE OF THE ONLY  
REGISTERED PROFESSIONAL ENGINEER  
RICH ALLEN P.E. #56542

ALLEN ENGINEERING &  
CONSTRUCTION SERVICES  
RICH ALLEN PROFESSIONAL ENGINEER  
P.E. #56542 C.A. #9542  
8809 SKYMASTER DRIVE  
NEW PORT RICHEY, FL. 34654  
727-942-6100  
richallenpe@gmail.com


PLANS EXAMINED AND REVIEWED FOR CODE  
COMPLIANCE IN ACCORDANCE WITH CITY  
OF SAFETY HARBOR BUILDING CODE  
WITH EXCEPTIONS NOTED  
DEC 21 2018  
THE ISSUANCE OF THIS PERMIT SHALL NOT  
BE HELD TO PERMIT OR APPROVE THE  
COMPLIANCE WITH ANY CITY, COUNTY OR STATE  
BUILDING CODE REGULATION OR ORDINANCE

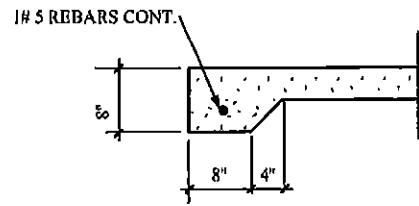


**8" THICKENED SLAB (J)**

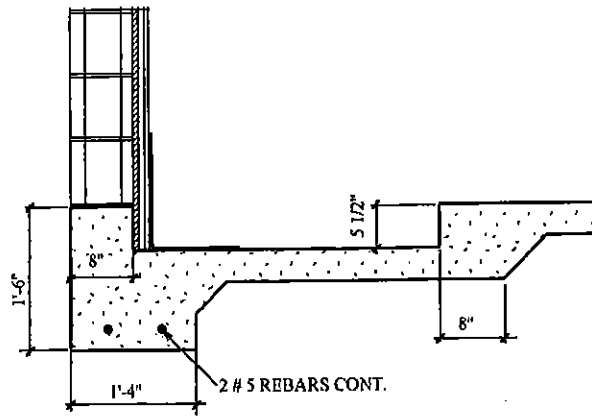


**SHOWER RECESS (G)**

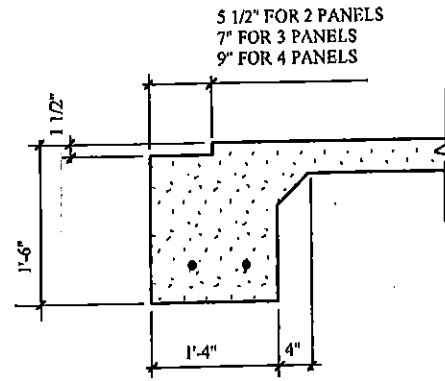


**SLIDING GLASS DR. RECESS (D)**

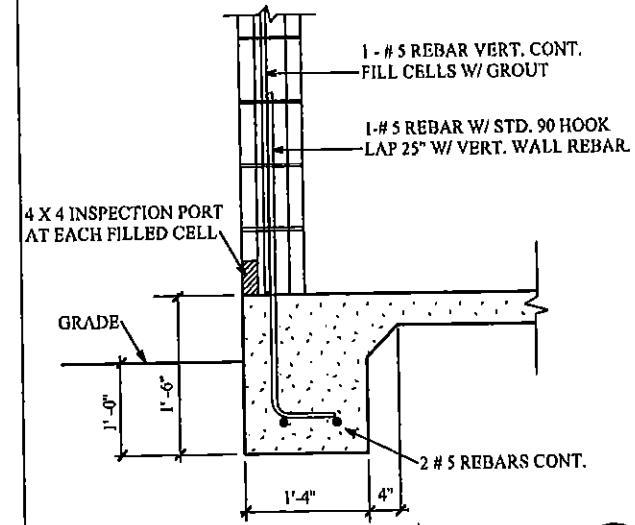


**TYPICAL ONE STORY (A)**

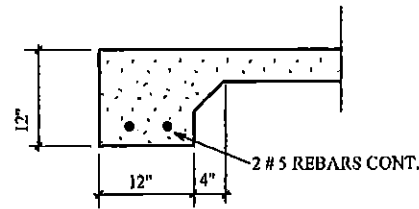


**12" THICKENED SLAB (K)**

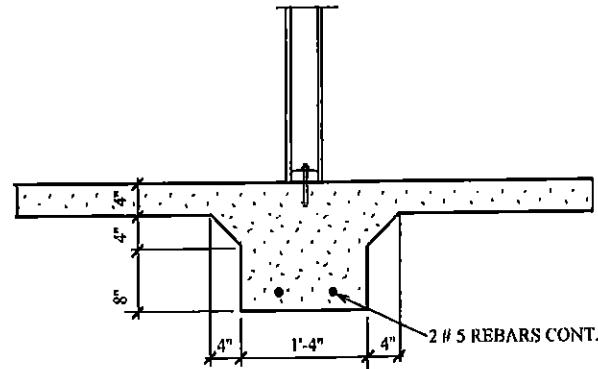


**INTERIOR BEARING FTG. (H)**

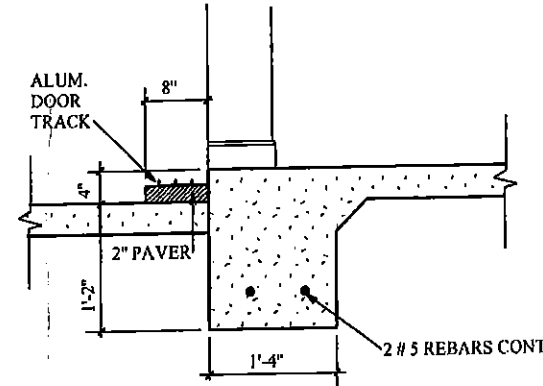


**EXTERIOR POCKET S.G.D. (E)**

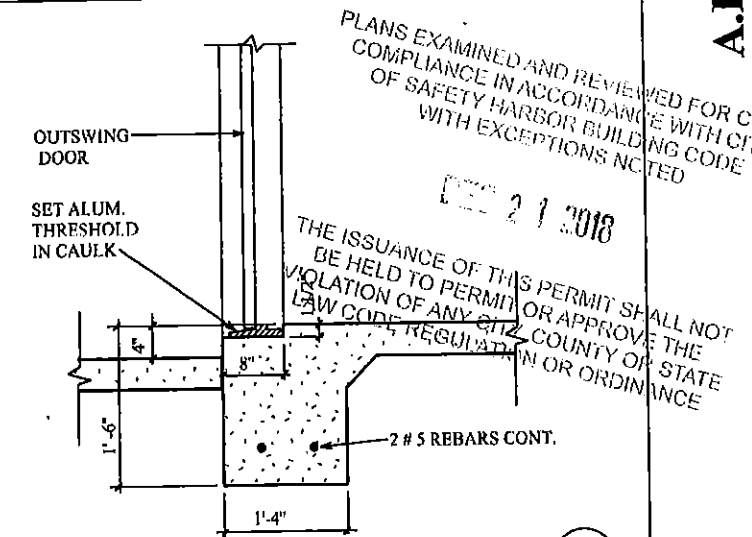


**EXTERIOR DOOR RECESS (B)**

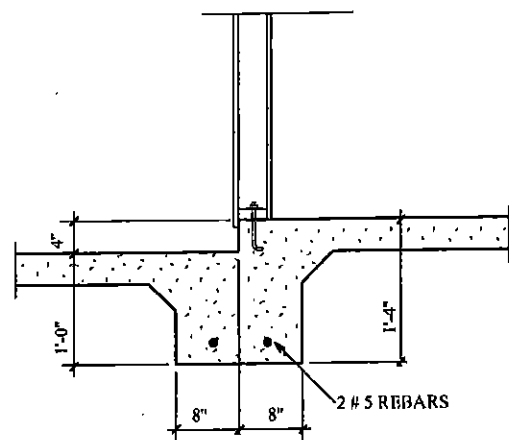

**BEARING GARAGE STEP (I)**

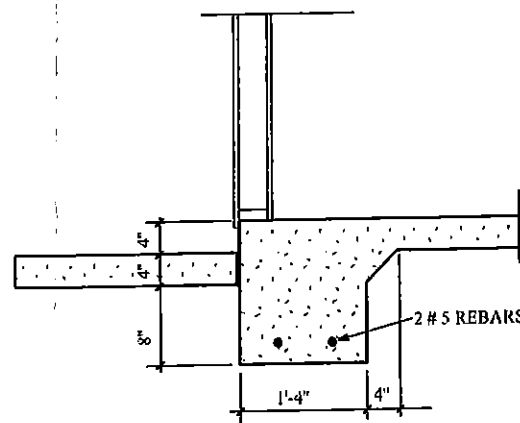

**NON-BRG. GARAGE STEP (F)**

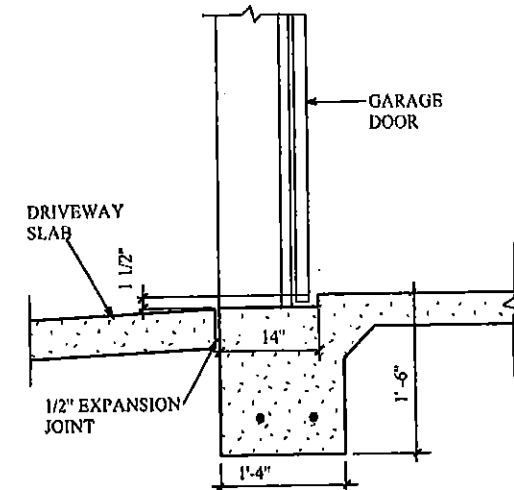

**GARAGE DOOR RECESS (C)**

**FOOTING DETAILS**

**A.E.C.S. 18040 PLAN 3020**

**INVENTORY LOT 22  
365 HAMILTON AVE  
SAFETY HARBOR**

PLAN DATE
07-17-18
09-17-18
12-11-18

**DEEB FAMILY  
HOMES, LTD.  
9400 RIVER CROSSING BLD.  
NEW PORT RICHEY, FL. 34655  
727-376-6831**

**11**

**ALLEN ENGINEERING &  
CONSTRUCTION SERVICES  
RICH ALLEN PROFESSIONAL ENGINEER  
P.E. # 56970 C.A. # 9542  
3809 SKYMASTER DR.  
NEW PORT RICHEY, FL. 34654  
727-842-6100  
richallenpe@gmail.com**

**PLANS EXAMINED AND REVIEWED FOR COMPLIANCE IN ACCORDANCE WITH CITY OF SAFETY HARBOR BUILDING CODE WITH EXCEPTIONS NOTED**  
21 2018  
THE ISSUANCE OF THIS PERMIT SHALL NOT BE HELD TO PERMIT OR APPROVE THE VIOLATION OF ANY CITY, COUNTY OR STATE LAW, CODE, REGULATION OR ORDINANCE

**RICHARD E. ALLEN P.E. #6520**